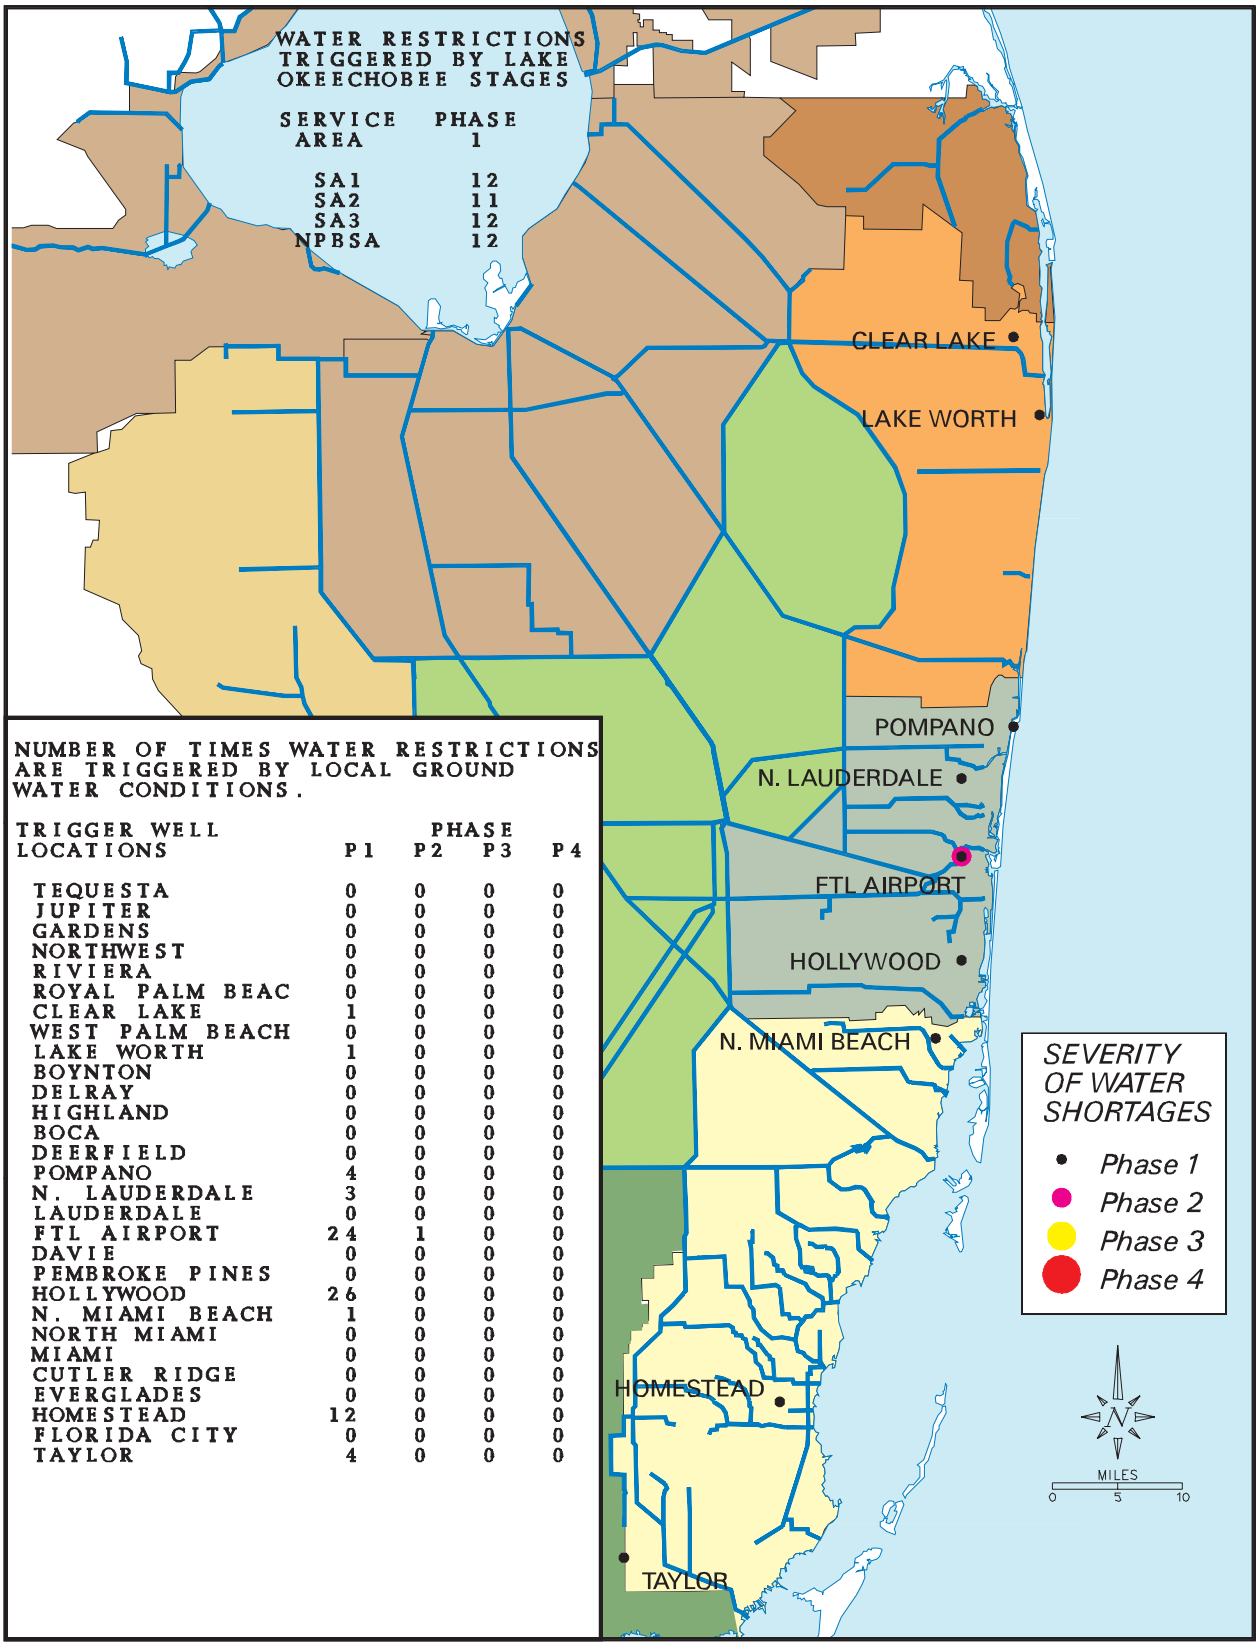

NUMBER OF TIMES WATER RESTRICTIONS ARE TRIGGERED BY LOCAL GROUND WATER CONDITIONS.

TRIGGER WELL LOCATIONS	PHASE P1	P2	P3	P4
TEQUESTA	0	0	0	0
JUPITER	0	0	0	0
GARDENS	0	0	0	0
NORTHWEST	0	0	0	0
RIVIERA	0	0	0	0
ROYAL PALM BEAC	0	0	0	0
CLEAR LAKE	1	0	0	0
WEST PALM BEACH	0	0	0	0
LAKE WORTH	1	0	0	0
BOYNTON	0	0	0	0
DELRAY	0	0	0	0
HIGHLAND	0	0	0	0
BOCA	0	0	0	0
DEERFIELD	0	0	0	0
POMPANO	4	0	0	0
N. LAUDERDALE	3	0	0	0
LAUDERDALE	0	0	0	0
FTL AIRPORT	24	1	0	0
DAVIE	0	0	0	0
PEMBROKE PINES	0	0	0	0
HOLLYWOOD	26	0	0	0
N. MIAMI BEACH	1	0	0	0
NORTH MIAMI	0	0	0	0
MIAMI	0	0	0	0
CUTLER RIDGE	0	0	0	0
EVERGLADES	0	0	0	0
HOMESTEAD	12	0	0	0
FLORIDA CITY	0	0	0	0
TAYLOR	4	0	0	0

Frequency & Severity of Water Restriction Triggers for

SFWMM v3.4 - ALT 3 SOCA1LR (RESTUDY)