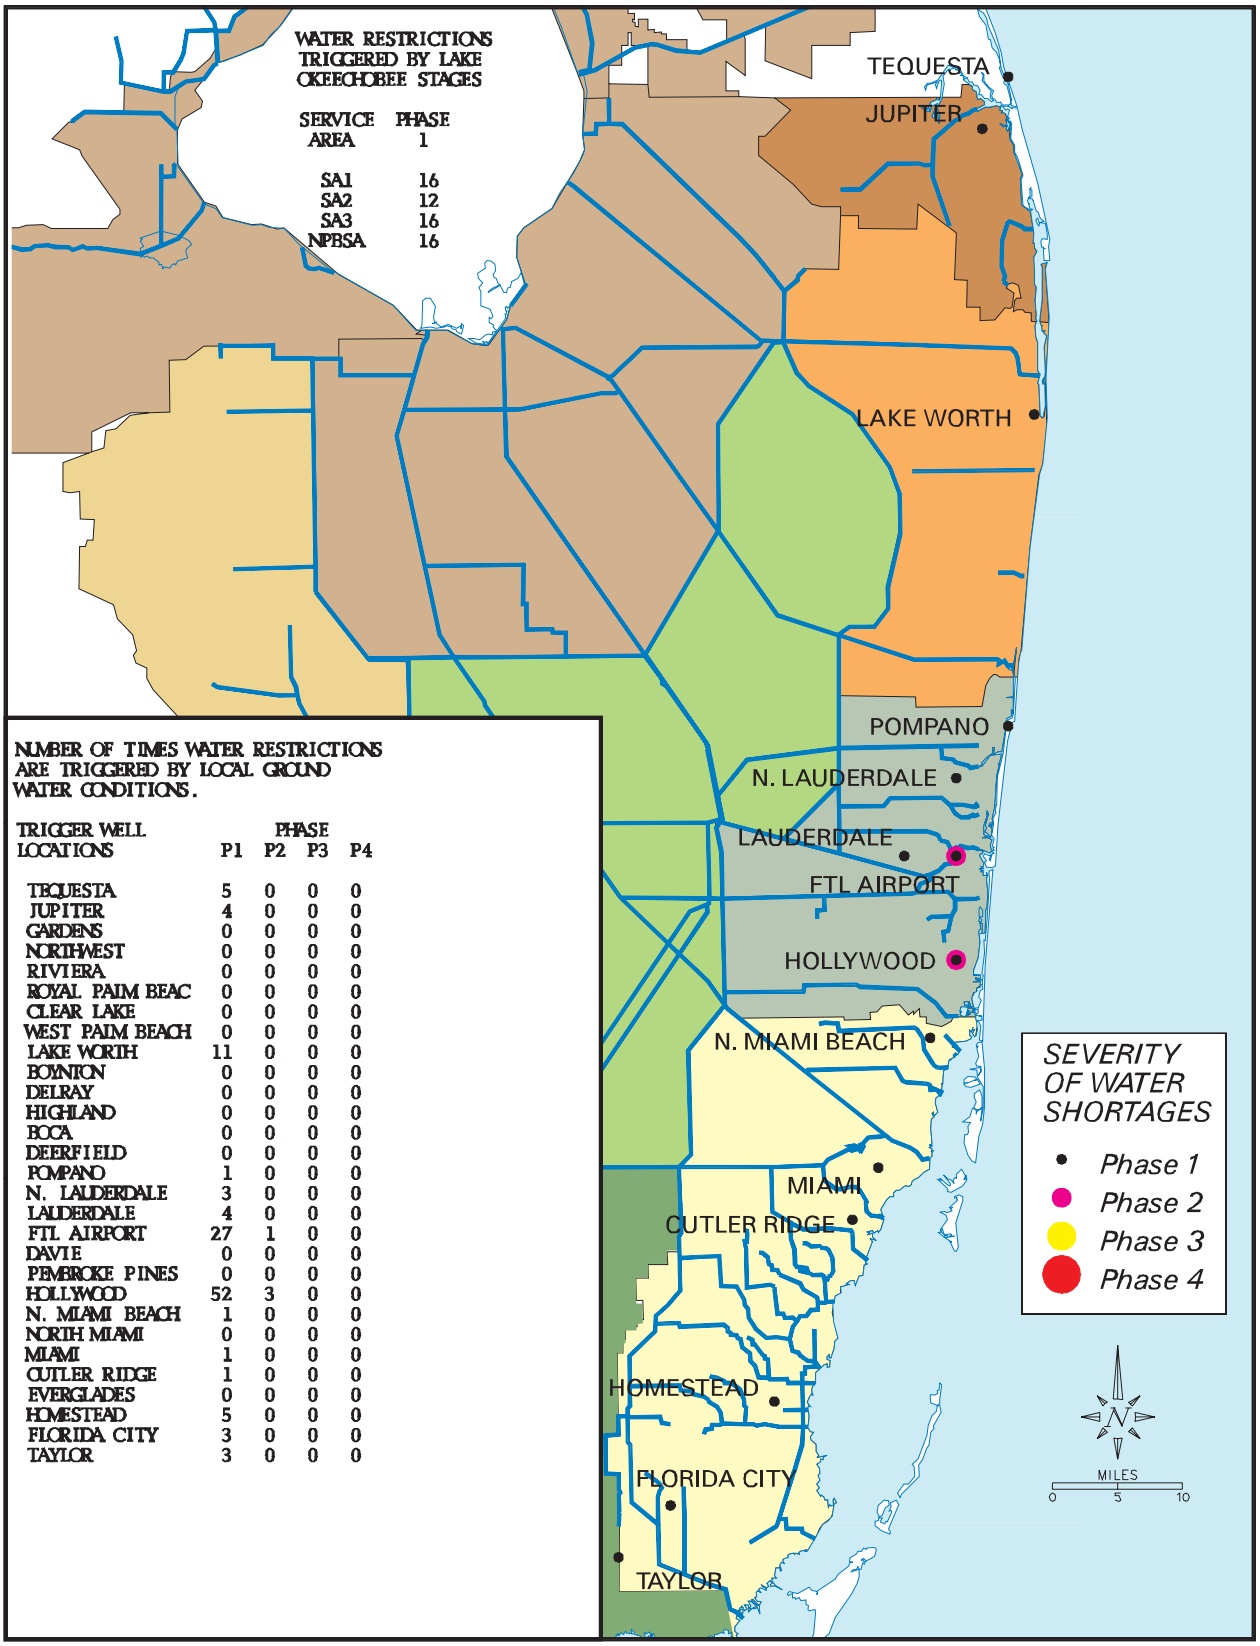

WATER RESTRICTIONS TRIGGERED BY LAKE OKEECHOBEE STAGES

SERVICE AREA	PHASE 1
SA1	16
SA2	12
SA3	16
NPBSA	16

NUMBER OF TIMES WATER RESTRICTIONS ARE TRIGGERED BY LOCAL GROUND WATER CONDITIONS.

TRIGGER WELL LOCATIONS	PHASE P1	P2	P3	P4
TEQUESTA	5	0	0	0
JUPITER	4	0	0	0
GARDENS	0	0	0	0
NORTHWEST	0	0	0	0
RIVIERA	0	0	0	0
ROYAL PAIM BEAC	0	0	0	0
CLEAR LAKE	0	0	0	0
WEST PAIM BEACH	0	0	0	0
LAKE WORTH	11	0	0	0
BOYNTON	0	0	0	0
DELRAY	0	0	0	0
HIGHLAND	0	0	0	0
BOCA	0	0	0	0
DEERFIELD	0	0	0	0
POMPANO	1	0	0	0
N. LAUDERDALE	3	0	0	0
LAUDERDALE	4	0	0	0
FTL AIRPORT	27	1	0	0
DAVIE	0	0	0	0
PEMBROKE PINES	0	0	0	0
HOLLYWOOD	52	3	0	0
N. MIAMI BEACH	1	0	0	0
NORTH MIAMI	0	0	0	0
MIAMI	1	0	0	0
CUTLER RIDGE	1	0	0	0
EVERGLADES	0	0	0	0
HOMESTEAD	5	0	0	0
FLORIDA CITY	3	0	0	0
TAYLOR	3	0	0	0

Frequency & Severity of Water Restriction Triggers for

'v3.7 - Permitted 1'