

Application of the Lake Okeechobee Regulation Schedule (LORS2008) on 11/05/2018 (ENSO Neutral Condition)

Lake Okeechobee Net Inflow Outlook:

The Lake Okeechobee Net Inflow Outlook has been computed using 4 methods: Croley's method¹, the SFWMD empirical method², a sub-sampling of Neutral years³ and a sub-sampling of warm years of the Atlantic Multi-decadal Oscillation (AMO) in combination with La Nina ENSO years⁴. The results for Croley's method and the SFWMD empirical method are based on the [CPC Outlook](#).

Table of the Lake Okeechobee Net Inflow Outlooks in feet of equivalent depth. All methods are updated on a weekly basis with observed net inflow for the current month.

Season	Croley's Method ^{1*}		SFWMD Empirical Method ²		Sub-sampling of ENSO Years ³		Sub-sampling of AMO Warm + ENSO Years ⁴	
	Value (ft)	Condition	Value (ft)	Condition	Value (ft)	Condition	Value (ft)	Condition
Current (Nov-April)	N/A	N/A	0.52	Dry	1.34	Normal	-0.22	Dry
Multi Seasonal (Nov-Oct)	N/A	N/A	3.11	Wet	3.90	Wet	2.15	Normal

*Croley's Method Not Produced For This Report

See [Seasonal](#) and [Multi-Seasonal](#) tables for the classification of Lake Okeechobee Outlooks.

The recommended methods and values for estimating the Lake Okeechobee Net Inflow Outlook are shaded and should be used in the LORS2008 Release Guidance Flow Charts.

**Sub-sampling is a weighted average of ENSO conditions based on the ENSO forecast used.

[Tributary Hydrologic Conditions Graph:](#)

-**1339 cfs** 14-day running average for Lake Okeechobee Net Inflow through 11/05/2018. According to the classification in [Tributary Hydrologic Conditions](#) table, this condition is Dry.

- **1.78** for Palmer Index on 11/03/2018.

According to the classification in [Tributary Hydrologic Conditions](#) table, this condition is Dry.

The wetter of the two conditions above is **Dry**.

[LORS2008 Classification Tables:](#)

Lake Okeechobee Stage on 11/05/2018

Lake Okeechobee Stage: **13.65 feet**

[USACE Report for Lake Okeechobee](#)

[Lake Okeechobee Stage Hydrograph](#)

Lake Okeechobee Management Zone/Band		Bottom Elevation (feet, NGVD)	Current Lake Stage
High Lake Management Band		17.25	
Operational Band	High sub-band	16.88	
	Intermediate sub-band	16.25	
	Low sub-band	14.50	
Base Flow sub-band		12.85	← 13.65
Beneficial Use sub-band		12.73	
Water Shortage Management Band			

[Part C of LORS2008: Discharge to WCA's](#)

Release Guidance Flow Chart Outcome: No releases to WCA's.

[Part D of LORS2008: Discharge to Tidewater](#)

Release Guidance Flow Chart Outcome: S-79 Up to 450 cfs & S-80 Up to 200 cfs.

[Adaptive Protocol's Release Guidance: Caloosahatchee Estuary](#)

Release Guidance Flow Chart Outcome: No releases.

[Back to Lake Okeechobee Operations Main Page](#)

[Back to U.S. Army Corps of Engineers Homepage](#)

LORS2008 Implementation on 11/5/2018 (ENSO Neutral Condition):

Status for week ending 11/5/2018:

District wide, Raindar rainfall was 0.76 inches for the week. Lake stage on 11/4/2018 was 13.65 ft, down 0.11 ft from last week.

The updated Oct 2018 Mid-Month SFWMM Dynamic Position Analysis [percentile graph](#) for Lake Okeechobee show that the current lake stage is in the Base Flow Operational Sub-Band. The LORS2008 tributary [indices](#) are classified as **Dry**. The PDSI indicates dry condition and the LONIN is dry. The classification is based on the wetter of the two.

Water Supply Risk Evaluation


Area	Indicator	Value	Color Coded Scoring Scheme
LOK	Projected LOK Stage for the next two months	Base Flow Sub Band	M
	Palmer Index for LOK Tributary Conditions	-1.78 (Dry)	M
	CPC Precipitation Outlook	1 month: Above Normal	L
		3 months: Above Normal	L
	LOK Seasonal Net Inflow Outlook	1.34 ft	L
	ENSO La Nina Years	(Normal to Extremely Wet)	
	LOK Multi-Seasonal Net Inflow Outlook	3.90 ft (Wet)	L
	ENSO La Nina Years		
WCAs	WCA 1: Site 1-7, Site 1-8T, & Site 1-9 Average	Line 1- Line 2 (16.43 ft)	M
	WCA 2A: Site 2-17 HW	Above Line 1 (12.99 ft)	L
	WCA-3A: 3 Station Average (Site 63, 64 and 65)	Above Line 1 (9.86 ft)	L
LEC	Service Area 1	Year-Round Irrigation Rule in effect	L
	Service Area 2	Year-Round Irrigation Rule in effect	L
	Service Area 3	Year-Round Irrigation Rule in effect	L

Note: The water supply risk classification based on the Palmer index, as well as the LOK seasonal and multi-seasonal net inflow outlooks use slightly different classification intervals than those used by the 2008-LORS.

[Back to Lake Okeechobee Operations Main Page](#)

[Back to U.S. Army Corps of Engineers LORSS Homepage](#)


Lake Okeechobee SFWMM Oct 2018 Mid-Month Position Analysis

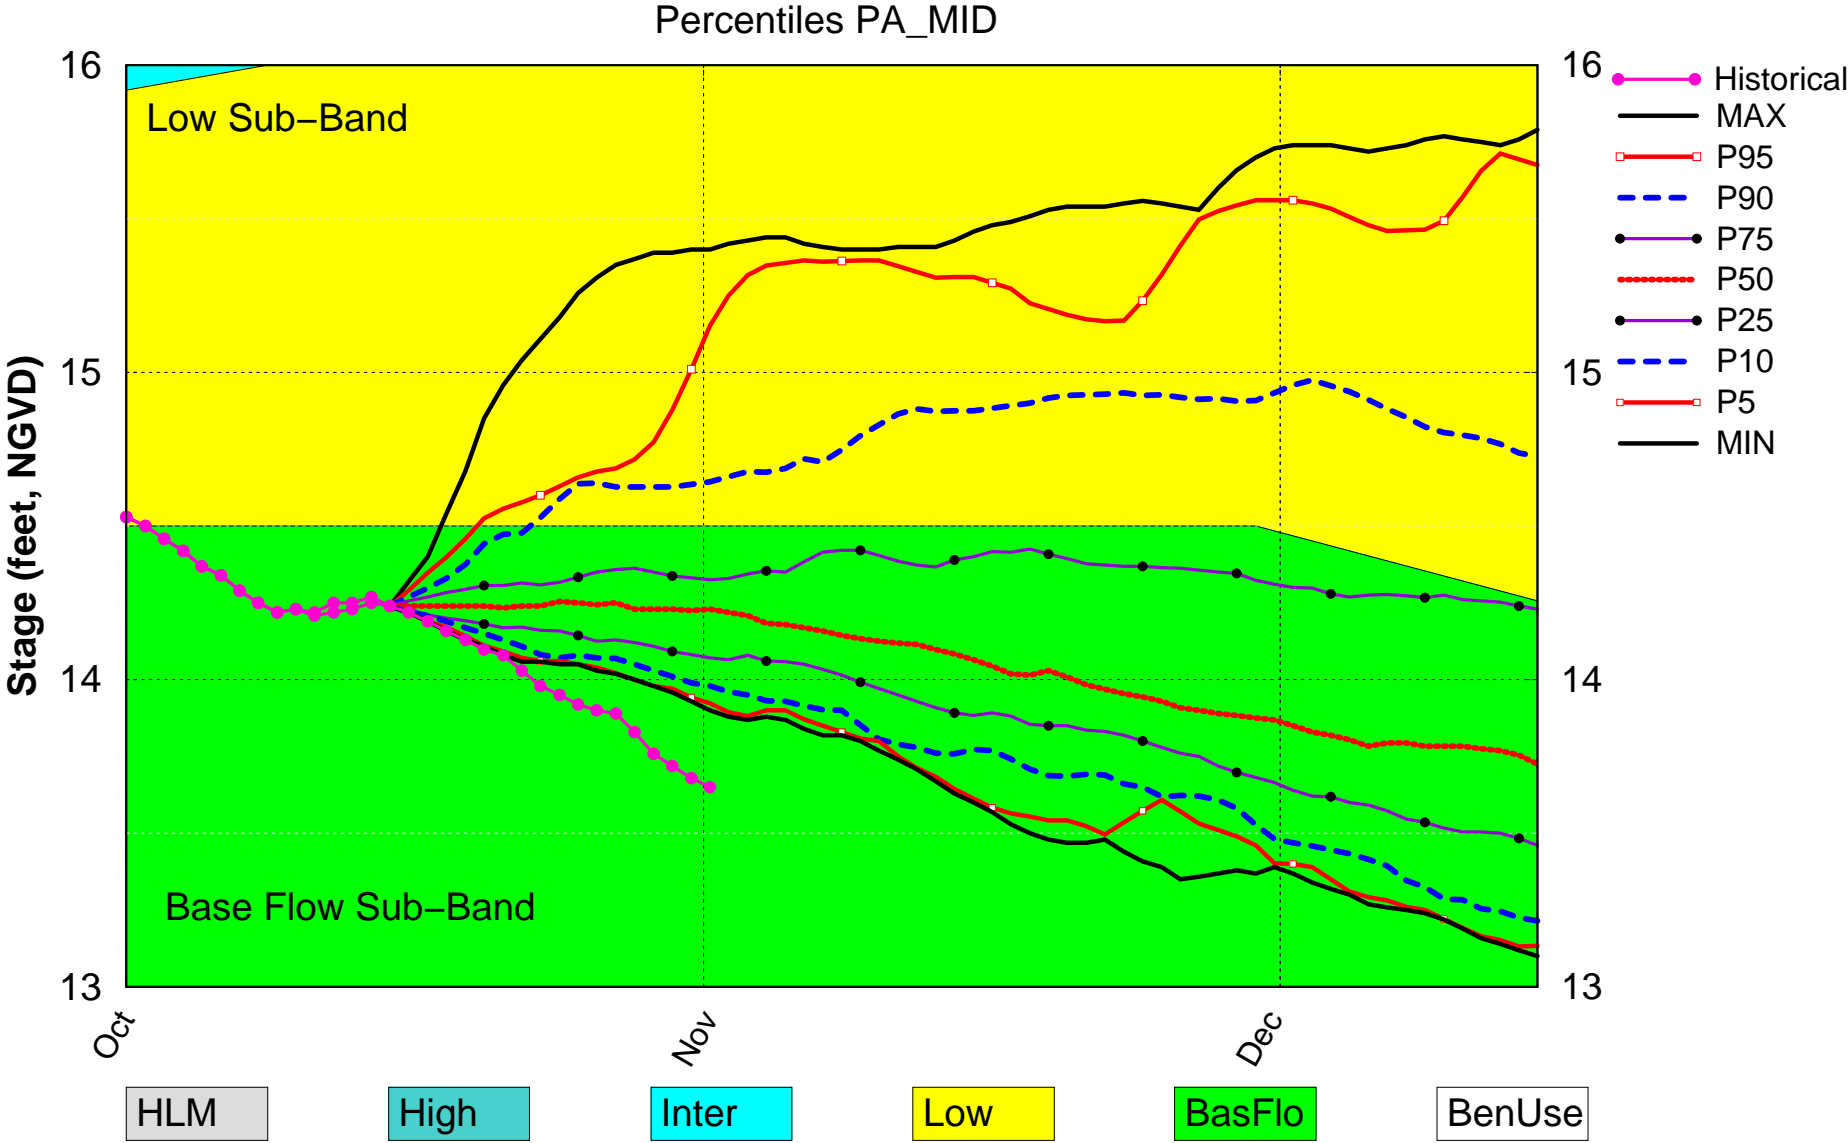


(See assumptions on the Position Analysis Results website)

Tributary Basin Condition Indicators as of November 5 2018

Palmer Index

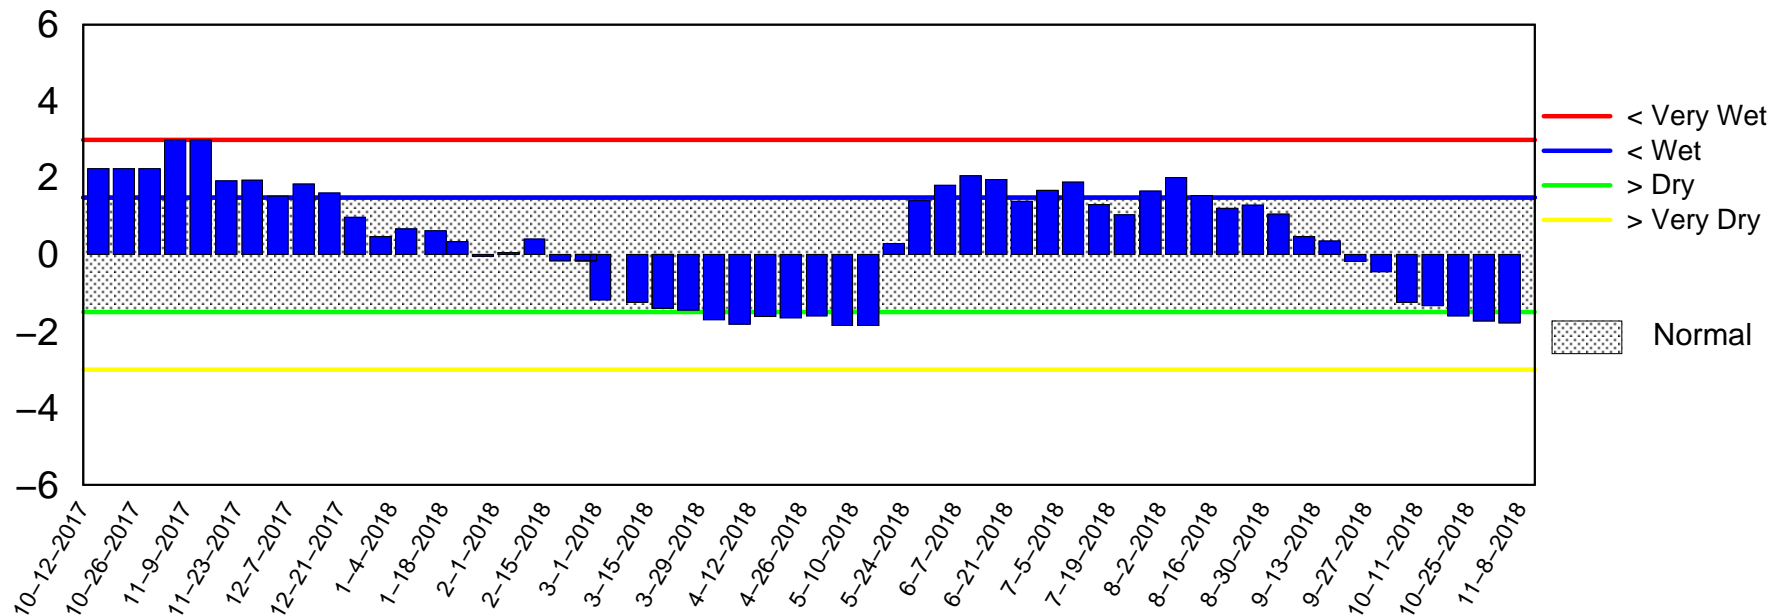

Lake Okeechobee Net Inflow (LONIN) 14-day Running Average

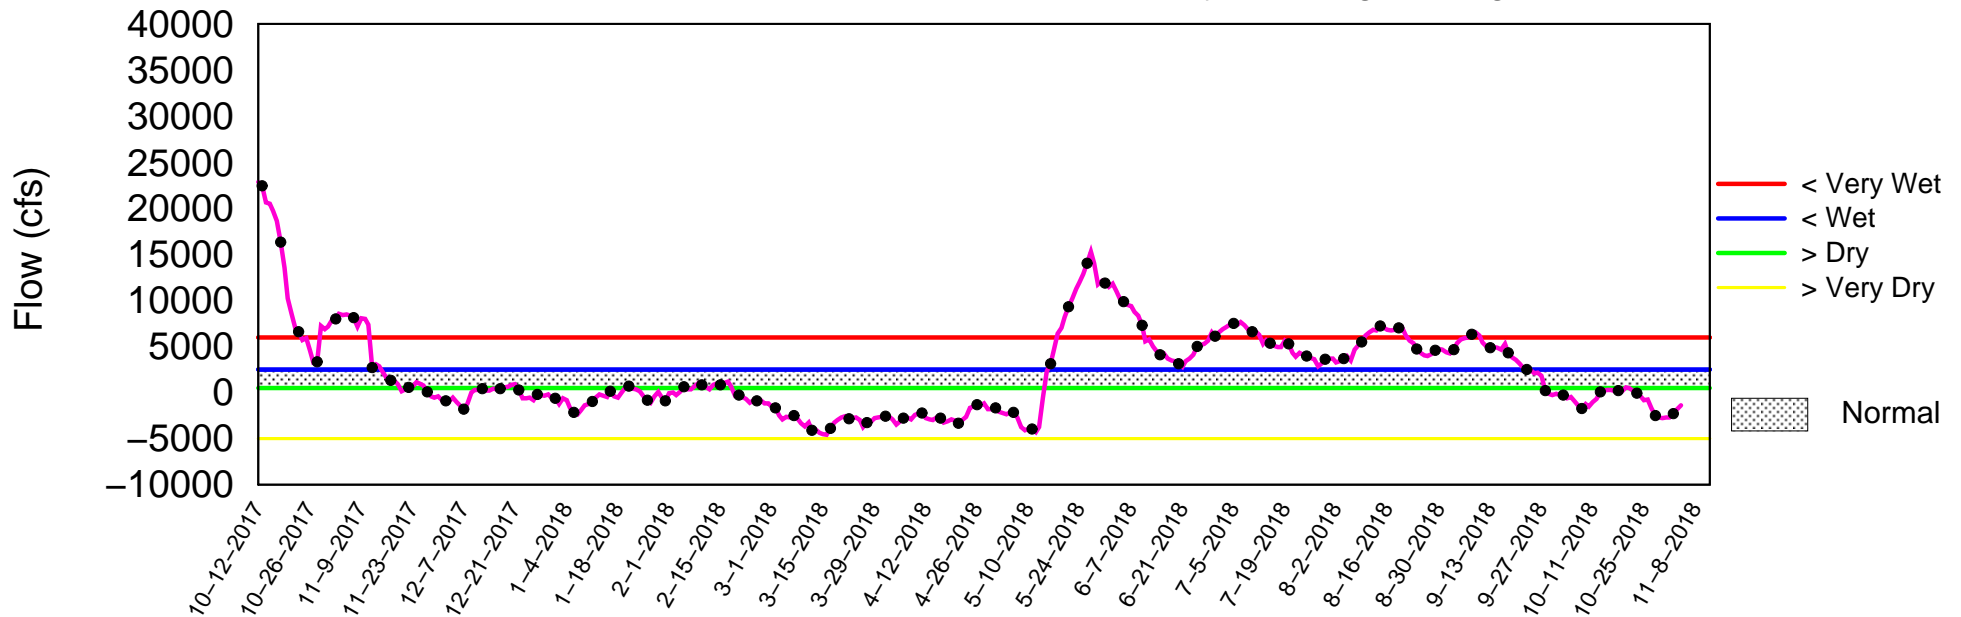

Mon Nov 05 14:51:52 EST 2018

2008 LORS

Part C: Establish Allowable Lake Okeechobee Releases to the Water Conservation Areas


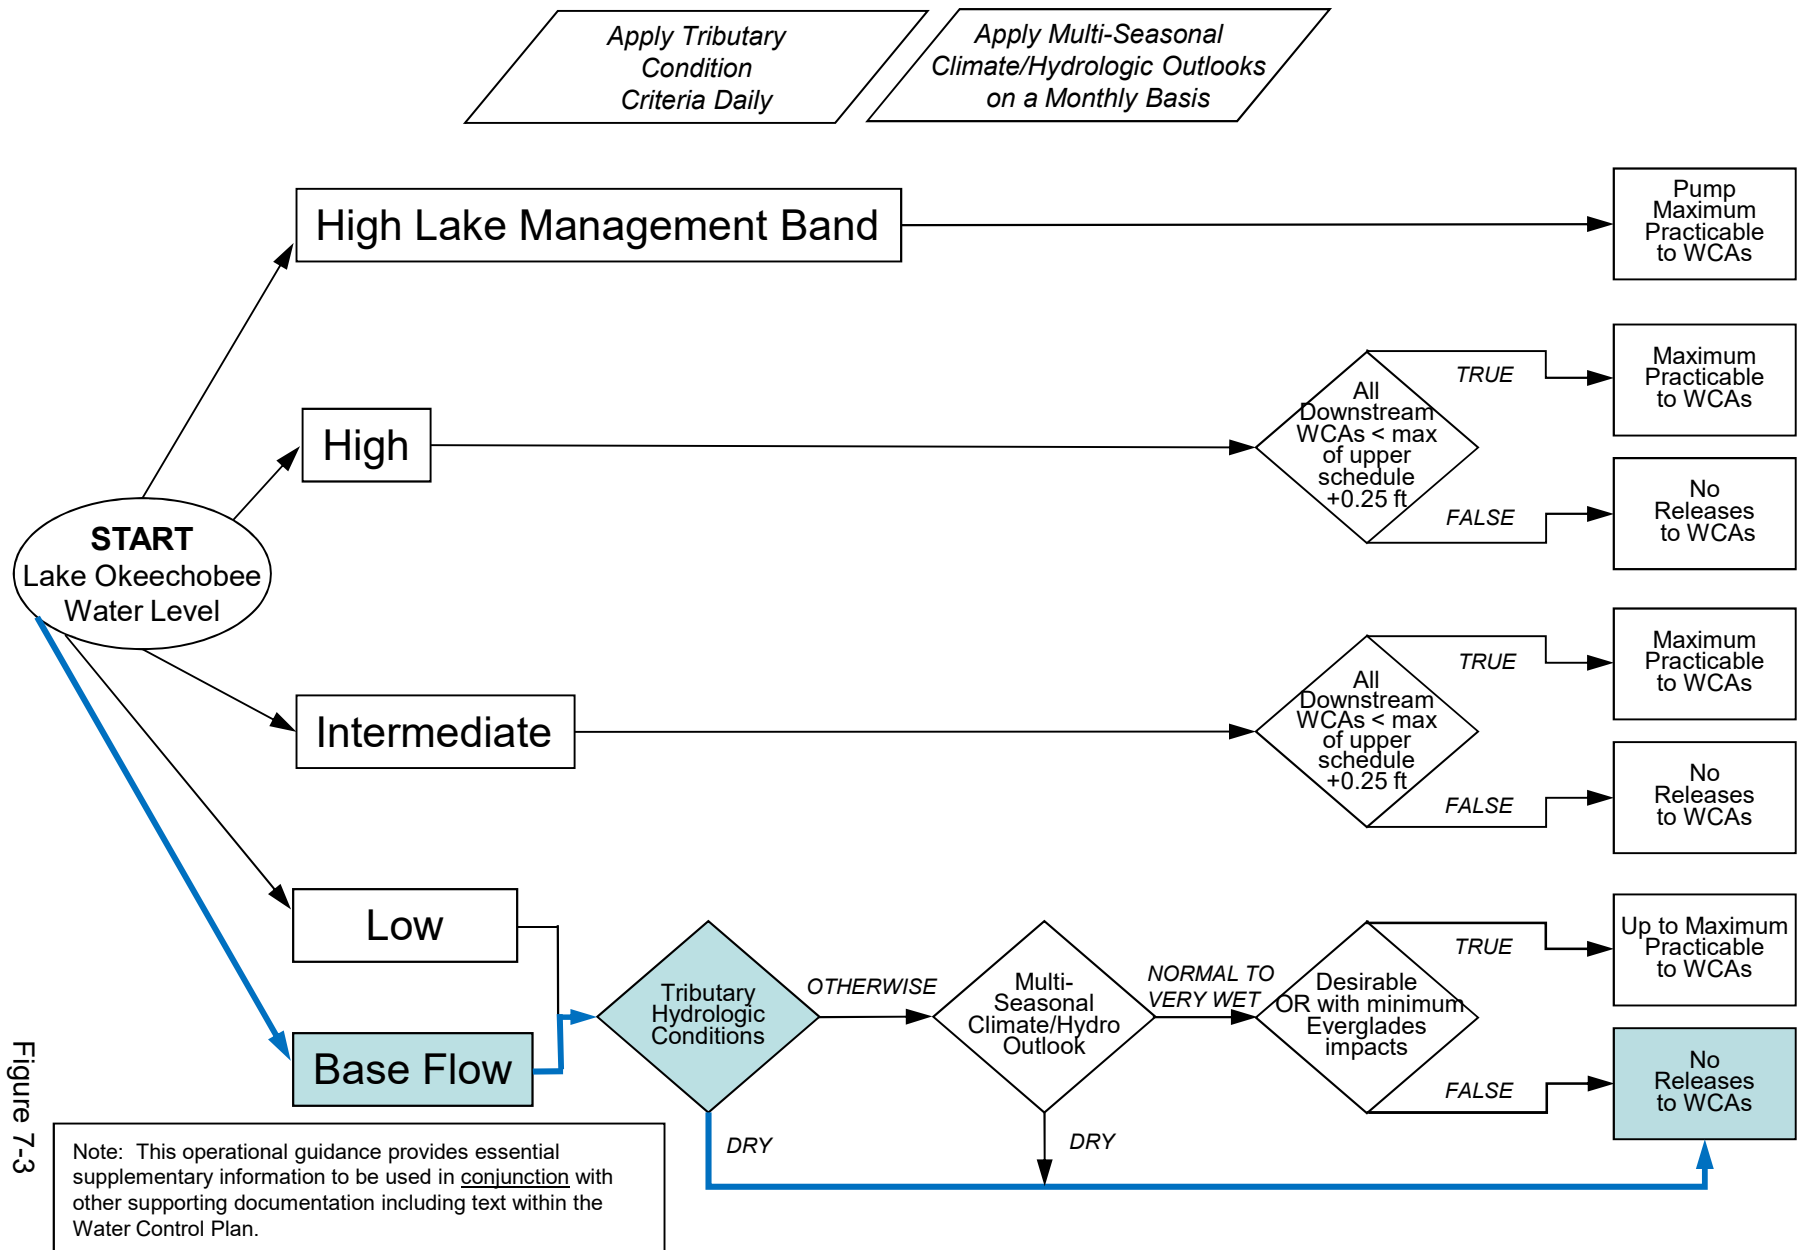


Figure 7-3


Part D: Establish Allowable Lake Okeechobee Releases to Tide (Estuaries)

*When conducting Base Flow releases,
flows can be distributed East and West
up to 650 cfs as needed
to minimize impacts or provide benefits
through S-80 and S-79*

Apply Meteorological Forecasts on a Weekly Basis; apply Seasonal and Multi-Seasonal Climate/Hydrologic Outlooks on a Monthly Basis

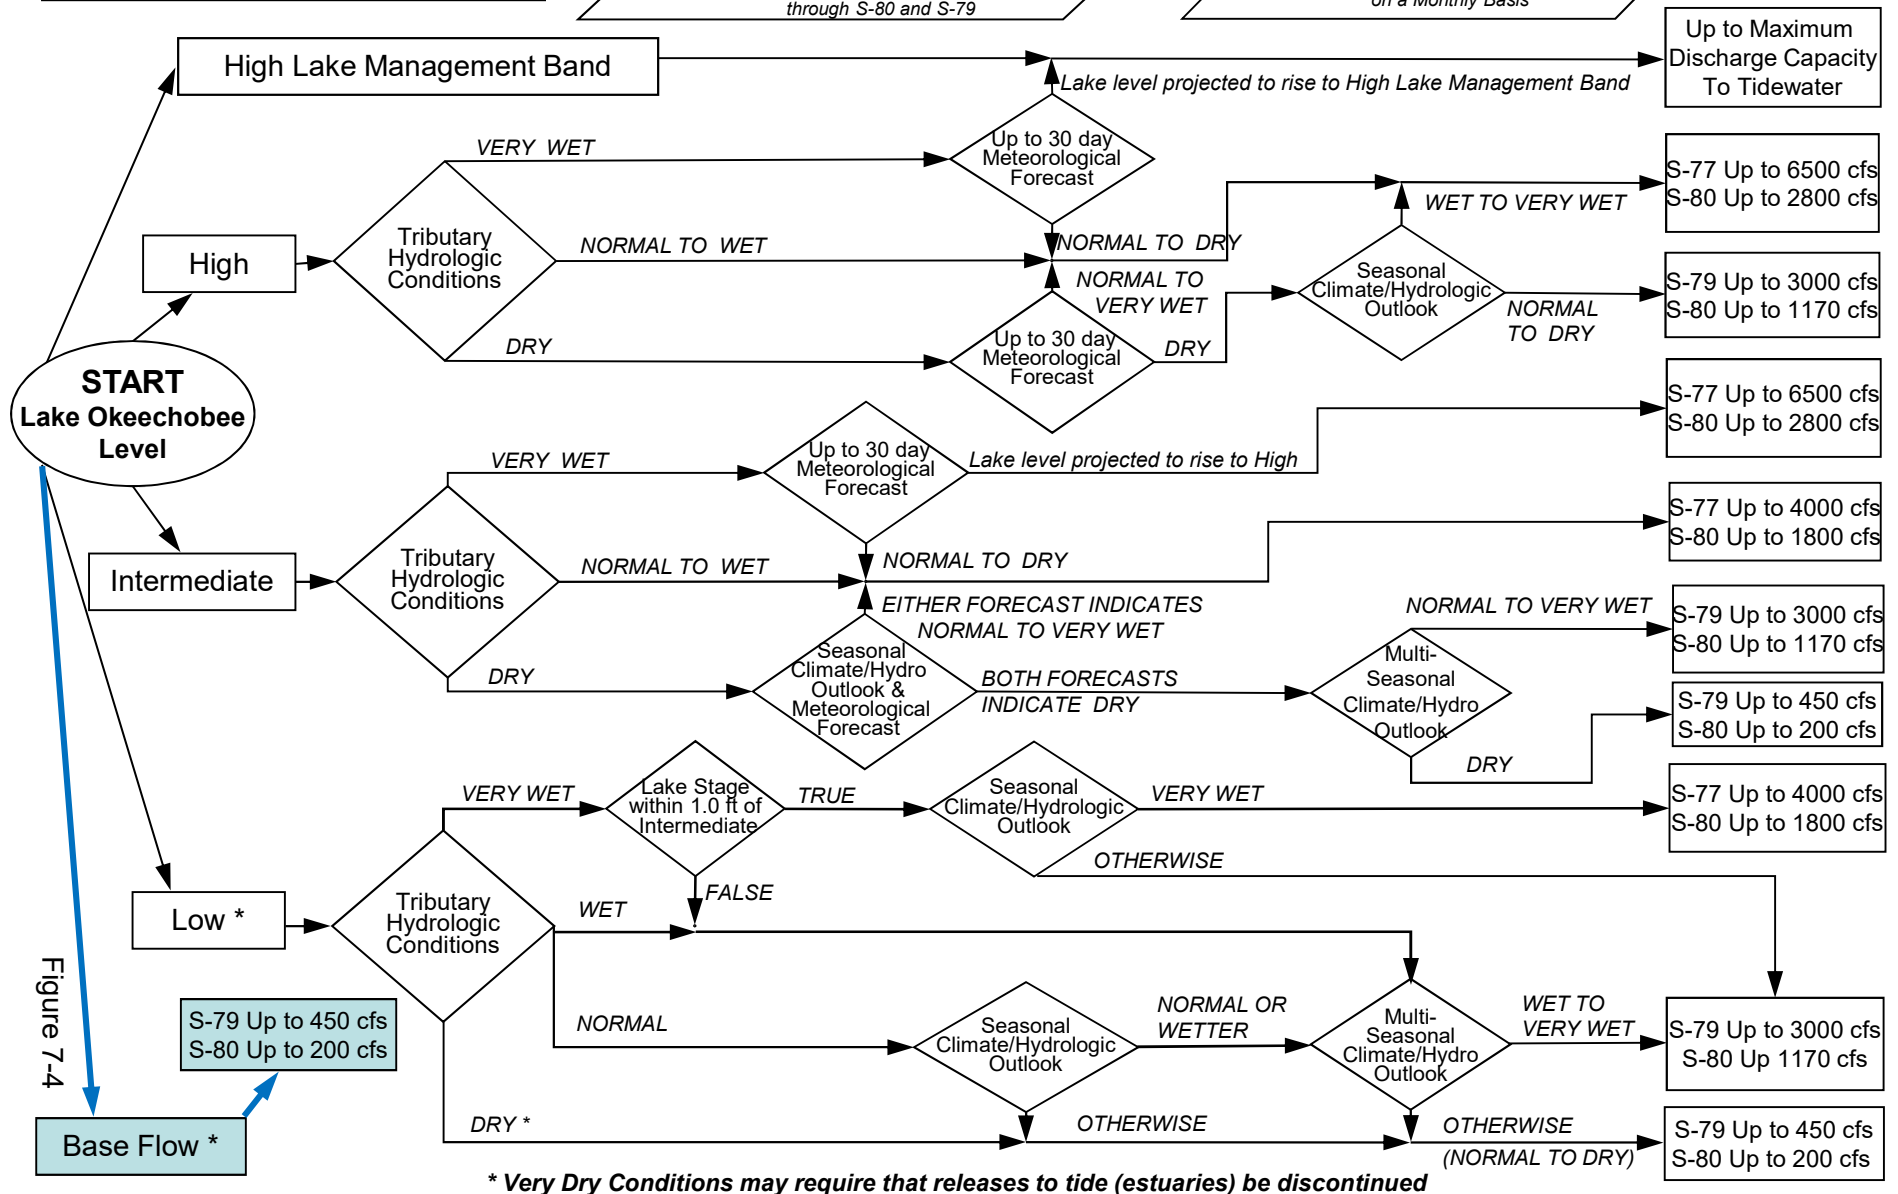

Flowchart to Guide Recommendations for Lake Okeechobee Releases to the Caloosahatchee Estuary for 2008 LORS Baseflow & for Environmental Water Supply (revised 9-Aug-2012)

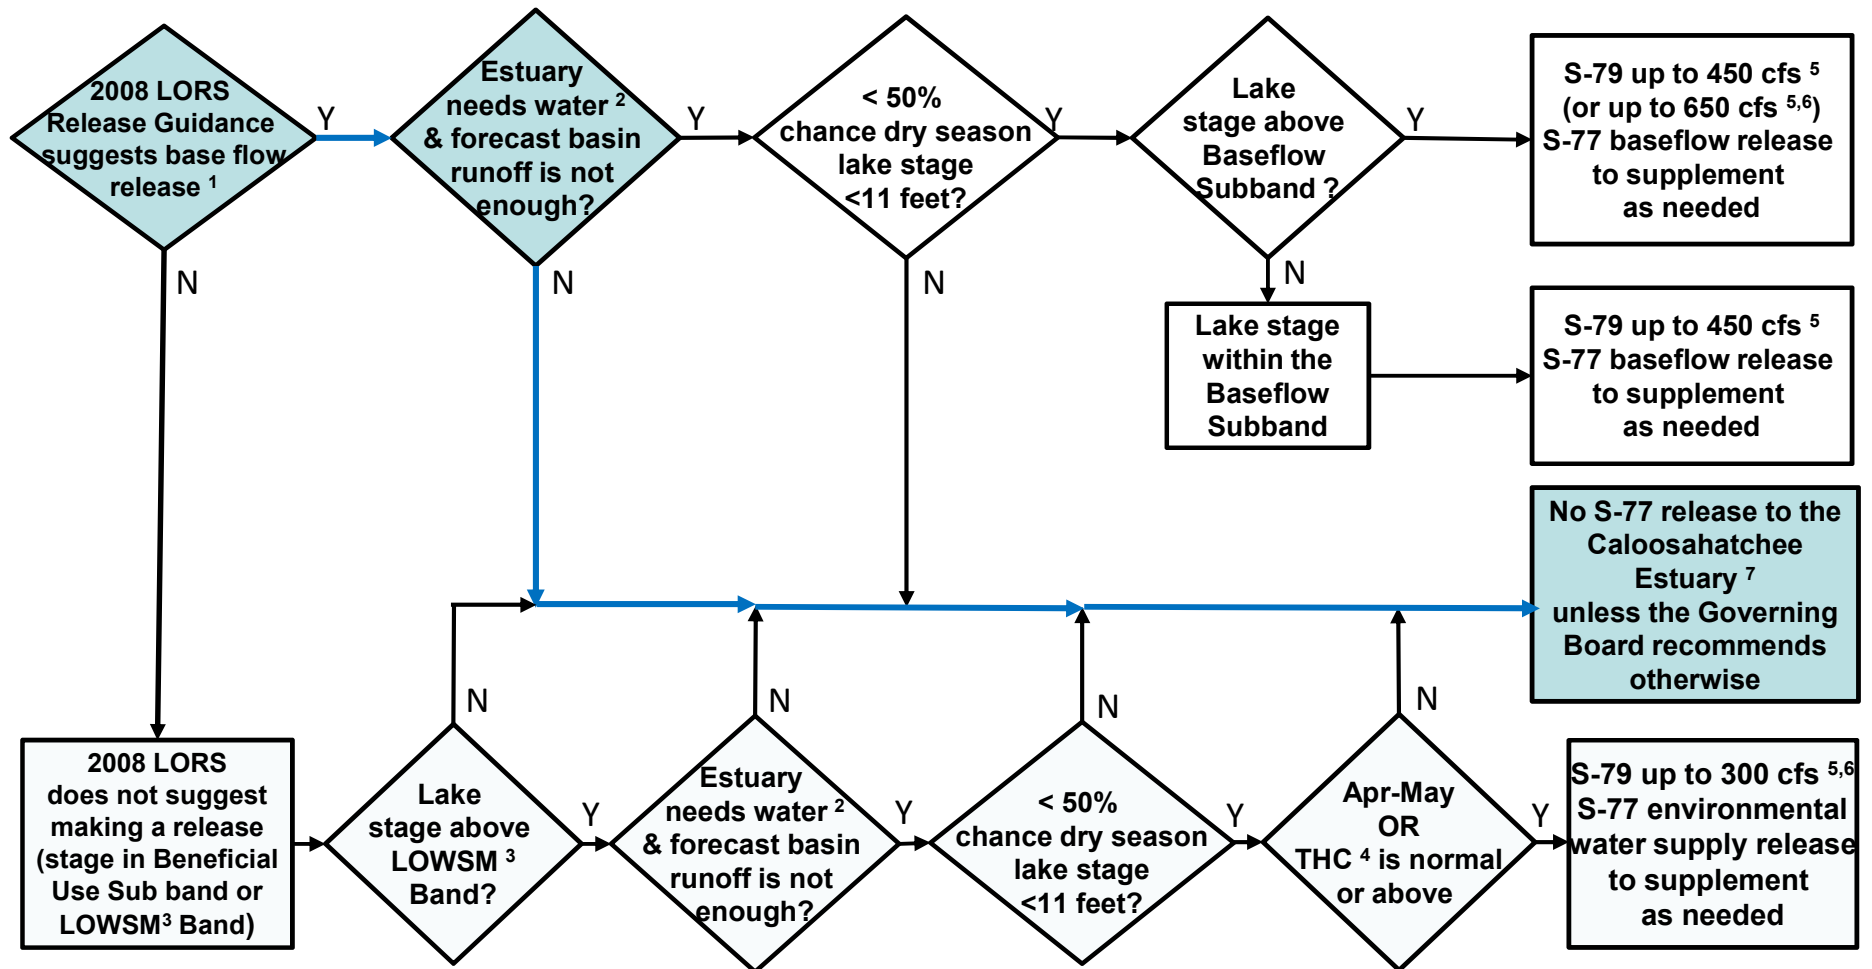

¹The 2008 LORS Release Guidance (Part D) can suggest baseflow releases in the Intermediate, Low, or Baseflow Subbands.

²Estuary "needs" water when the 30-day moving average salinity at I-75 bridge is projected to exceed 5 practical salinity units (psu) within 2 weeks.

³LOWSM = Lake Okeechobee Water Shortage Management.


⁴Tributary Hydrologic Condition (THC) is based on classification of Lake Okeechobee Net Inflow and Palmer Index.

⁵Can release less than the "up to" limit if lower release is sufficient to reach or sustain desired estuary salinity; cfs = cubic feet per second.

⁶After reviewing conditions in Water Conservation Areas (WCAs), Stormwater Treatment Areas (STAs), ENP, St. Lucie Estuary and Lake Okeechobee.

⁷Should this condition be reached, the Governing Board will be briefed at their next regularly scheduled meeting as part of the State of the Water Resources agenda item.

Lake Okeechobee Water Level History and Projected Stages

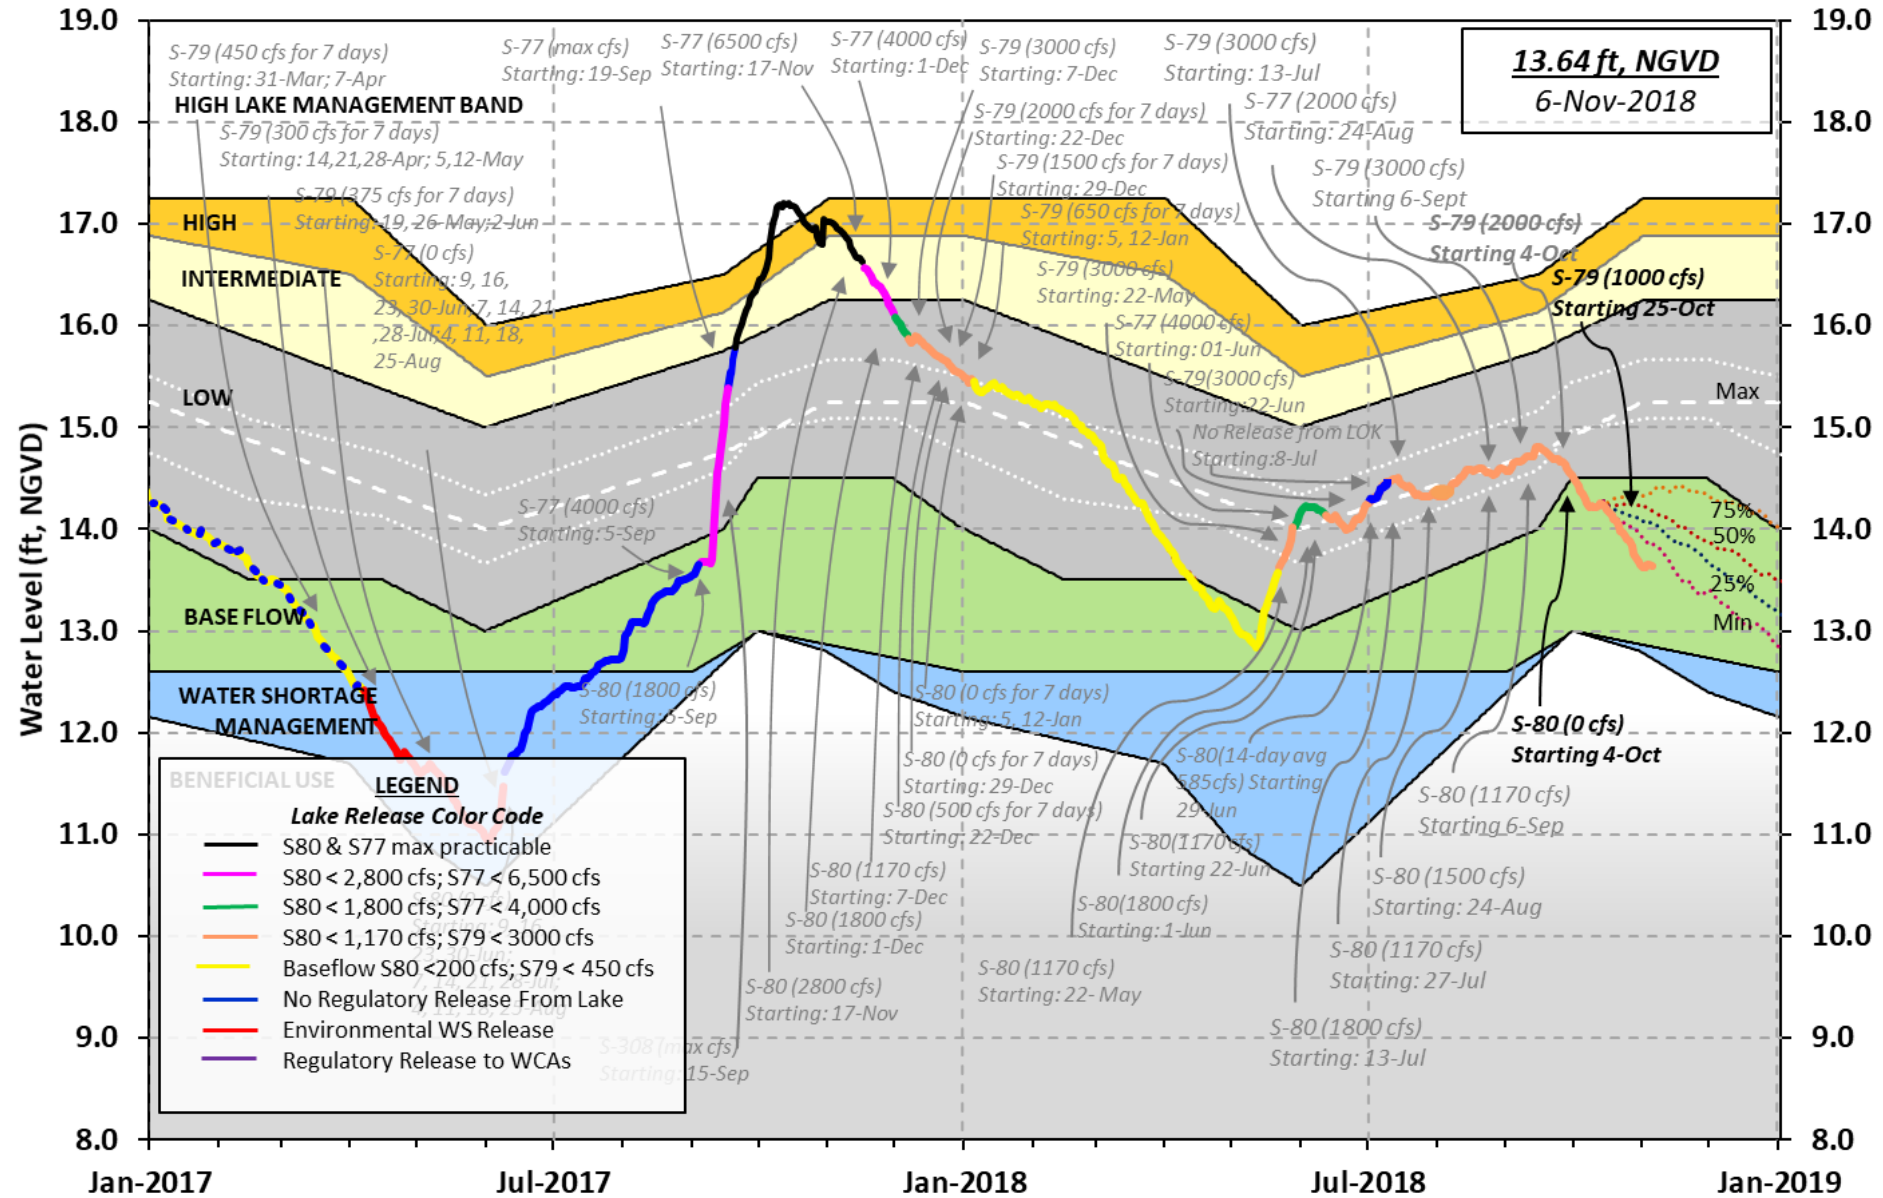

U. S. Army Corps of Engineers, Jacksonville District
Lake Okeechobee and Vicinity Report
** Preliminary Data - Subject to Revision **

Data Ending 2400 hours 04 NOV 2018

Okeechobee Lake Regulation	Elevation (ft-NGVD)	Last Year (ft-NGVD)	2YRS Ago (ft-NGVD)
*Okeechobee Lake Elevation	13.65	16.95	15.36 (Official Elv)
Bottom of High Lake Mngmt=	17.25	Top of Water Short Mngmt=	12.75
Currently in Operational Management Band			

Simulated Average LORS2008 [1965-2000] 13.96
Difference from Average LORS2008 -0.31

04NOV (1965-2007) Period of Record Average 15.03
Difference from POR Average -1.38

Today Lake Okeechobee elevation is determined from the 4 Int & 4 Edge stations

++Navigation Depth (Based on 2007 Channel Condition Survey) Route 1 ÷ 7.59'
++Navigation Depth (Based on 2008 Channel Condition Survey) Route 2 ÷ 5.79'
Bridge Clearance = 49.89'

4 Interior and 4 Edge Okeechobee Lake Average (Avg-Daily values):

L001	L005	L006	LZ40	S4	S352	S308	S133
13.60	13.72	13.65	13.58	13.71	13.77	13.58	13.57

*Combination Okeechobee Avg-Daily Lake Average = 13.65
(*See Note)

Okeechobee Inflows (cfs):

S65E	0	S65EX1	401	Fisheating Cr	7
S154	0	S191	0	S135 Pumps	0
S84	0	S133 Pumps	0	S2 Pumps	0
S84X	0	S127 Pumps	0	S3 Pumps	0
S71	0	S129 Pumps	0	S4 Pumps	0
S72	0	S131 Pumps	0	C5	0
Total Inflows:	408				

Okeechobee Outflows (cfs):

S135 Culverts	0	S354	508	S77	1166
S127 Culverts	-5	S351	0	S308	-137
S129 Culverts	0	S352	0		
S131 Culverts	0	L8 Canal Pt	50		
Total Outflows:	1583				

****S77 structure flow is being used to compute Total Outflow.
****S308 structure flow is being used to compute Total Outflow.

Okeechobee Pan Evaporation (inches):

S77 0.18 S308 0.18
Average Pan Evap x 0.75 Pan Coefficient = 0.14" = 0.01'

Lake Average Precipitation using NEXRAD: = 0.02" = 0.00'

Evaporation - Precipitation: = 0.12" = 0.01'
 Evaporation - Precipitation using Lake Area of 730 square miles
 is equal to 2257 cfs out of the lake.
 Lake Okeechobee (Change in Storage) Flow is 0 cfs or 0 AC-FT

	Headwater Elevation (ft-msl)	Tailwater Elevation (ft-msl)	Disch (cfs)	----- Gate Positions -----							
				#1 (ft)	#2 (ft)	#3 (ft)	#4 (ft)	#5 (ft)	#6 (ft)	#7 (ft)	#8 (ft)
			(I) see note at bottom								
North East Shore											
S133 Pumps:	13.32	13.61	0	0	0	0	0	0	(cfs)		
S193:											
S191:	17.33	13.56	0	0.0	0.0	0.0					
S135 Pumps:	13.43	13.55	0	0	0	0	0		(cfs)		
S135 Culverts:			0	0.0	0.0						
North West Shore											
S65E:	21.02	13.49	0	0.0	0.0	0.0	0.0	0.0	0.0		
S65EX1:	21.02	13.49	401								
S127 Pumps:	13.47	13.55	0	0	0	0	0	0	(cfs)		
S127 Culvert:			-5	1.0							
S129 Pumps:	12.87	13.65	0	0	0	0			(cfs)		
S129 Culvert:			0	0.0							
S131 Pumps:	12.95	13.72	0	0	0				(cfs)		
S131 Culvert:			0								
Fisheating Creek											
nr Palmdale		28.41	7								
nr Lakeport											
C5:		-NR-	0	-NR-	-NR-	-NR-					
South Shore											
S4 Pumps:	13.34	13.75	0	0	0	0			(cfs)		
S169:	13.68	13.33	0	0.0	0.0	0.0					
S310:	13.71		2								
S3 Pumps:	11.68	13.67	0	0	0	0			(cfs)		
S354:	13.67	11.68	508	0.7	0.9						
S2 Pumps:	11.01	-NR-	0	0	0	0	0		(cfs)		
S351:	-NR-	11.01	0	0.0	0.0	0.0					
S352:	13.75	11.10	0	0.0	0.0						
C10A:	-NR-	13.69		8.0	8.0	8.0	0.0	0.0			
L8 Canal PT		13.51	50								

S351 and S352 Temporary Pumps/S354 Spillway

S351:	11.01	-NR-	0	-NR-	-NR-	-NR-	-NR-	-NR-		
S352:	11.10	13.75	0	-NR-	-NR-	-NR-	-NR-			
S354:	11.68	13.67	508	-NR-	-NR-	-NR-	-NR-			

Caloosahatchee River (S77, S78, S79)

S47B:	13.78	11.14		0.0	0.0					
S47D:	11.14	11.13	-11	6.5						

S77:

Spillway and Sector Preferred Flow:

13.68 11.04 1163 0.0 2.5 2.5 0.0

Flow Due to Lockages+: 3

S78:

Spillway and Sector Flow:

10.96 2.83 1364 2.0 2.5 0.0 0.0

Flow Due to Lockages+: 11

S79:

Spillway and Sector Flow:

3.01 1.48 1526 0.0 1.0 1.0 1.0 1.0 1.0 0.0 0.0

Flow Due to Lockages+: 9

Percent of flow from S77 76%

Chloride (ppm) 51

St. Lucie Canal (S308, S80)

S308:

Spillway and Sector Preferred Flow:

13.53 13.61 -137 0.0 0.0 0.0 0.0

Flow Due to Lockages+: 0

S153: 18.85 13.41 0 0.0 0.0

S80:

Spillway and Sector Flow:

13.67 0.80 0 0.0 0.0 0.0 0.0 0.0 0.0 0.0

Flow Due to Lockages+: 13

Percent of flow from S308 NA %

Steele Point Top Salinity (mg/ml) ****

Steele Point Bottom Salinity (mg/ml) ****

Speedy Point Top Salinity (mg/ml) ****

Speedy Point Bottom Salinity (mg/ml) ****

+ Flow Due to lockages is computed utilizing average daily headwater and tailwater along with total number of lockages for the day to calculate a volume which is then converted to an average discharge in cfs.

++ Preferred flow is determined from either the spillway discharge or the below flow meter daily

Daily Precipitation Totals	1-Day (inches)	3-Day (inches)	7-Day (inches)	----- Wind -----	
				Direction (DegØ)	Speed (mph)
S133 Pump Station:	-NR-	0.00	0.00		
S193:	-NR-	0.00	0.00	-NR-	-NR-
Okeechobee Field Station:	-NR-	0.00	0.00		
S135 Pump Station:	-NR-	0.00	0.00		
S127 Pump Station:	-NR-	0.00	0.00		
S129 Pump Station:	-NR-	0.00	0.00		
S131 Pump Station:	-NR-	0.00	0.00		
S77:	0.01	0.02	0.03	3	1
S78:	0.01	0.11	0.11	21	1
S79:	0.22	0.37	0.37	270	0
S4 Pump Station:	-NR-	0.00	0.00		
Clewiston Field Station:	-NR-	0.00	0.00		
S3 Pump Station:	-NR-	0.00	0.00		
S2 Pump Station:	-NR-	0.00	0.00		
S308:	0.00	0.57	0.57	113	5
S80:	0.01	0.89	0.89	184	1
Okeechobee Average	0.00	0.05	0.05		

(Sites S78, S79 and S80 not included)

Oke Nexrad Basin Avg 0.02 0.71 0.85

Okeechobee Lake Elevations	04 NOV 2018	13.65	Difference from 04NOV18
04NOV18 -1 Day =	03 NOV 2018	13.65	0.00
04NOV18 -2 Days =	02 NOV 2018	13.62	-0.03
04NOV18 -3 Days =	01 NOV 2018	13.62	-0.03
04NOV18 -4 Days =	31 OCT 2018	13.65	0.00
04NOV18 -5 Days =	30 OCT 2018	13.68	0.03
04NOV18 -6 Days =	29 OCT 2018	13.72	0.07
04NOV18 -7 Days =	28 OCT 2018	13.76	0.11
04NOV18 -30 Days =	05 OCT 2018	14.34	0.69
04NOV18 -1 Year =	04 NOV 2017	16.95	3.30
04NOV18 -2 Year =	04 NOV 2016	15.36	1.71

Long Term Mean 30day Avearge ET for Lake Alfred (Inches) = 3.12

Lake Okeechobee Net Inflow (LONIN)					
Average Flow over the previous 14 days					Avg-Daily Flow
04NOV18 Today =	04 NOV 2018	-1302	MON		1721
04NOV18 -1 Day =	03 NOV 2018	-1739	SUN		8548
04NOV18 -2 Days =	02 NOV 2018	-2249	SAT		3939
04NOV18 -3 Days =	01 NOV 2018	-2679	FRI		-2598
04NOV18 -4 Days =	31 OCT 2018	-2642	THU		-2212
04NOV18 -5 Days =	30 OCT 2018	-2700	WED		-3213
04NOV18 -6 Days =	29 OCT 2018	-2636	TUE		-2929
04NOV18 -7 Days =	28 OCT 2018	-2448	MON		-9729
04NOV18 -8 Days =	27 OCT 2018	-1999	SUN		-6913
04NOV18 -9 Days =	26 OCT 2018	-1011	SAT		3918
04NOV18 -10 Days =	25 OCT 2018	-1091	FRI		-174
04NOV18 -11 Days =	24 OCT 2018	-412	THU		-1921
04NOV18 -12 Days =	23 OCT 2018	-214	WED		-1104
04NOV18 -13 Days =	22 OCT 2018	273	TUE		-5555

S65E					
Average Flow over previous 14 days					Avg-Daily Flow
04NOV18 Today=	04 NOV 2018	132	MON		0
04NOV18 -1 Day =	03 NOV 2018	132	SUN		0
04NOV18 -2 Days =	02 NOV 2018	132	SAT		0
04NOV18 -3 Days =	01 NOV 2018	132	FRI		0
04NOV18 -4 Days =	31 OCT 2018	132	THU		0
04NOV18 -5 Days =	30 OCT 2018	132	WED		0
04NOV18 -6 Days =	29 OCT 2018	132	TUE		0
04NOV18 -7 Days =	28 OCT 2018	132	MON		0
04NOV18 -8 Days =	27 OCT 2018	132	SUN		0
04NOV18 -9 Days =	26 OCT 2018	132	SAT		0
04NOV18 -10 Days =	25 OCT 2018	132	FRI		0
04NOV18 -11 Days =	24 OCT 2018	132	THU		0
04NOV18 -12 Days =	23 OCT 2018	132	WED		934
04NOV18 -13 Days =	22 OCT 2018	65	TUE		908

S65EX1					
Average Flow over previous 14 days					Avg-Daily Flow
04NOV18 Today=	04 NOV 2018	610	MON		401
04NOV18 -1 Day =	03 NOV 2018	691	SUN		404
04NOV18 -2 Days =	02 NOV 2018	770	SAT		399

04NOV18	-3 Days =	01 NOV 2018	846	FRI		500
04NOV18	-4 Days =	31 OCT 2018	920	THU		427
04NOV18	-5 Days =	30 OCT 2018	1001	WED		400
04NOV18	-6 Days =	29 OCT 2018	1085	TUE		292
04NOV18	-7 Days =	28 OCT 2018	1176	MON		554
04NOV18	-8 Days =	27 OCT 2018	1249	SUN		448
04NOV18	-9 Days =	26 OCT 2018	1338	SAT		799
04NOV18	-10 Days =	25 OCT 2018	1391	FRI		1036
04NOV18	-11 Days =	24 OCT 2018	1441	THU		1541
04NOV18	-12 Days =	23 OCT 2018	1433	WED		662
04NOV18	-13 Days =	22 OCT 2018	1498	TUE		680

Lake Okeechobee Outlets Last 14 Days

	S-77	Below S-77	S-78	S-79	
	Discharge	Discharge	Discharge	Discharge	
	(ALL DAY)	(ALL-DAY)	(ALL DAY)	(ALL DAY)	
DATE	(AC-FT)	(AC-FT)	(AC-FT)	(AC-FT)	
04 NOV 2018	2299	2302	2725	3013	
03 NOV 2018	2697	2535	2189	3740	
02 NOV 2018	2098	1918	1340	2286	
01 NOV 2018	1012	931	419	100	
31 OCT 2018	1548	1302	485	717	
30 OCT 2018	3072	2541	1177	1836	
29 OCT 2018	3090	2623	1785	2778	
28 OCT 2018	2759	1933	1826	3386	
27 OCT 2018	3281	3073	1939	3210	
26 OCT 2018	2999	2557	1490	1846	
25 OCT 2018	633	557	191	227	
24 OCT 2018	2191	1697	795	960	
23 OCT 2018	2165	1715	1301	1676	
22 OCT 2018	2464	2255	1536	2482	

	S-310	S-351	S-352	S-354	L8 Canal Pt
	Discharge	Discharge	Discharge	Discharge	Discharge
	(ALL DAY)	(ALL DAY)	(ALL DAY)	(ALL DAY)	(ALL DAY)
DATE	(AC-FT)	(AC-FT)	(AC-FT)	(AC-FT)	(AC-FT)
04 NOV 2018	4	0	0	855	99
03 NOV 2018	37	576	204	765	-237
02 NOV 2018	108	2575	1027	1281	195
01 NOV 2018	179	2871	1194	1489	213
31 OCT 2018	205	3166	1202	1414	301
30 OCT 2018	265	3430	1291	1535	359
29 OCT 2018	69	3856	1467	1652	396
28 OCT 2018	45	3960	1586	1755	404
27 OCT 2018	233	3877	1493	1515	464
26 OCT 2018	186	4010	1051	1432	532
25 OCT 2018	-NR-	3217	904	1477	532
24 OCT 2018	-NR-	2783	1001	2019	475
23 OCT 2018	-NR-	3584	1035	2546	350
22 OCT 2018	-NR-	3213	825	2421	306

	S-308	Below S-308	S-80
	Discharge	Discharge	Discharge
	(ALL DAY)	(ALL-DAY)	(ALL-DAY)
DATE	(AC-FT)	(AC-FT)	(AC-FT)
04 NOV 2018	-305	-199	25
03 NOV 2018	-333	-522	30
02 NOV 2018	403	140	37
01 NOV 2018	293	355	43
31 OCT 2018	77	483	28
30 OCT 2018	363	356	43

29 OCT 2018	14	199	40
28 OCT 2018	-194	146	36
27 OCT 2018	34	10	58
26 OCT 2018	324	22	50
25 OCT 2018	191	232	35
24 OCT 2018	-67	165	32
23 OCT 2018	403	442	33
22 OCT 2018	0	118	32

*** NOTE: Discharge (ALL DAY) is computed using Spillway, Sector Gate and Lockages Discharges from 0015 hrs to 2400 hrs.


(I) - Flows preceded by "I" signify an instantaneous flow computed from the single value reported for the day

* On 11 May 1999, Lake Okeechobee Elevation was switched from Instantaneous 2400 value to an average-daily lake average.
 On 14 Mar 2001, due to the isolation of various gages within the standard 10 stations, the average of the interior 4 station gages was used as the Lake Okeechobee Elevation.
 On 05 November 2010, Lake Okeechobee Elevation was switched to a 9 gage mix of interior and edge gages to obtain a more reliable representation of the lake level.
 On 09 May 2011, Lake Okeechobee Elevation was switched to a 8 gage mix of interior and edge gages to obtain a more reliable representation of the lake level due to isolation of S135 from low lake levels.
 Today Lake Okechobee elevation is determined from the 4 Int & 4 Edge stations
 ++ For more information see the Jacksonville District Navigation website at <http://www.saj.usace.army.mil/>
 \$ For information regarding Lake Okeechobee Service Area water restrictions please refer to www.sfwmd.gov

Report Generated 05NOV2018 @ 13:39 ** Preliminary Data - Subject to Revision **

Lake Okeechobee

05NOV18 14:30:20

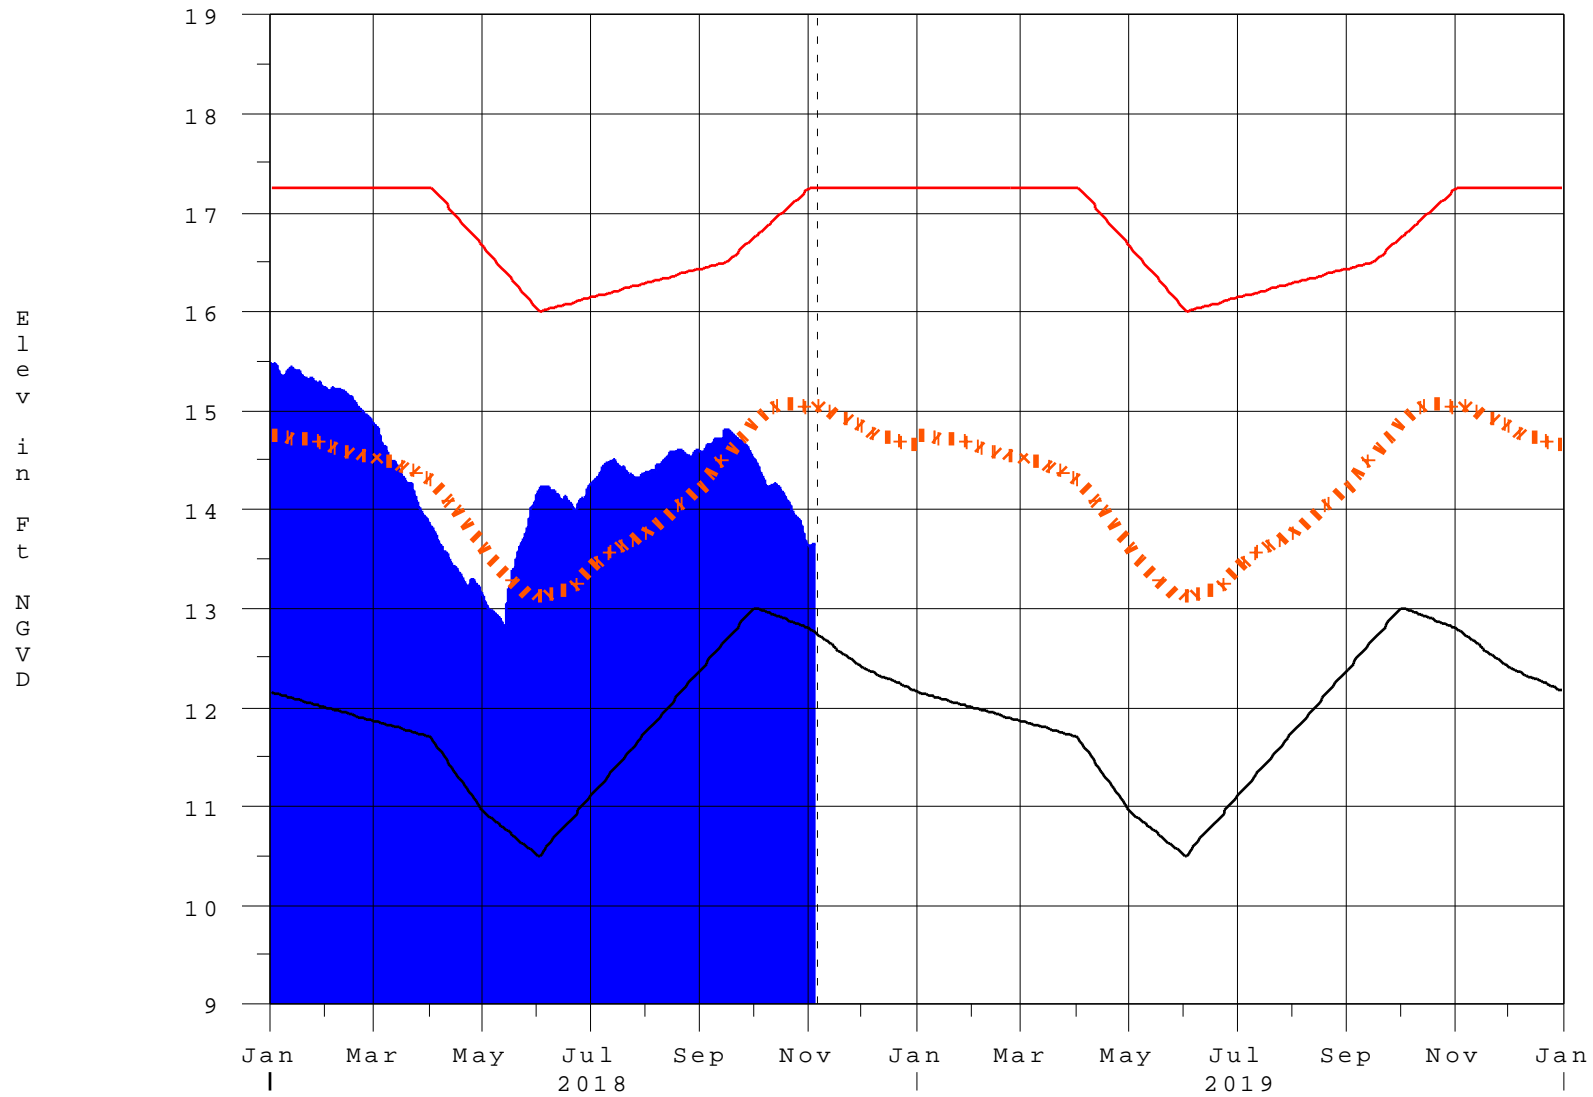

- High Lake Management
- Okeechobee Avg Elev
- Average Elev [1965-2007]
- Water Shortage Management

Classification Tables

Supplemental Tables used in conjunction with the LORS2008 Release

Guidance Flow Charts

- [Class Limits for Tributary Hydrologic Conditions](#)

Table K-2 in the Lake Okeechobee Water Control Plan

- [6-15 Day Precipitation Outlook Categories](#)

Table ?? in the Lake Okeechobee Water Control Plan

- [Classification of Lake Okeechobee Net Inflow for Seasonal Outlook](#)

Table K-3 in the Lake Okeechobee Water Control Plan

- [Classification of Lake Okeechobee Net Inflow for Multi-Seasonal Outlook](#)

Table K-4 in the Lake Okeechobee Water Control Plan

[Back to Lake Okeechobee Operations Main Page](#)

[Back to U.S. Army Corps of Engineers Lake Okeechobee Operations Homepage](#)

Tributary Hydrologic Classification*	Palmer Index Class Limits	2-wk Mean L.O. Net Inflow Class Limits
Very Wet	3.0 or greater	Greater \geq 6000 cfs
Wet	1.5 to 2.99	2500 - 5999 cfs
Near Normal	-1.49 to 1.49	500 - 2499 cfs
Dry	-2.99 to -1.5	-5000 – 500 cfs
Very Dry	-3.0 or less	Less than -5000 cfs

* use the wettest of the two indicators

Classification of Lake Okeechobee Net Inflow Seasonal Outlook*

Lake Net Inflow Prediction [million acre-feet]	Equivalent Depth** [feet]	Lake Okeechobee Net Inflow Seasonal Outlook
> 0.93	> 2.0	Very Wet
0.71 to 0.93	1.51 to 2.0	Wet
0.35 to 0.70	0.75 to 1.5	Normal
< 0.35	< 0.75	Dry

****Volume-depth conversion based on average lake surface area of 467,000 acres**

Classification of Lake Okeechobee Net Inflow Multi-Seasonal Outlook*

Lake Net Inflow Prediction [million acre-feet]	Equivalent Depth** [feet]	Lake Okeechobee Net Inflow Multi-Seasonal Outlook
> 2.0	> 4.3	Very Wet
1.18 to 2.0	2.51 to 4.3	Wet
0.5 to 1.17	1.1 to 2.5	Normal
< 0.5	< 1.1	Dry

****Volume-depth conversion based on average lake surface area of 467,000 acres**

6-15 Day Precipitation Outlook Categories*

6-15 Day Precipitation Outlook Categories	WSE Decision Tree Categories
Above Normal	Wet to Very Wet
Normal	Normal
Below Normal	Dry

*** Corresponds to Table 7-6 in the Lake Okeechobee Water Control Plan**

Under Construction