

Application of the Lake Okeechobee Regulation Schedule (LORS2008) on 12/23/2019 (ENSO Neutral Condition)

Lake Okeechobee Net Inflow Outlook:

The Lake Okeechobee Net Inflow Outlook has been computed using 4 methods: Croley's method¹, the SFWMD empirical method², a sub-sampling of Neutral years³ and a sub-sampling of warm years of the Atlantic Multi-decadal Oscillation (AMO) in combination with La Nina ENSO years⁴. The results for Croley's method and the SFWMD empirical method are based on the [CPC Outlook](#).

Table of the Lake Okeechobee Net Inflow Outlooks in feet of equivalent depth. All methods are updated on a weekly basis with observed net inflow for the current month.

Season	Croley's Method ^{1*}		SFWMD Empirical Method ²		Sub-sampling of Neutral ENSO Years ³		Sub-sampling of AMO Warm + Neutral ENSO Years ⁴	
	Value (ft)	Condition	Value (ft)	Condition	Value (ft)	Condition	Value (ft)	Condition
Current (Nov-Apr)	N/A	N/A	0.17	Dry	0.46	Normal	1.48	Normal
Multi Seasonal (Nov-Oct)	N/A	N/A	3.07	Wet	3.20	Wet	5.33	Very Wet

***Croley's Method Not Produced for This Report**

See [Seasonal](#) and [Multi-Seasonal](#) tables for the classification of Lake Okeechobee Outlooks.

The recommended methods and values for estimating the Lake Okeechobee Net Inflow Outlook are shaded and should be used in the LORS2008 Release Guidance Flow Charts.

**Sub-sampling is a weighted average of ENSO conditions based on the ENSO forecast used.

[Tributary Hydrologic Conditions Graph:](#)

1753 cfs 14-day running average for Lake Okeechobee Net Inflow through 12/23/2019. According to the classification in [Tributary Hydrologic Conditions](#) table, this condition is Normal.

-1.31 for Palmer Index on 12/21/2019.

According to the classification in [Tributary Hydrologic Conditions](#) table, this condition is Normal.

The wetter of the two conditions above is **Normal**.

[LORS2008 Classification Tables:](#)

Lake Okeechobee Stage on 12/23/2019

Lake Okeechobee Stage: **13.00 feet**

[USACE Report for Lake Okeechobee](#)

[Lake Okeechobee Stage Hydrograph](#)

Lake Okeechobee Management Zone/Band		Bottom Elevation (feet, NGVD)	Current Lake Stage
High Lake Management Band		17.25	
Operational Band	High sub-band	16.88	
	Intermediate sub-band	16.25	
	Low sub-band	14.15	
Base Flow sub-band		12.64	← 13.00
Beneficial Use sub-band		12.23	
Water Shortage Management Band			

[Part C of LORS2008: Discharge to WCA's](#)

Up to Maximum Practicable to the WCAs if desirable or with minimum Everglades impact; otherwise no releases to WCAs.

[Part D of LORS2008: Discharge to Tidewater](#)

Release Guidance Flow Chart Outcome: S-79 Up to 450 cfs & S-80 Up to 200 cfs.

[Adaptive Protocol's Release Guidance: Caloosahatchee Estuary](#)

Release Guidance Flow Chart Outcome: S-79 Up to 450 cfs & S-77 baseflow release to supplement as needed.

[Back to Lake Okeechobee Operations Main Page](#)

[Back to U.S. Army Corps of Engineers LORSS Homepage](#)

LORS2008 Implementation on 12/23/2019 (ENSO Neutral Condition):


Status for week ending 12/23/2019:

Water Supply Risk Evaluation

Area	Indicator	Value	Color Coded Scoring Scheme
LOK	Projected LOK Stage for the next two months	Base-Flow Sub-Band	M
	Palmer Index for LOK Tributary Conditions	-1.31 (Dry)	M
	CPC Precipitation Outlook	1 month: Normal	L
		3 months: Below Normal	M
	LOK Seasonal Net Inflow Outlook	0.46 ft (Dry)	M
	ENSO Forecast (positive)		
	LOK Multi-Seasonal Net Inflow Outlook	3.20 ft (Normal)	M
ENSO Forecast (positive)			
WCAs	WCA 1: 3 Station Average (Site 1-7, Site 1-8T & Site 1-9)	Above Line 1 (16.57 ft)	L
	WCA 2A: Site 2-17 HW	Above Line 1 (12.25 ft)	L
	WCA-3A: 3 Station Average (Site 63, 64, and 65)	Above Line 1 (9.59 ft)	L
LEC	Service Area 1	Year-Round Irrigation Rule in effect	L
	Service Area 2	Year-Round Irrigation Rule in effect	L
	Service Area 3	Year-Round Irrigation Rule in effect	L

Note: The water supply risk classification based on the Palmer index, as well as the LOK seasonal and multi-seasonal net inflow outlooks use slightly different classification intervals than those used by the 2008-LORS.


Lake Okeechobee SFWMM Dec 2019 Position Analysis

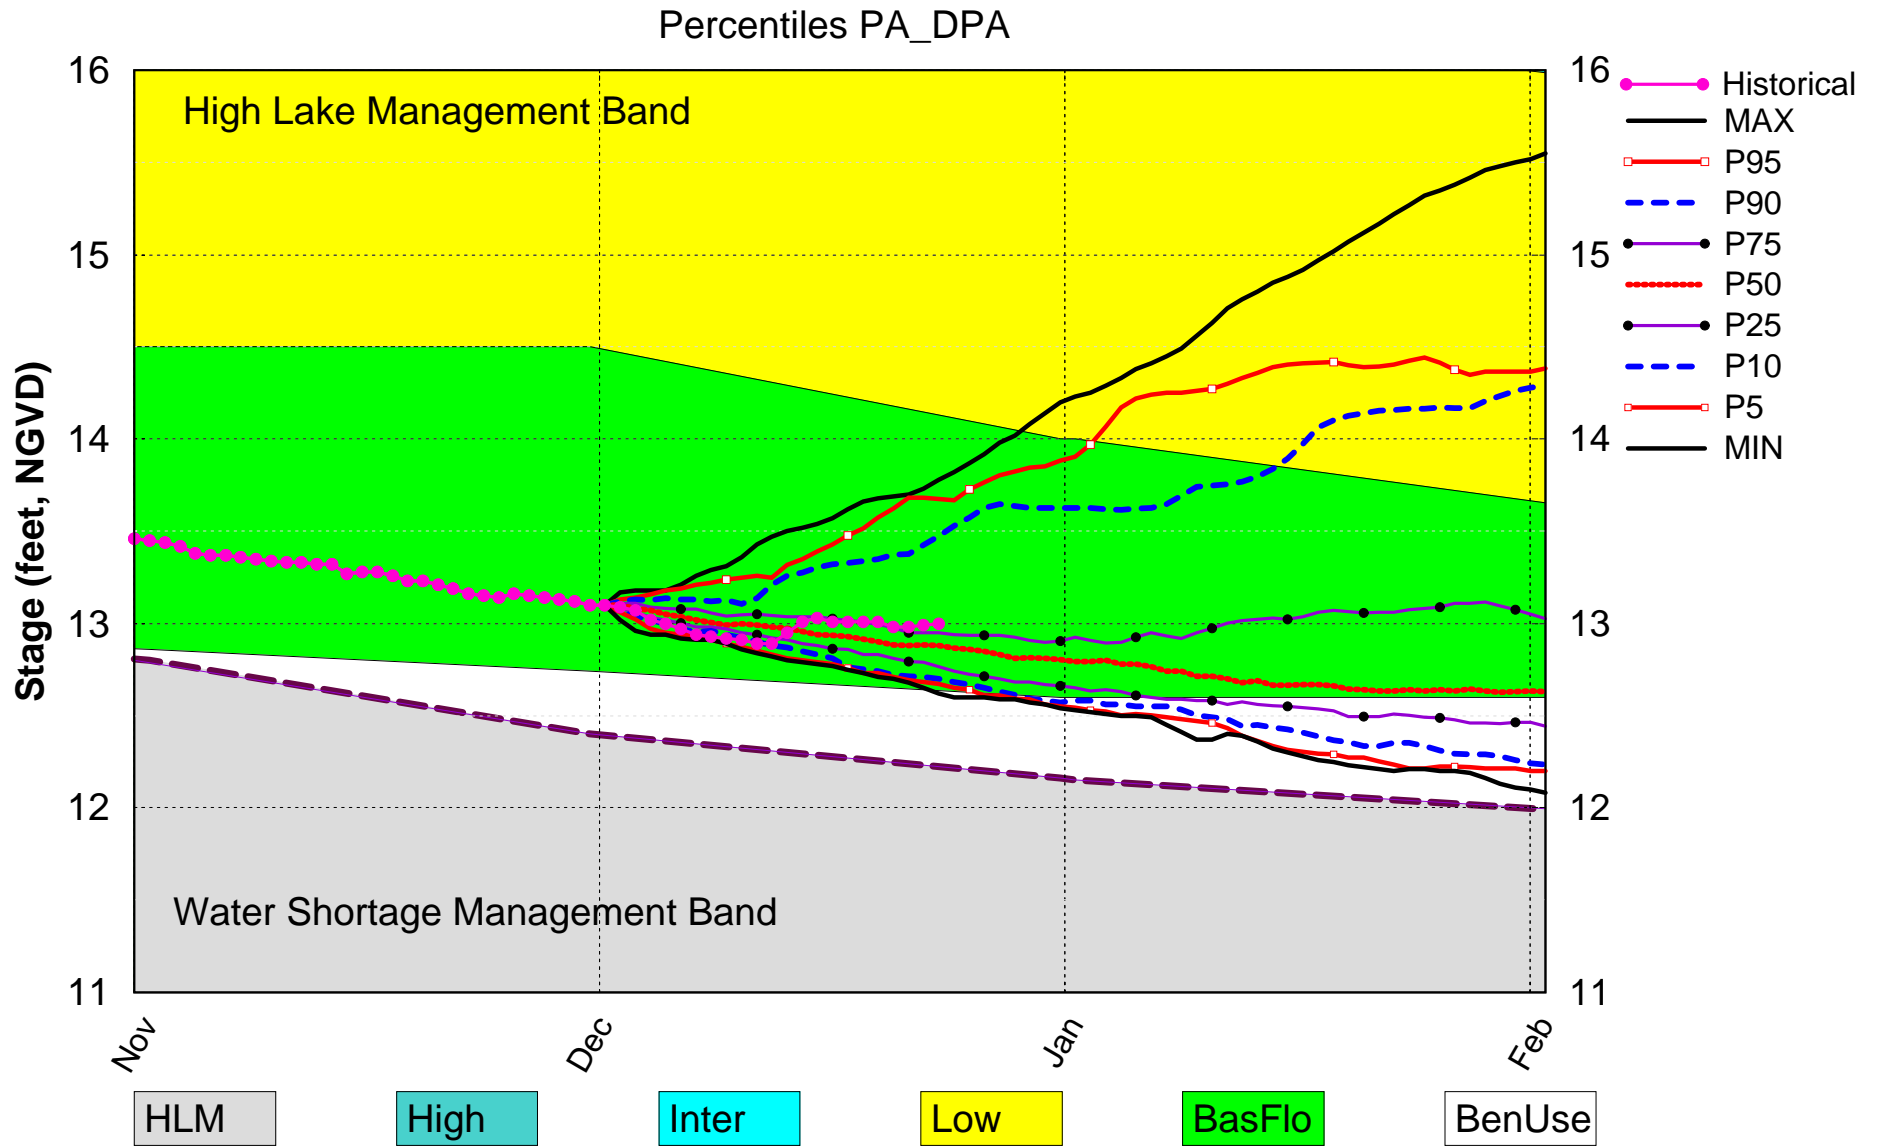


(See assumptions on the Position Analysis Results website)

Tributary Basin Condition Indicators as of December 23 2019

Palmer Index

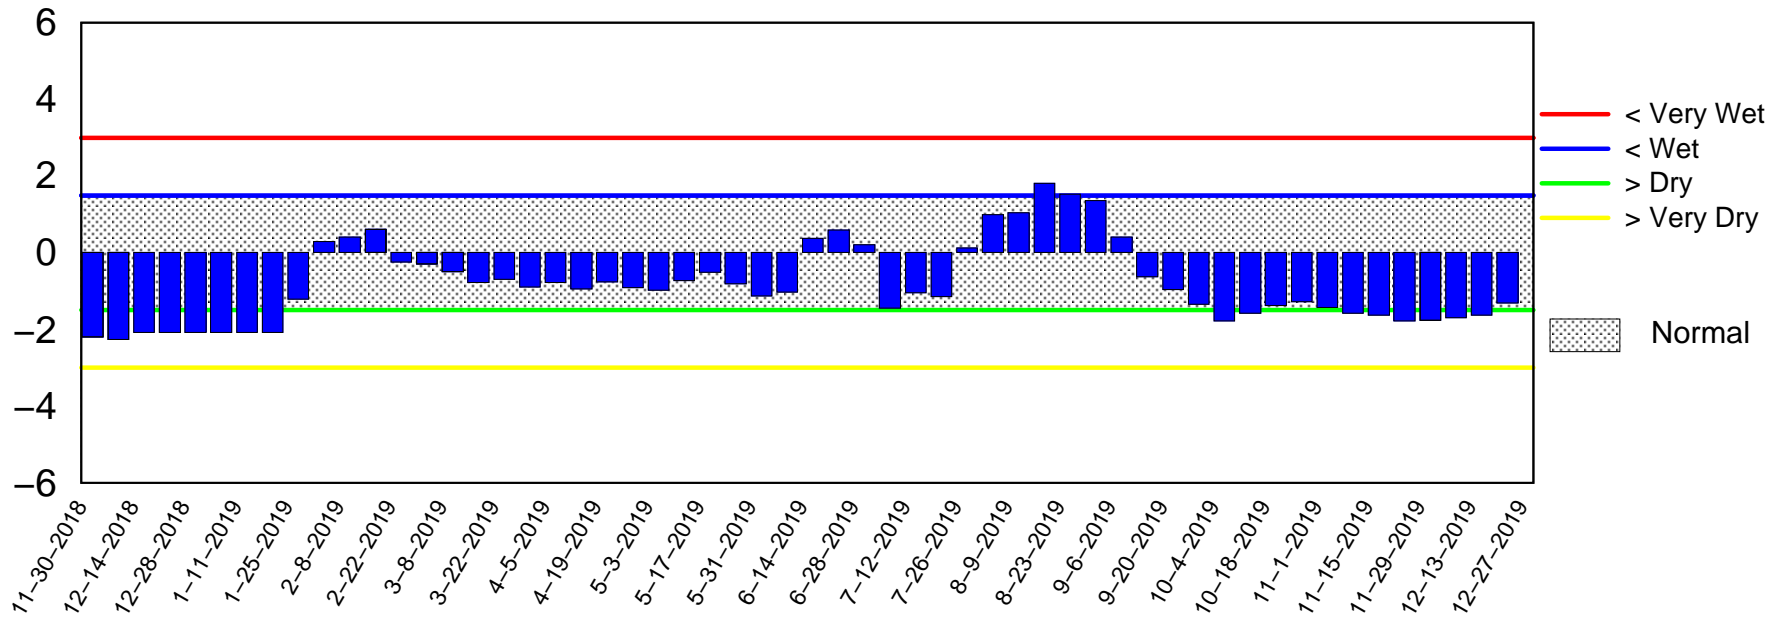

Lake Okeechobee Net Inflow (LONIN) 14-day Running Average

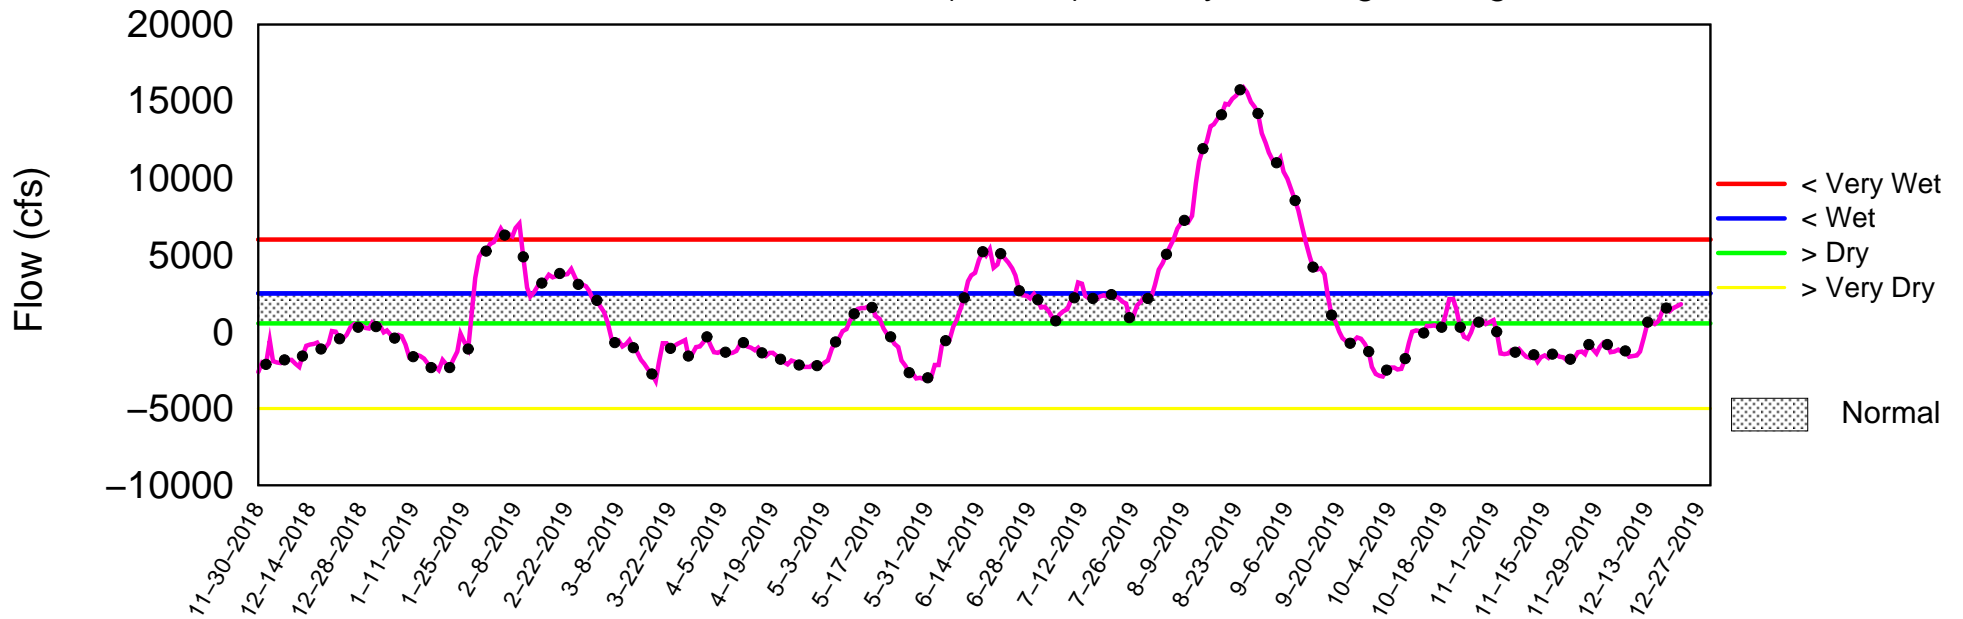

Mon Dec 23 11:56:14 EST 2019

2008 LORS

Part C: Establish Allowable Lake Okeechobee Releases to the Water Conservation Areas

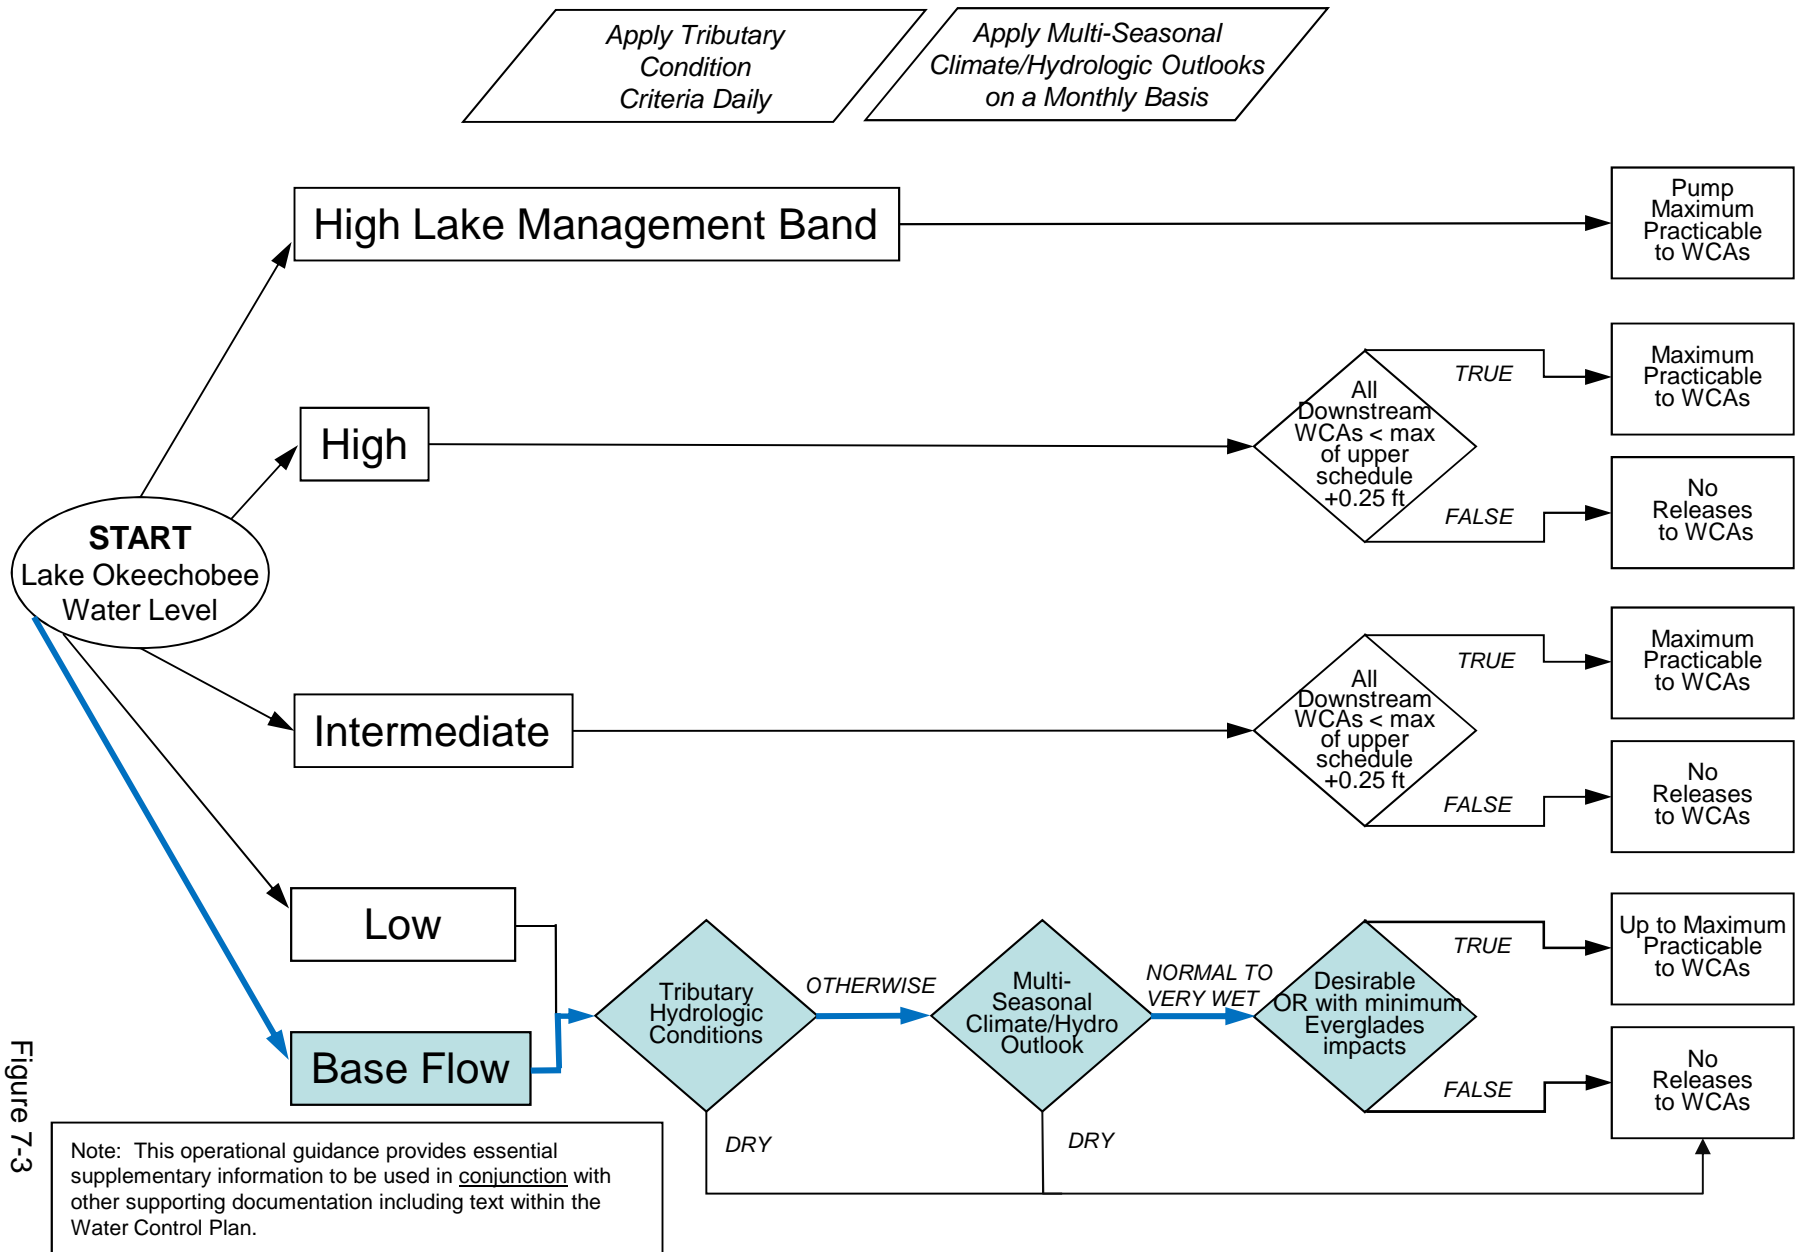


Figure 7-3

2008 LORS

Part D: Establish Allowable Lake Okeechobee Releases to Tide (Estuaries)

Note: This operational guidance provides essential supplementary information to be used in conjunction with other supporting documentation including text within the Water Control Plan.

When conducting Base Flow releases, flows can be distributed East and West up to 650 cfs as needed to minimize impacts or provide benefits through S-80 and S-79

Apply Meteorological Forecasts on a Weekly Basis; apply Seasonal and Multi-Seasonal Climate/Hydrologic Outlooks on a Monthly Basis


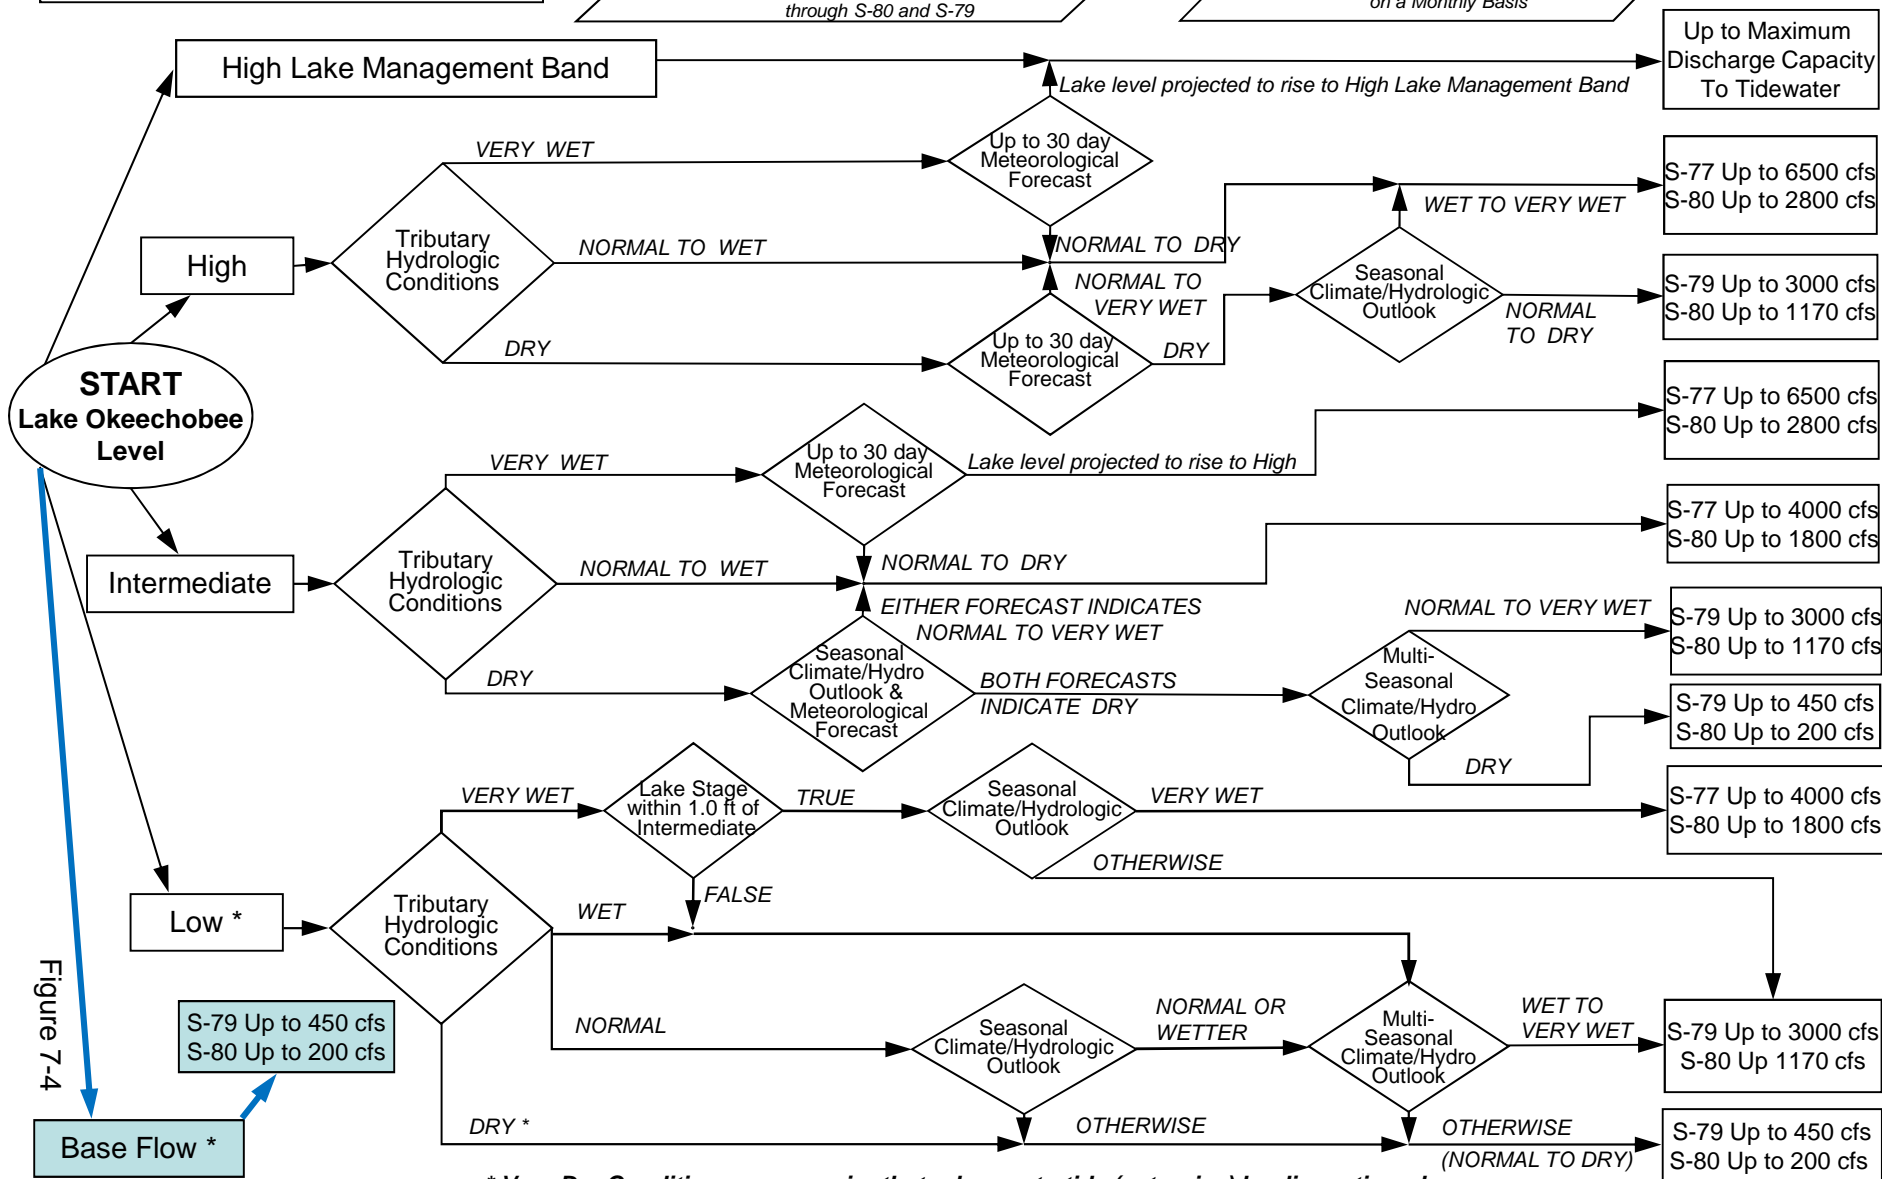


Figure 7-4

* Very Dry Conditions may require that releases to tide (estuaries) be discontinued

Flowchart to Guide Recommendations for Lake Okeechobee Releases to the Caloosahatchee Estuary for 2008 LORS Baseflow & for Environmental Water Supply (revised 9-Aug-2012)

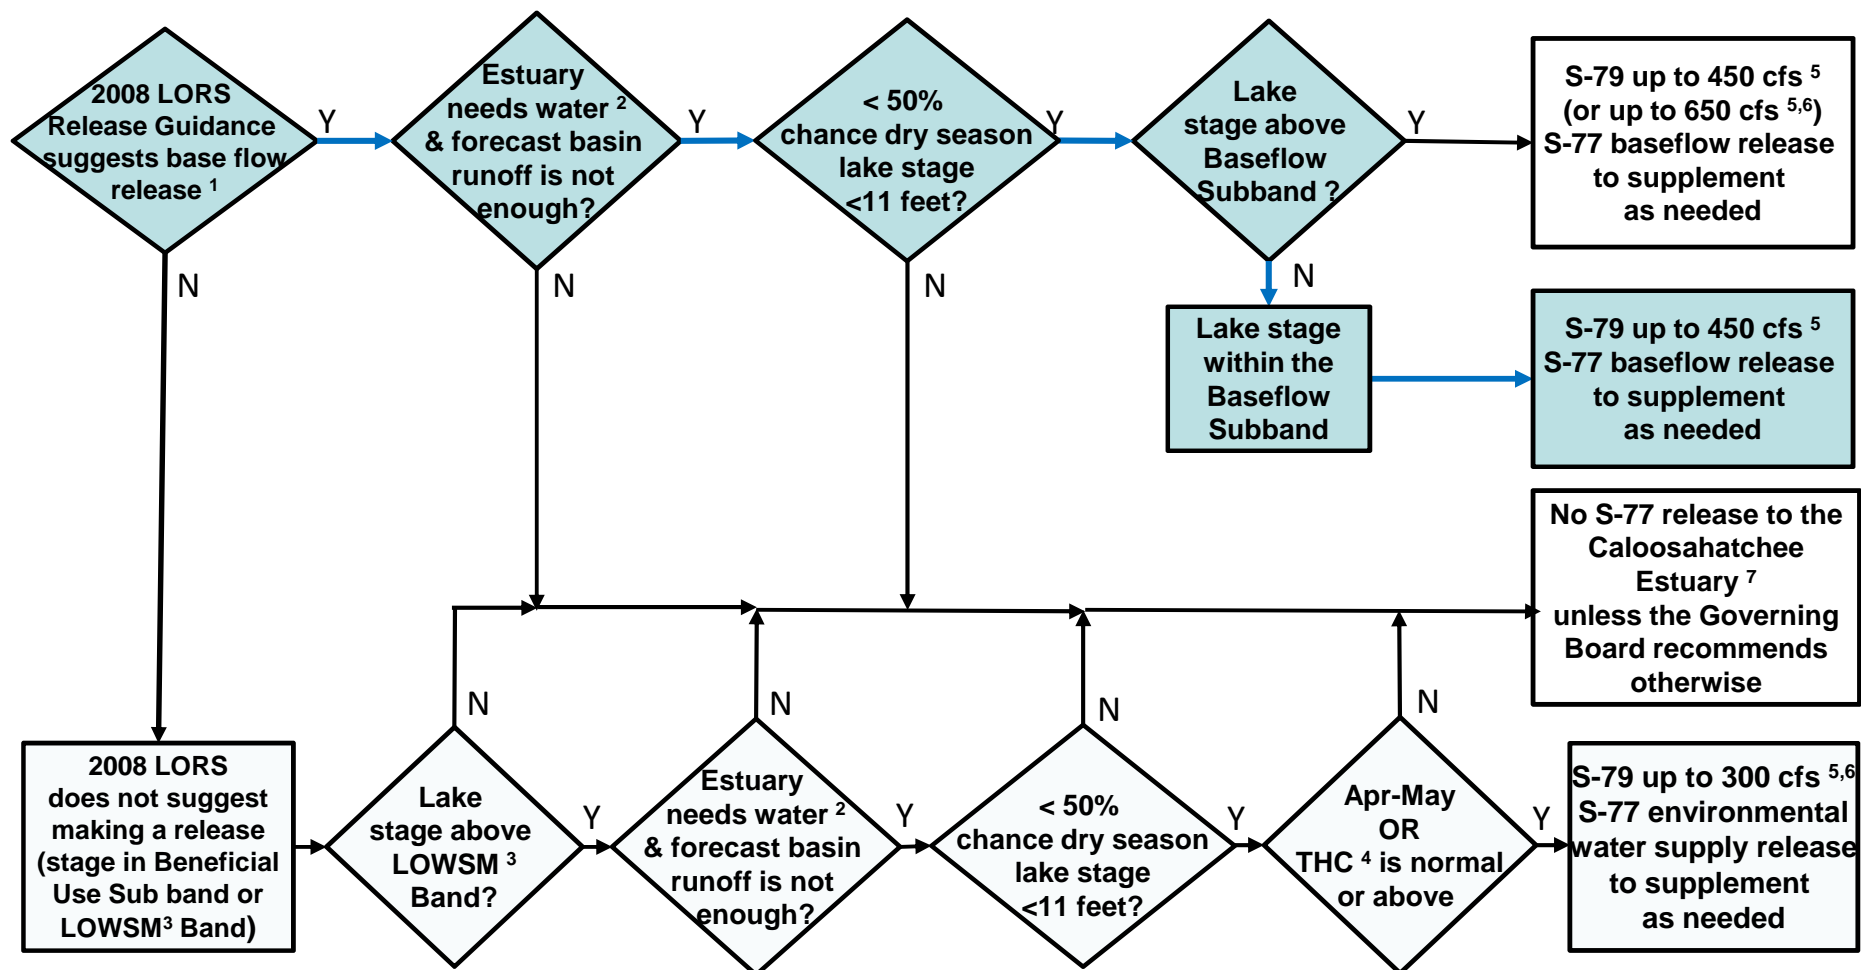

¹The 2008 LORS Release Guidance (Part D) can suggest baseflow releases in the Intermediate, Low, or Baseflow Subbands.

²Estuary “needs” water when the 30-day moving average salinity at I-75 bridge is projected to exceed 5 practical salinity units (psu) within 2 weeks.

³LOWSM = Lake Okeechobee Water Shortage Management.

⁴Tributary Hydrologic Condition (THC) is based on classification of Lake Okeechobee Net Inflow and Palmer Index.

⁵Can release less than the “up to” limit if lower release is sufficient to reach or sustain desired estuary salinity; cfs = cubic feet per second.

⁶After reviewing conditions in Water Conservation Areas (WCAs), Stormwater Treatment Areas (STAs), ENP, St. Lucie Estuary and Lake Okeechobee.

⁷Should this condition be reached, the Governing Board will be briefed at their next regularly scheduled meeting as part of the State of the Water Resources agenda item.

U. S. Army Corps of Engineers, Jacksonville District
 Lake Okeechobee and Vicinity Report
 ** Preliminary Data - Subject to Revision **

Data Ending 2400 hours 22 DEC 2019

Okeechobee Lake Regulation	Elevation	Last Year	2YRS Ago
	(ft-NGVD)	(ft-NGVD)	(ft-NGVD)
*Okeechobee Lake Elevation	13.00	12.75	-NR- (Official Elv)
Bottom of High Lake Mngmt=	17.25	Top of Water Short Mngmt=	12.23
Currently in Operational Management Band			

Simulated Average LORS2008 [1965-2000]	13.58
Difference from Average LORS2008	-0.58

22DEC (1965-2007) Period of Record Average	14.68
Difference from POR Average	-1.68

Today Lake Okeechobee elevation is determined from the 4 Int & 4 Edge stations

++Navigation Depth (Based on 2007 Channel Condition Survey) Route 1 ÷ 6.94'
 ++Navigation Depth (Based on 2008 Channel Condition Survey) Route 2 ÷ 5.14'
 Bridge Clearance = 50.58'

4 Interior and 4 Edge Okeechobee Lake Average (Avg-Daily values):

L001	L005	L006	LZ40	S4	S352	S308	S133
13.02	13.10	12.99	12.97	13.04	13.03	12.90	13.00

*Combination Okeechobee Avg-Daily Lake Average = 13.00
 (*See Note)

Okeechobee Inflows (cfs):

S65E	450	S65EX1	0	Fisheating Cr	4
S154	0	S191	99	S135 Pumps	0
S84	199	S133 Pumps	0	S2 Pumps	0
S84X	0	S127 Pumps	0	S3 Pumps	0
S71	52	S129 Pumps	0	S4 Pumps	0
S72	0	S131 Pumps	0	C5	0
Total Inflows:	804				

Okeechobee Outflows (cfs):

S135 Culverts	0	S354	0	S77	529
S127 Culverts	0	S351	0	S308	-124
S129 Culverts	0	S352	0		
S131 Culverts	0	L8 Canal Pt	-62		
Total Outflows:	343				

****S77 structure flow is being used to compute Total Outflow.
 ****S308 structure flow is being used to compute Total Outflow.

Okeechobee Pan Evaporation (inches):

S77	0.11	S308	0.33
Average Pan Evap x 0.75 Pan Coefficient = 0.16" = 0.01'			

Lake Average Precipitation using NEXRAD: = 0.51" = 0.04'

Evaporation - Precipitation: = -0.34" = -0.03'
 Evaporation - Precipitation using Lake Area of 730 square miles
 is equal to 6772 cfs into the lake.
 Lake Okeechobee (Change in Storage) Flow is 1966 cfs or 3900 AC-FT

	Headwater Elevation (ft-msl)	Tailwater Elevation (ft-msl)	Disch (cfs)	----- Gate Positions -----							
				#1 (ft)	#2 (ft)	#3 (ft)	#4 (ft)	#5 (ft)	#6 (ft)	#7 (ft)	#8 (ft)
(I) see note at bottom											
North East Shore											
S133 Pumps:	13.31	13.03	0	0	0	0	0	0	0		(cfs)
S193:											
S191:	19.33	12.99	99	1.4	0.0	0.0					
S135 Pumps:	13.39	12.90	0	0	0	0	0				(cfs)
S135 Culverts:			0	0.0	0.0						
North West Shore											
S65E:	20.92	13.02	450	0.1	0.0	0.0	0.0	0.0	0.0		
S65EX1:	20.92	13.02	0								
S127 Pumps:	12.95	13.07	0	0	0	0	0	0			(cfs)
S127 Culvert:			0	0.0							
S129 Pumps:	12.91	13.17	0	0	0	0					(cfs)
S129 Culvert:			0	0.0							
S131 Pumps:	12.91	13.30	0	0	0						(cfs)
S131 Culvert:			0								
Fisheating Creek											
nr Palmdale		28.32	4								
nr Lakeport											
C5:		-NR-	0	-NR-	-NR-	-NR-					
South Shore											
S4 Pumps:	11.80	12.98	0	0	0	0					(cfs)
S169:	13.01	11.77	0	0.0	0.0	0.0					
S310:	12.88		-32								
S3 Pumps:	9.62	12.86	0	0	0	0					(cfs)
S354:	12.86	9.62	0	0.0	0.0						
S2 Pumps:	9.52	-NR-	0	-NR-	-NR-	-NR-	-NR-				(cfs)
S351:	-NR-	9.52	0	0.0	0.0	0.0					
S352:	13.02	9.43	0	0.0	0.0						
C10A:	-NR-	13.14		8.0	8.0	8.0	0.0	0.0			
L8 Canal PT		12.92	-62								

S351 and S352 Temporary Pumps/S354 Spillway

S351:	9.52	-NR-	0	-NR-	-NR-	-NR-	-NR-	-NR-	-NR-		
S352:	9.43	13.02	0	-NR-	-NR-	-NR-	-NR-				
S354:	9.62	12.86	0	-NR-	-NR-	-NR-	-NR-				

Caloosahatchee River (S77, S78, S79)

S47B:	13.11	11.18		0.0	0.0						
S47D:	11.15	11.14	18	6.5							

S77:

Spillway and Sector Preferred Flow:
 12.87 11.02 528 0.0 0.0 2.5 0.0
 Flow Due to Lockages+: 1

S78:

Spillway and Sector Flow:
 11.08 2.98 880 0.0 0.0 2.5 0.0
 Flow Due to Lockages+: 4

S79:

Spillway and Sector Flow:
 3.15 2.63 1384 0.0 1.0 1.0 1.0 1.0 1.0 0.0 0.0
 Flow Due to Lockages+: 2
 Percent of flow from S77 38%
 Chloride (ppm) 0

St. Lucie Canal (S308, S80)

S308:

Spillway and Sector Preferred Flow:
 12.92 12.92 -124 3.0 3.0 3.0 3.0
 Flow Due to Lockages+: 0

S153: 18.73 12.75 66 0.0 0.0

S80:

Spillway and Sector Flow:
 13.10 0.45 0 0.0 0.0 0.0 0.0 0.0 0.0 0.0
 Flow Due to Lockages+: 10
 Percent of flow from S308 NA %

Steele Point Top Salinity (mg/ml) ****
 Steele Point Bottom Salinity (mg/ml) ****

Speedy Point Top Salinity (mg/ml) ****
 Speedy Point Bottom Salinity (mg/ml) ****

+ Flow Due to lockages is computed utilizing average daily headwater and tailwater along with total number of lockages for the day to calculate a volume which is then converted to an average discharge in cfs.

++ Preferred flow is determined from either the spillway discharge or the below flow meter daily

Daily Precipitation Totals	1-Day (inches)	3-Day (inches)	7-Day (inches)	----- Wind -----	
				Direction (DegØ)	Speed (mph)
S133 Pump Station:	-NR-	0.00	0.00		
S193:	-NR-	0.00	0.00	-NR-	-NR-
Okeechobee Field Station:	-NR-	0.00	0.00		
S135 Pump Station:	-NR-	0.00	0.00		
S127 Pump Station:	-NR-	0.00	0.00		
S129 Pump Station:	-NR-	0.00	0.00		
S131 Pump Station:	-NR-	0.00	0.00		
S77:	0.32	0.39	8.10	140	7
S78:	0.33	0.47	4.24	118	9
S79:	0.75	1.05	6.23	82	9
S4 Pump Station:	-NR-	0.00	0.00		
Clewiston Field Station:	-NR-	0.00	0.00		
S3 Pump Station:	-NR-	0.00	0.00		
S2 Pump Station:	-NR-	0.00	0.00		
S308:	0.18	0.18	10.36	140	7
S80:	0.20	0.55	9.87	162	3
Okeechobee Average	0.25	0.04	1.42		

(Sites S78, S79 and S80 not included)

Oke Nexrad Basin Avg 0.51 0.60 1.01

Okeechobee Lake Elevations	22 DEC 2019	13.00	Difference from 22DEC19
22DEC19 -1 Day =	21 DEC 2019	12.99	-0.01
22DEC19 -2 Days =	20 DEC 2019	12.98	-0.02
22DEC19 -3 Days =	19 DEC 2019	12.98	-0.02
22DEC19 -4 Days =	18 DEC 2019	13.01	0.01
22DEC19 -5 Days =	17 DEC 2019	13.01	0.01
22DEC19 -6 Days =	16 DEC 2019	13.01	0.01
22DEC19 -7 Days =	15 DEC 2019	13.01	0.01
22DEC19 -30 Days =	22 NOV 2019	13.15	0.15
22DEC19 -1 Year =	22 DEC 2018	12.75	-0.25
22DEC19 -2 Year =	22 DEC 2017	-NR-	-NR-

Long Term Mean 30day Avearge ET for Lake Alfred (Inches) = 2.02

Lake Okeechobee Net Inflow (LONIN)				
Average Flow over the previous 14 days				Avg-Daily Flow
22DEC19 Today =	22 DEC 2019	2078	MON	2494
22DEC19 -1 Day =	21 DEC 2019	1943	SUN	2591
22DEC19 -2 Days =	20 DEC 2019	1822	SAT	262
22DEC19 -3 Days =	19 DEC 2019	1600	FRI	-5595
22DEC19 -4 Days =	18 DEC 2019	1802	THU	811
22DEC19 -5 Days =	17 DEC 2019	1640	WED	731
22DEC19 -6 Days =	16 DEC 2019	966	TUE	732
22DEC19 -7 Days =	15 DEC 2019	747	MON	-3625
22DEC19 -8 Days =	14 DEC 2019	987	SUN	4923
22DEC19 -9 Days =	13 DEC 2019	771	SAT	12274
22DEC19 -10 Days =	12 DEC 2019	-114	FRI	12443
22DEC19 -11 Days =	11 DEC 2019	-1161	THU	2022
22DEC19 -12 Days =	10 DEC 2019	-1435	WED	-1751
22DEC19 -13 Days =	09 DEC 2019	-1386	TUE	785

S65E				
Average Flow over previous 14 days				Avg-Daily Flow
22DEC19 Today=	22 DEC 2019	421	MON	524
22DEC19 -1 Day =	21 DEC 2019	411	SUN	347
22DEC19 -2 Days =	20 DEC 2019	407	SAT	480
22DEC19 -3 Days =	19 DEC 2019	392	FRI	494
22DEC19 -4 Days =	18 DEC 2019	383	THU	500
22DEC19 -5 Days =	17 DEC 2019	366	WED	458
22DEC19 -6 Days =	16 DEC 2019	350	TUE	322
22DEC19 -7 Days =	15 DEC 2019	354	MON	321
22DEC19 -8 Days =	14 DEC 2019	356	SUN	359
22DEC19 -9 Days =	13 DEC 2019	348	SAT	456
22DEC19 -10 Days =	12 DEC 2019	340	FRI	569
22DEC19 -11 Days =	11 DEC 2019	323	THU	238
22DEC19 -12 Days =	10 DEC 2019	336	WED	468
22DEC19 -13 Days =	09 DEC 2019	319	TUE	354

S65EX1				
Average Flow over previous 14 days				Avg-Daily Flow
22DEC19 Today=	22 DEC 2019	0	MON	0
22DEC19 -1 Day =	21 DEC 2019	0	SUN	0
22DEC19 -2 Days =	20 DEC 2019	6	SAT	0

22DEC19	-3 Days =	19 DEC 2019	14	FRI		0
22DEC19	-4 Days =	18 DEC 2019	14	THU		0
22DEC19	-5 Days =	17 DEC 2019	14	WED		0
22DEC19	-6 Days =	16 DEC 2019	20	TUE		0
22DEC19	-7 Days =	15 DEC 2019	20	MON		0
22DEC19	-8 Days =	14 DEC 2019	27	SUN		0
22DEC19	-9 Days =	13 DEC 2019	28	SAT		0
22DEC19	-10 Days =	12 DEC 2019	34	FRI		0
22DEC19	-11 Days =	11 DEC 2019	34	THU		0
22DEC19	-12 Days =	10 DEC 2019	36	WED		0
22DEC19	-13 Days =	09 DEC 2019	40	TUE		0

Lake Okeechobee Outlets Last 14 Days

	S-77	Below S-77	S-78	S-79	
	Discharge	Discharge	Discharge	Discharge	
	(ALL DAY)	(ALL-DAY)	(ALL DAY)	(ALL DAY)	
DATE	(AC-FT)	(AC-FT)	(AC-FT)	(AC-FT)	
22 DEC 2019	1042	837	1751	2723	
21 DEC 2019	892	1033	1733	3341	
20 DEC 2019	85	461	1437	2830	
19 DEC 2019	507	668	761	1761	
18 DEC 2019	1057	1249	1168	1057	
17 DEC 2019	1084	1373	1198	1142	
16 DEC 2019	617	957	1013	1641	
15 DEC 2019	159	140	831	2247	
14 DEC 2019	137	252	619	1504	
13 DEC 2019	326	763	610	380	
12 DEC 2019	1038	1122	633	529	
11 DEC 2019	1720	1861	773	912	
10 DEC 2019	1622	1836	1176	1294	
09 DEC 2019	1428	1619	1362	1811	

	S-310	S-351	S-352	S-354	L8 Canal Pt
	Discharge	Discharge	Discharge	Discharge	Discharge
	(ALL DAY)	(ALL DAY)	(ALL DAY)	(ALL DAY)	(ALL DAY)
DATE	(AC-FT)	(AC-FT)	(AC-FT)	(AC-FT)	(AC-FT)
22 DEC 2019	-64	0	0	0	-122
21 DEC 2019	1	0	0	0	-166
20 DEC 2019	-38	0	0	0	-143
19 DEC 2019	-15	0	0	0	-134
18 DEC 2019	97	0	39	91	-65
17 DEC 2019	48	0	173	141	-190
16 DEC 2019	6	0	142	303	-52
15 DEC 2019	52	459	130	321	-249
14 DEC 2019	32	444	207	438	-518
13 DEC 2019	20	69	0	157	-691
12 DEC 2019	103	109	4	175	-172
11 DEC 2019	95	620	406	502	283
10 DEC 2019	208	880	490	397	284
09 DEC 2019	125	1658	616	641	322

	S-308	Below S-308	S-80
	Discharge	Discharge	Discharge
	(ALL DAY)	(ALL-DAY)	(ALL-DAY)
DATE	(AC-FT)	(AC-FT)	(AC-FT)
22 DEC 2019	-221	-279	21
21 DEC 2019	358	-279	23
20 DEC 2019	577	-56	30
19 DEC 2019	276	-537	-NR-
18 DEC 2019	517	-592	29
17 DEC 2019	-25	-689	47

16 DEC 2019	400	-604	50
15 DEC 2019	-399	-1387	35
14 DEC 2019	-1466	-2491	50
13 DEC 2019	-2500	-2956	42
12 DEC 2019	-1014	-1028	20
11 DEC 2019	337	4	49
10 DEC 2019	458	-38	44
09 DEC 2019	527	-50	17

*** NOTE: Discharge (ALL DAY) is computed using Spillway, Sector Gate and Lockages Discharges from 0015 hrs to 2400 hrs.


(I) - Flows preceded by "I" signify an instantaneous flow computed from the single value reported for the day

* On 11 May 1999, Lake Okeechobee Elevation was switched from Instantaneous 2400 value to an average-daily lake average.
 On 14 Mar 2001, due to the isolation of various gages within the standard 10 stations, the average of the interior 4 station gages was used as the Lake Okeechobee Elevation.
 On 05 November 2010, Lake Okeechobee Elevation was switched to a 9 gage mix of interior and edge gages to obtain a more reliable representation of the lake level.
 On 09 May 2011, Lake Okeechobee Elevation was switched to a 8 gage mix of interior and edge gages to obtain a more reliable representation of the lake level due to isolation of S135 from low lake levels.
 Today Lake Okechobee elevation is determined from the 4 Int & 4 Edge stations
 ++ For more information see the Jacksonville District Navigation website at <http://www.saj.usace.army.mil/>
 \$ For information regarding Lake Okeechobee Service Area water restrictions please refer to www.sfwmd.gov

Report Generated 23DEC2019 @ 09:45 ** Preliminary Data - Subject to Revision **

Lake Okeechobee

23DEC19 11:45:32

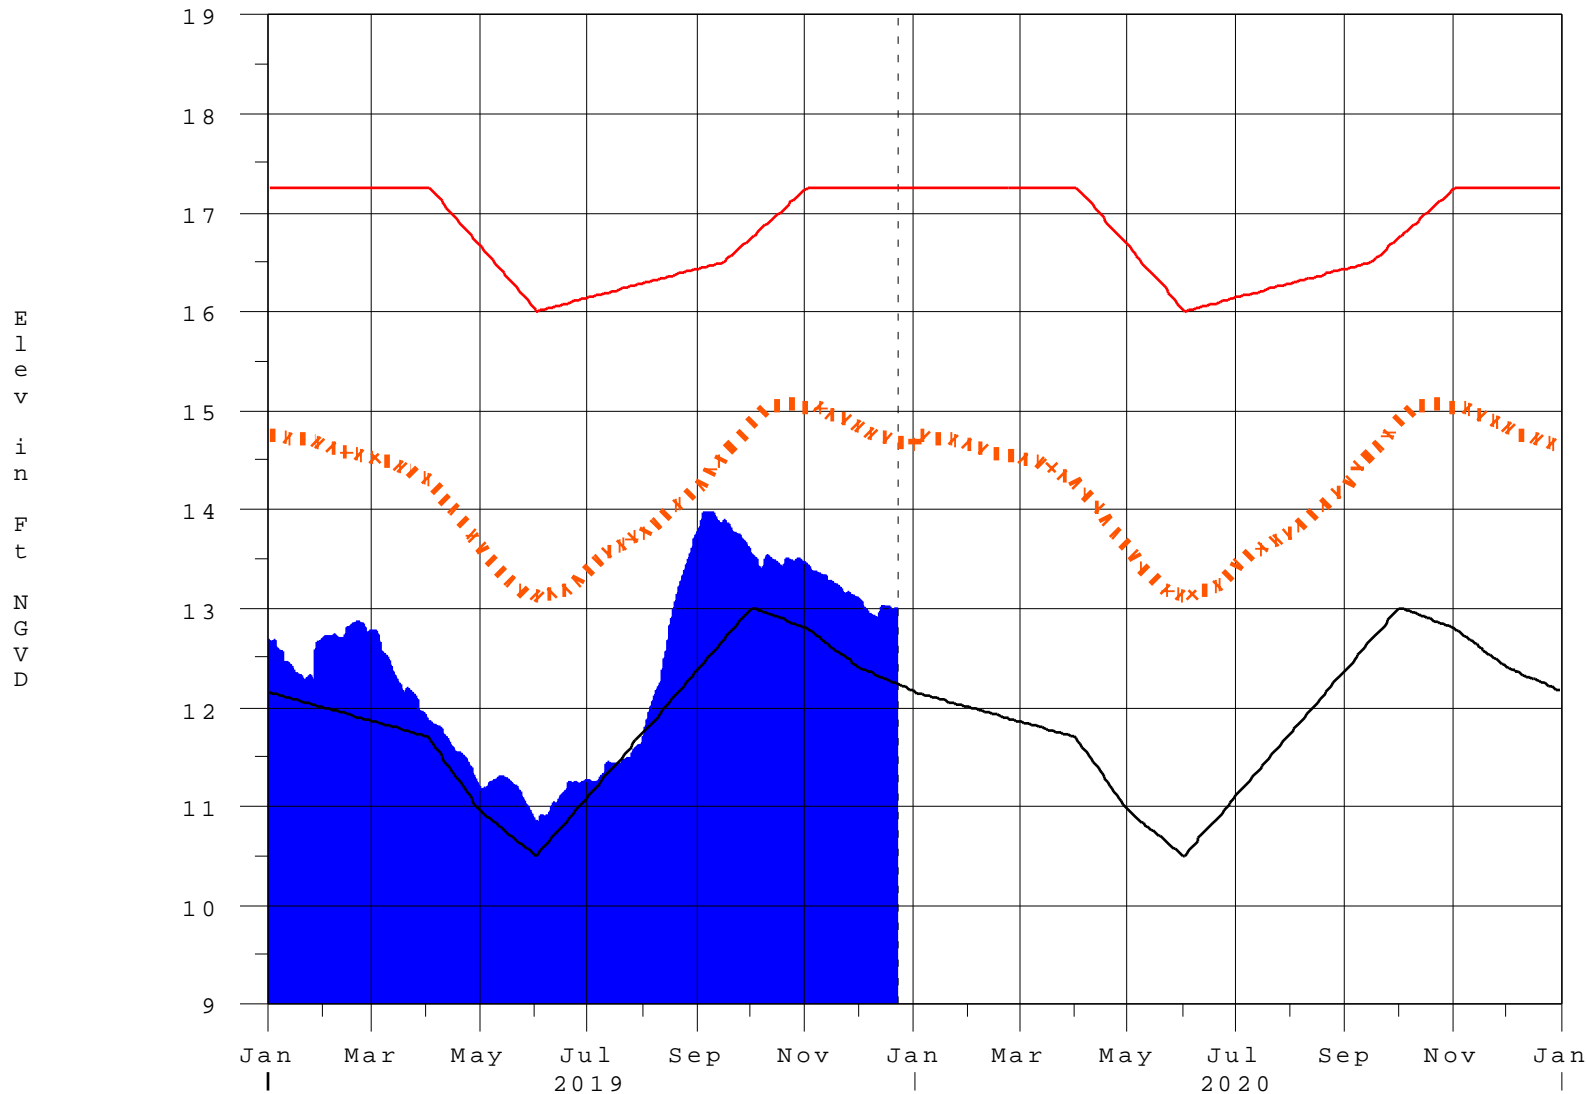

- High Lake Management
- Okeechobee Avg Elev
- Average Elev [1965-2007]
- Water Shortage Management

Classification Tables

Supplemental Tables used in conjunction with the LORS2008 Release

Guidance Flow Charts

- [Class Limits for Tributary Hydrologic Conditions](#)

Table K-2 in the Lake Okeechobee Water Control Plan

- [6-15 Day Precipitation Outlook Categories](#)

Table ?? in the Lake Okeechobee Water Control Plan

- [Classification of Lake Okeechobee Net Inflow for Seasonal Outlook](#)

Table K-3 in the Lake Okeechobee Water Control Plan

- [Classification of Lake Okeechobee Net Inflow for Multi-Seasonal Outlook](#)

Table K-4 in the Lake Okeechobee Water Control Plan

[Back to Lake Okeechobee Operations Main Page](#)

[Back to U.S. Army Corps of Engineers Lake Okeechobee Operations Homepage](#)

Tributary Hydrologic Classification*	Palmer Index Class Limits	2-wk Mean L.O. Net Inflow Class Limits
Very Wet	3.0 or greater	Greater \geq 6000 cfs
Wet	1.5 to 2.99	2500 - 5999 cfs
Near Normal	-1.49 to 1.49	500 - 2499 cfs
Dry	-2.99 to -1.5	-5000 – 500 cfs
Very Dry	-3.0 or less	Less than -5000 cfs

* use the wettest of the two indicators

Classification of Lake Okeechobee Net Inflow Seasonal Outlook*

Lake Net Inflow Prediction [million acre-feet]	Equivalent Depth** [feet]	Lake Okeechobee Net Inflow Seasonal Outlook
> 0.93	> 2.0	Very Wet
0.71 to 0.93	1.51 to 2.0	Wet
0.35 to 0.70	0.75 to 1.5	Normal
< 0.35	< 0.75	Dry

****Volume-depth conversion based on average lake surface area of 467,000 acres**

Classification of Lake Okeechobee Net Inflow Multi-Seasonal Outlook*

Lake Net Inflow Prediction [million acre-feet]	Equivalent Depth** [feet]	Lake Okeechobee Net Inflow Multi-Seasonal Outlook
> 2.0	> 4.3	Very Wet
1.18 to 2.0	2.51 to 4.3	Wet
0.5 to 1.17	1.1 to 2.5	Normal
< 0.5	< 1.1	Dry

****Volume-depth conversion based on average lake surface area of 467,000 acres**

6-15 Day Precipitation Outlook Categories*

6-15 Day Precipitation Outlook Categories	WSE Decision Tree Categories
Above Normal	Wet to Very Wet
Normal	Normal
Below Normal	Dry

* Corresponds to Table 7-6 in the Lake Okeechobee Water Control Plan

Under Construction