

Application of the Lake Okeechobee Regulation Schedule (LORS2008) on 8/16/2021 (ENSO Condition: ENSO-neutral)

Lake Okeechobee Net Inflow Outlook:

The Lake Okeechobee Net Inflow Outlook has been computed using 4 methods: Croley's method¹, the SFWMD empirical method², a sub-sampling of ENSO Neutral years³ and a sub-sampling of warm years of the Atlantic Multi-decadal Oscillation (AMO) in combination with ENSO Neutral years⁴. The results for Croley's method and the SFWMD empirical method are based on the CPC Outlook.

Table of the Lake Okeechobee Net Inflow Outlooks in feet of equivalent depth. All methods are updated on a weekly basis with observed net inflow for the current month.

Season	Croley's Method ^{1*}		SFWMD Empirical Method ²		Sub-sampling of ENSO Neutral Years ³		Sub-sampling of AMO Warm + ENSO Neutral Years ⁴	
	Value (ft)	<u>Condition</u>	Value (ft)	<u>Condition</u>	Value (ft)	<u>Condition</u>	Value (ft)	<u>Condition</u>
Current (Aug-Jan)	N/A	N/A	2.29	Very Wet	2.23	Very Wet	3.53	Very Wet
Multi Seasonal (Aug-Apr)	N/A	N/A	2.66	Wet	2.11	Normal	3.60	Wet

***Croley's Method Not Produced for This Report.** See Seasonal and Multi-Seasonal tables for the classification of Lake Okeechobee Outlooks.

The recommended methods and values for estimating the Lake Okeechobee Net Inflow Outlook are shaded and should be used in the LORS2008 Release Guidance Flow Charts.

****Sub-sampling is a weighted average of ENSO conditions based on the ENSO forecast used.**

Tributary Hydrologic Conditions Graph:

9270 cfs 14-day running average for Lake Okeechobee Net Inflow through 8/15/2021. According to the classification in Tributary Hydrologic Conditions table, this condition is Very Wet.

-0.68 for Palmer Drought Index on 8/14/2021.

According to the classification in Tributary Hydrologic Conditions table, this condition is Normal.

The wetter of the two conditions above is **Very Wet**.

LORS2008 Classification Tables:

Lake Okeechobee Stage on 8/16/2021:

Lake Okeechobee Stage: **14.35 feet**

Lake Okeechobee Management Zone/Band		Bottom Elevation (feet, NGVD)	Current Lake Stage
High Lake Management Band		16.35	
Operational Band	High sub-band	15.95	
	Intermediate sub-band	15.53	
	Low sub-band	13.71	← 14.35 ft
Base Flow sub-band		12.60	
Beneficial Use sub-band		12.05	
Water Shortage Management Band			

Part C of LORS2008: Discharge to WCAs

Up to Maximum Practicable to the WCAs if desirable or with minimum Everglades impact; otherwise no releases to WCAs.

Part D of LORS2008: Discharge to Tide

Up to 450 cfs at S-79 and up to 200 cfs at S-80.

LORS2008 Implementation on 8/16/2021 (ENSO Condition- ENSO-neutral):


Status for week ending 8/16/2021:

Water Supply Risk Evaluation

Area	Indicator	Value	Color Coded Scoring Scheme
LOK	Projected LOK Stage for the next two months	Low Sub-band	L
	Palmer Drought Index for LOK Tributary Conditions	-0.68 (Normal to Extremely Wet)	L
	CPC Precipitation Outlook	1 month: Normal	L
		3 months: Normal	L
	LOK Seasonal Net Inflow Outlook	2.23 ft	L
	ENSO Forecast	Normal to Extremely Wet	L
	LOK Multi-Seasonal Net Inflow Outlook	2.11 ft	M
	ENSO Forecast	Normal	
WCAs	WCA 1: 3 Station Average (Site 1-7, 1-8T and 1-9)	Above Line 1 (16.77 ft)	L
	WCA 2A: Site 2-17	Above Line 1 (12.51 ft)	L
	WCA-3A: 3 Station Average (Site 63, 64 and 65)	Above Line 1 (9.84 ft)	L
LEC	Service Area 1	Year-Round Irrigation Rule in effect	L
	Service Area 2	Year-Round Irrigation Rule in effect	L
	Service Area 3	Year-Round Irrigation Rule in effect	L

Note: The water supply risk classification based on the Palmer index, as well as the LOK seasonal and multi-seasonal net inflow outlooks use slightly different classification intervals than those used by the 2008-LORS.


Lake Okeechobee SFWMM Aug 2021 Position Analysis

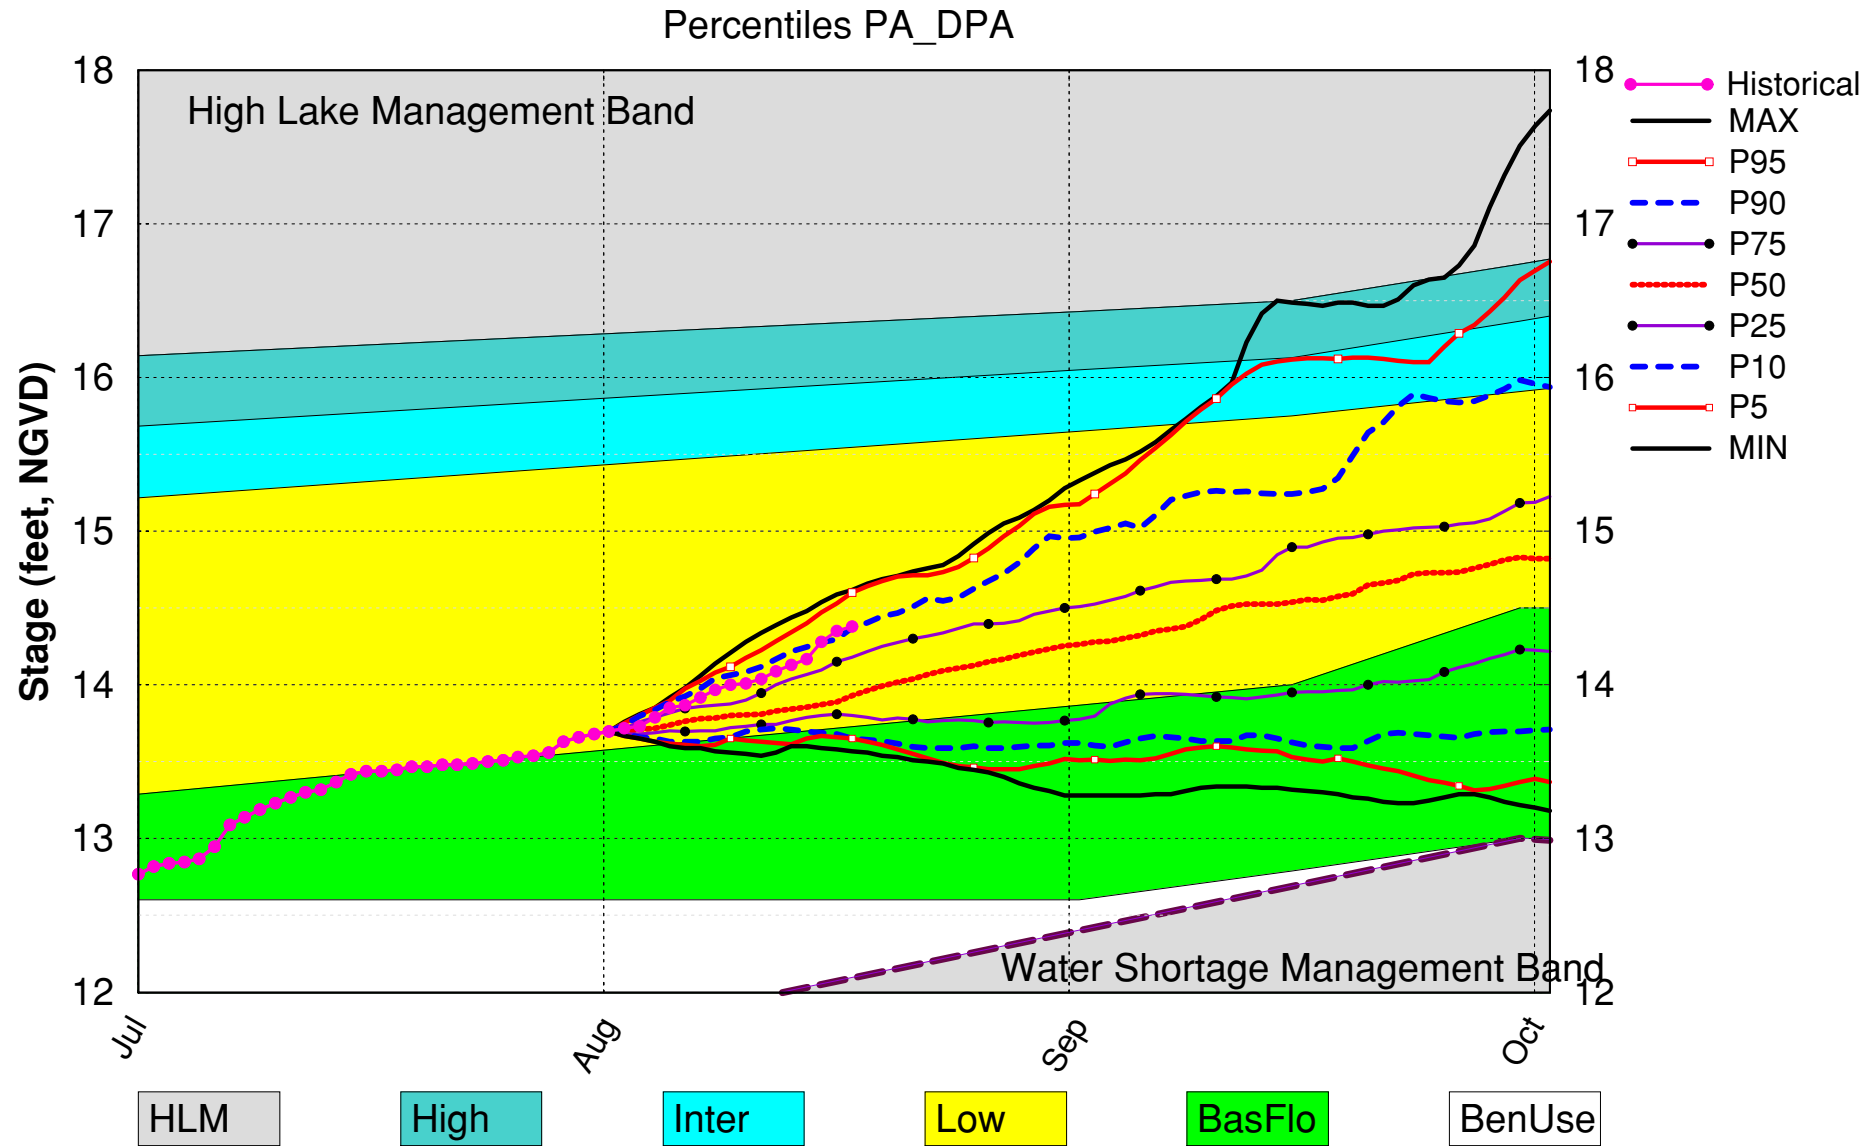


(See assumptions on the Position Analysis Results website)

Tributary Basin Condition Indicators as of August 16 2021

Palmer Index

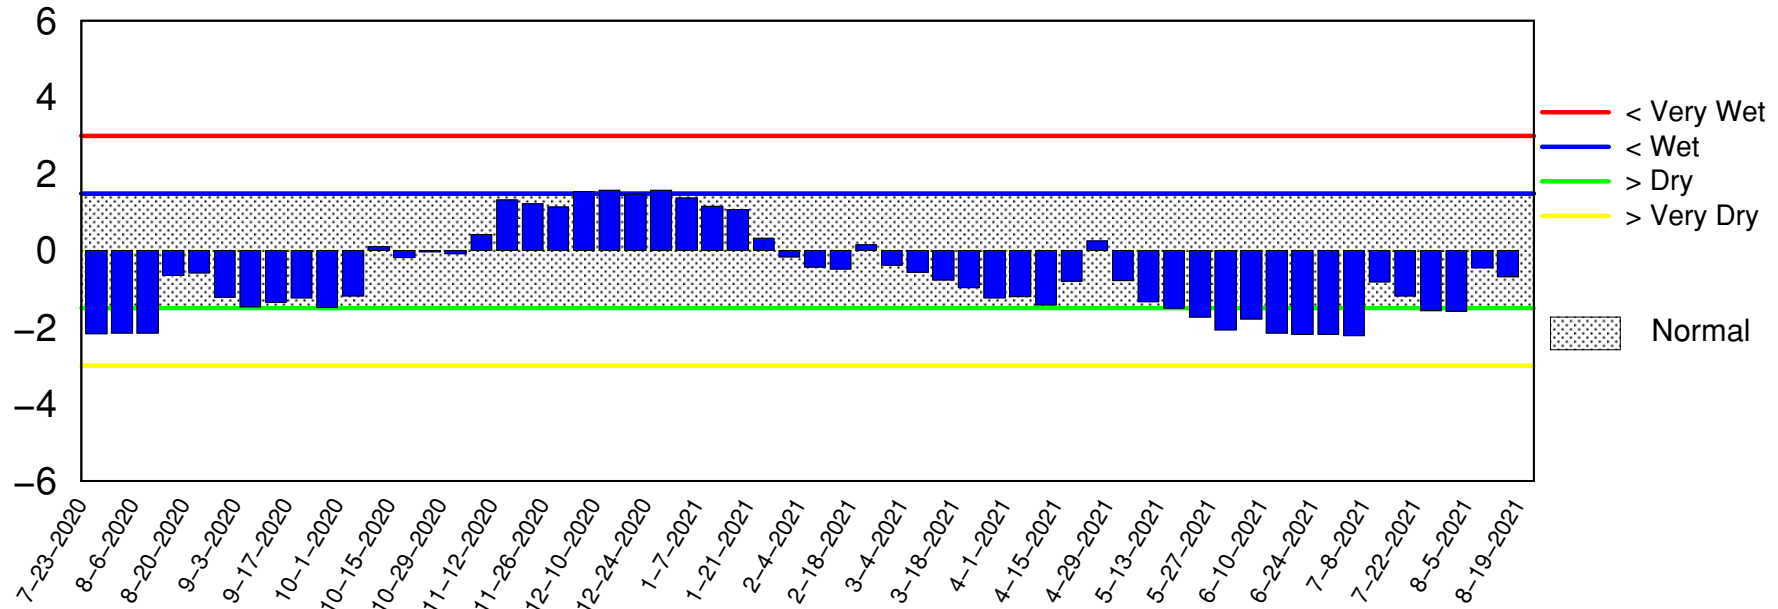

Lake Okeechobee Net Inflow (LONIN) 14-day Running Average

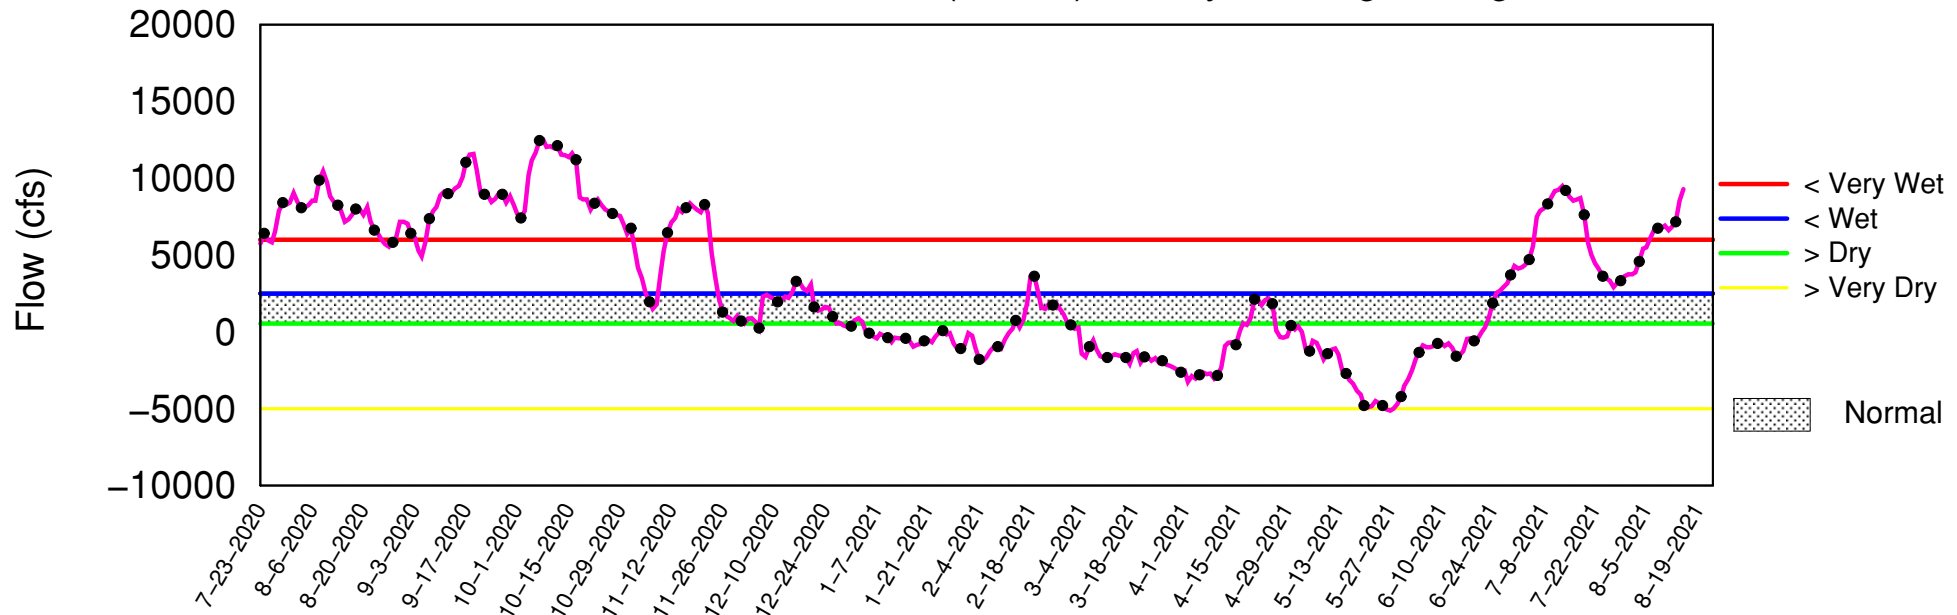

2008 LORS

Part C: Establish Allowable Lake Okeechobee Releases to the Water Conservation Areas

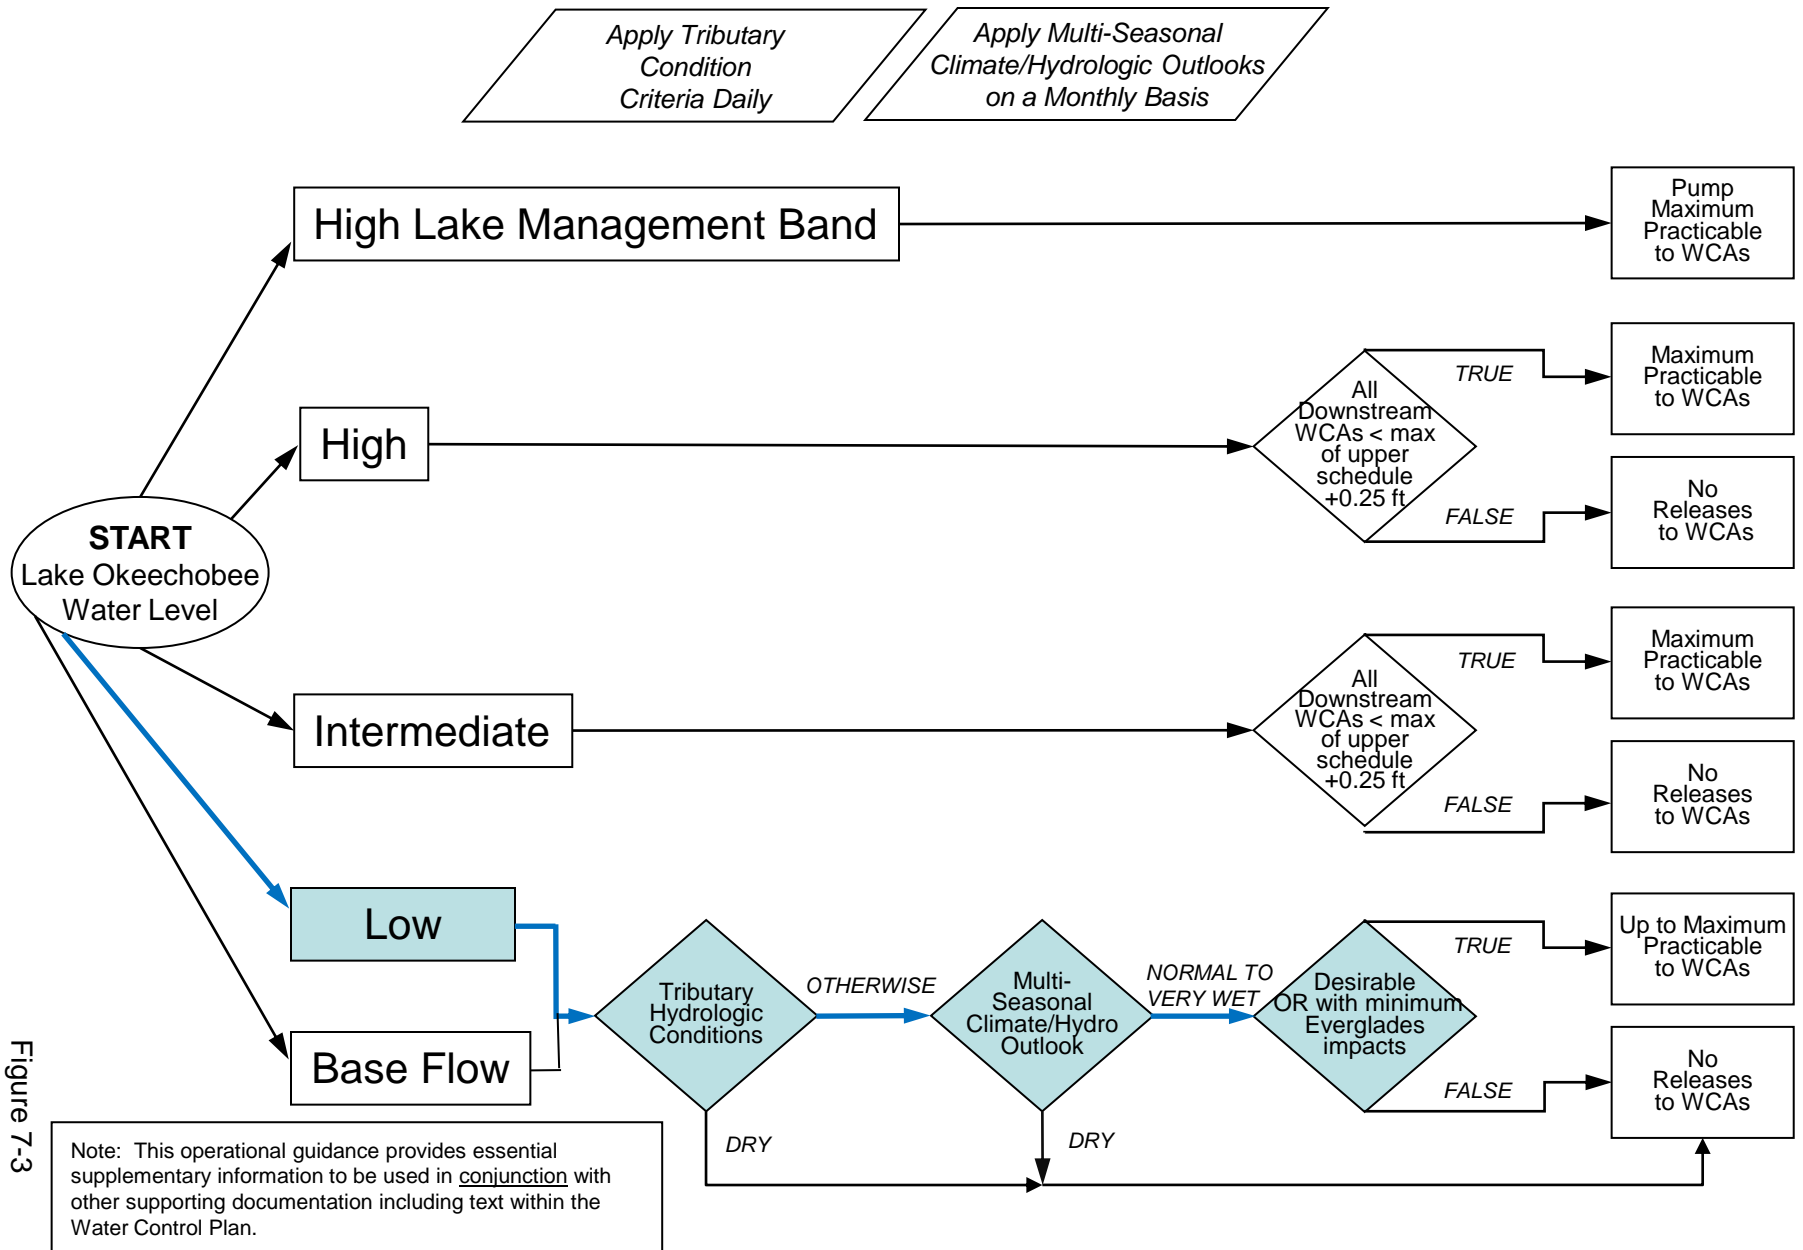


Figure 7-3


2008 LORS

Part D: Establish Allowable Lake Okeechobee Releases to Tide (Estuaries)


Note: This operational guidance provides essential supplementary information to be used in conjunction with other supporting documentation including text within the Water Control Plan.

When conducting Base Flow releases, flows can be distributed East and West up to 650 cfs as needed to minimize impacts or provide benefits through S-80 and S-79

Apply Meteorological Forecasts on a Weekly Basis; apply Seasonal and Multi-Seasonal Climate/Hydrologic Outlooks on a Monthly Basis

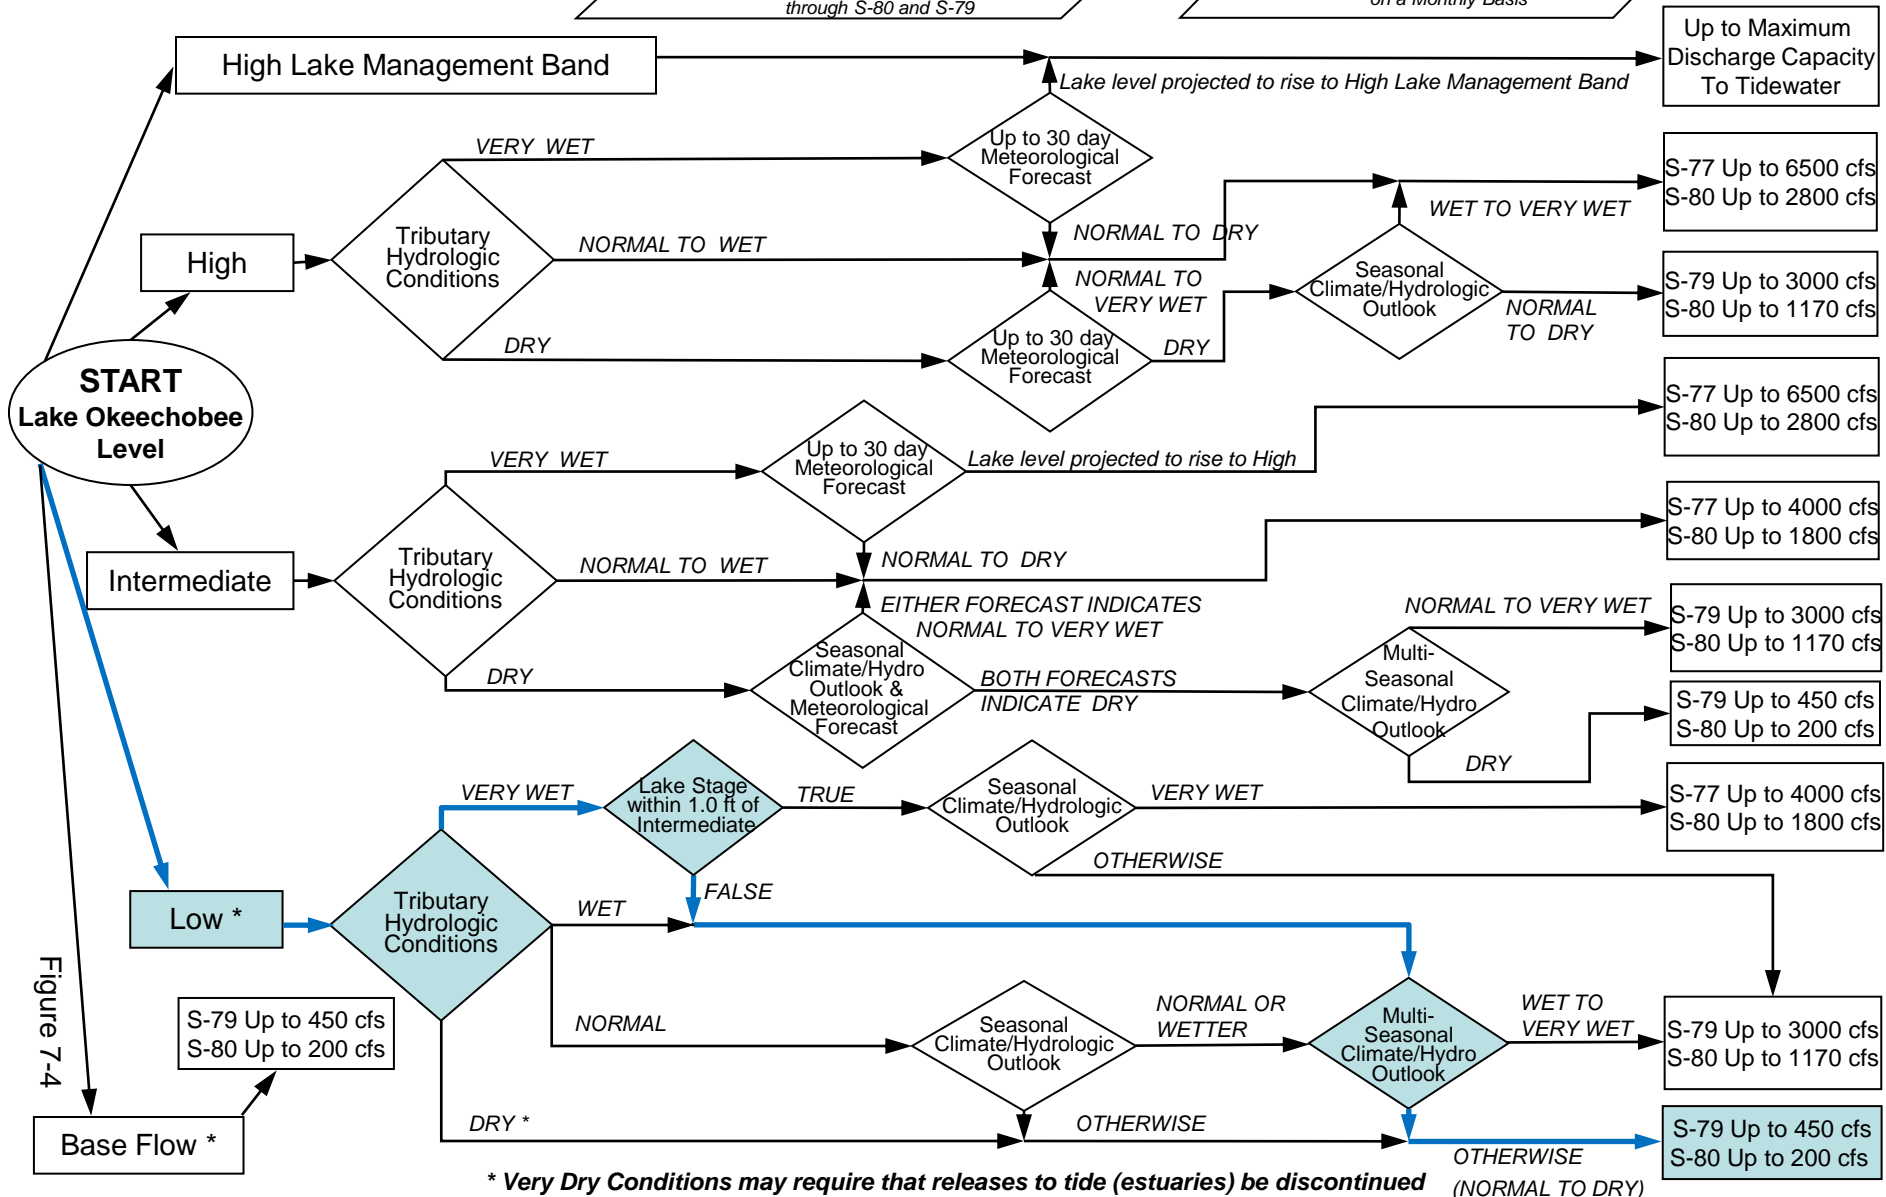

Lake Okeechobee Water Level History and Projected Stages

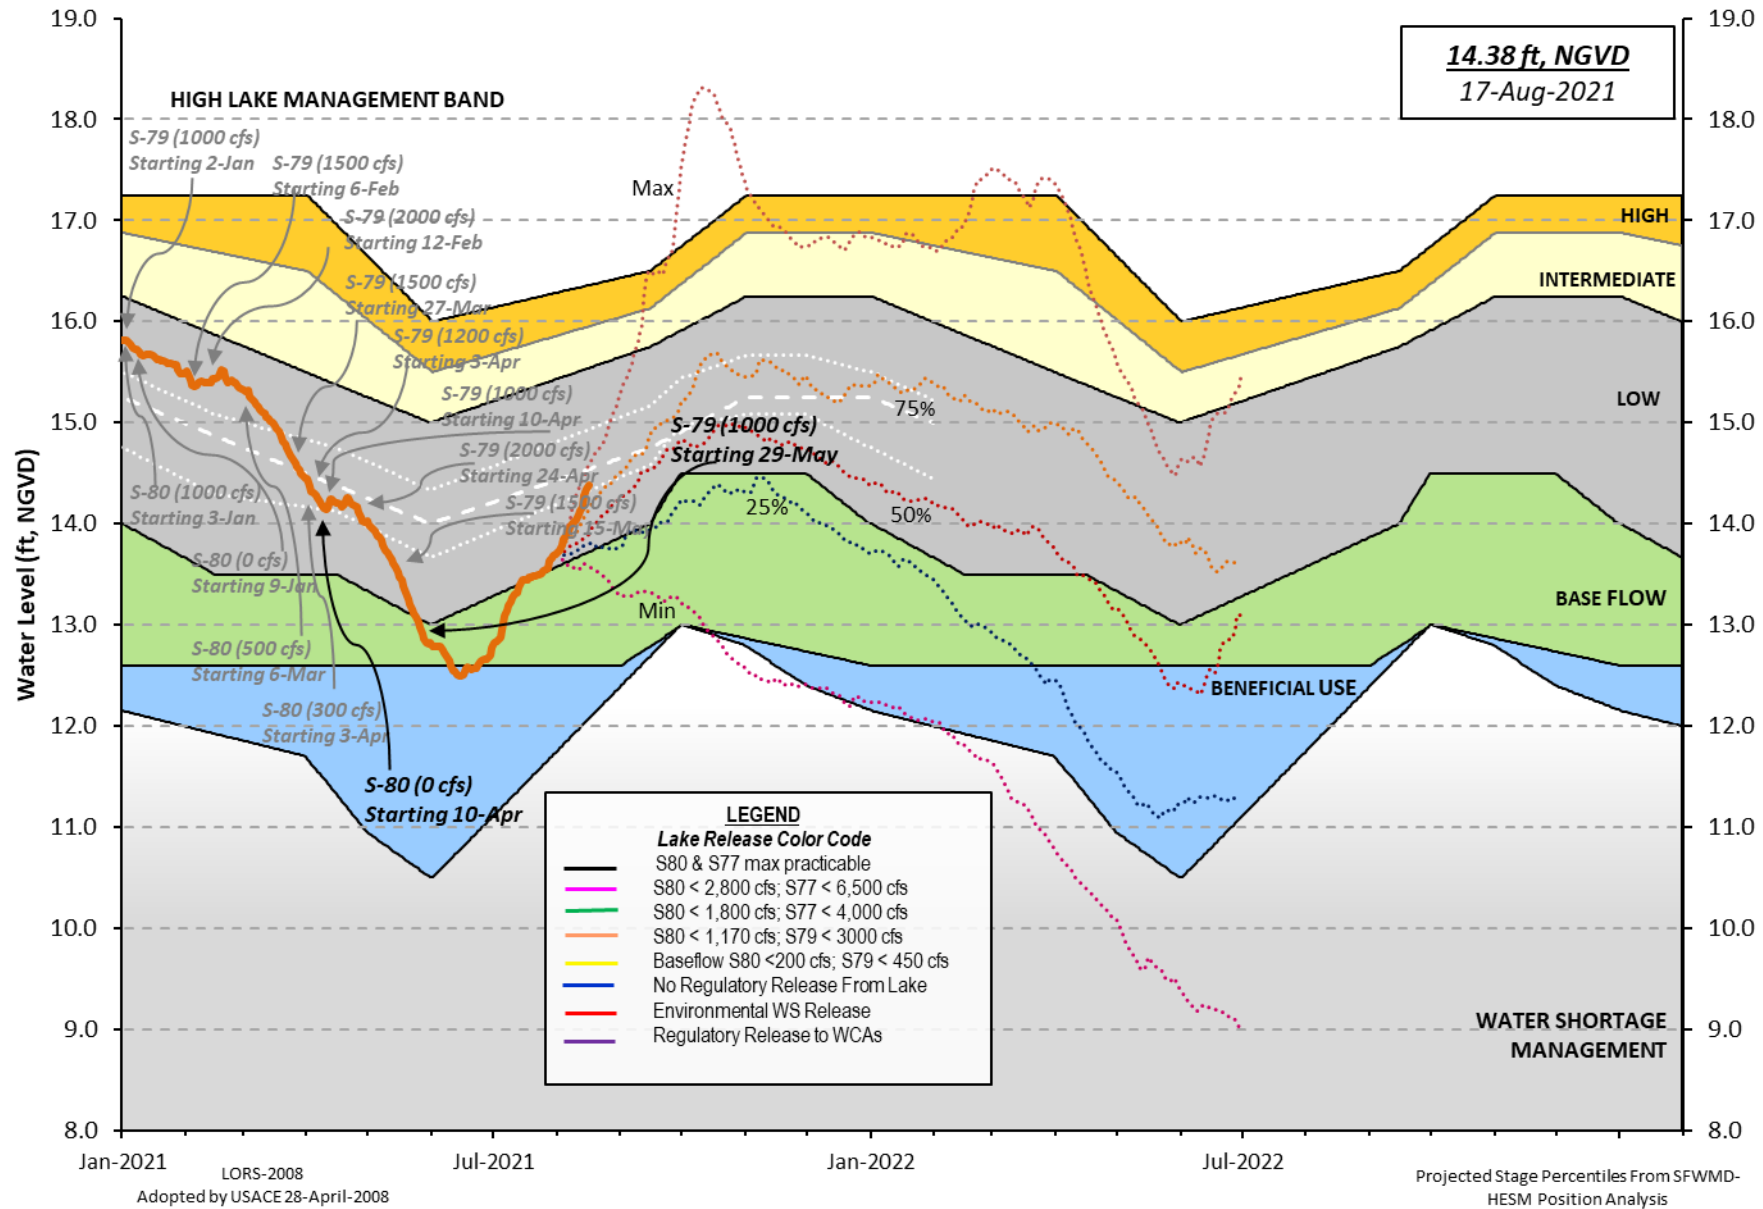

U. S. Army Corps of Engineers, Jacksonville District
Lake Okeechobee and Vicinity Report
** Preliminary Data - Subject to Revision **

Data Ending 2400 hours 15 AUG 2021

Okeechobee Lake Regulation	Elevation (ft-NGVD)	Last Year (ft-NGVD)	2YRS Ago (ft-NGVD)
*Okeechobee Lake Elevation	14.35	13.83	12.67 (Official Elv)
Bottom of High Lake Mngmt= 16.35 Top of Water Short Mngmt= 12.05			
Currently in Operational Management Band			

Simulated Average LORS2008 [1965-2000]	12.95
Difference from Average LORS2008	1.40

15AUG (1965-2007) Period of Record Average	13.98
Difference from POR Average	0.37

Today Lake Okeechobee elevation is determined from the 4 Int & 4 Edge stations

++Navigation Depth (Based on 2007 Channel Condition Survey) Route 1 ♦ 8.29'
++Navigation Depth (Based on 2008 Channel Condition Survey) Route 2 ♦ 6.49'
Bridge Clearance = 49.41'

4 Interior and 4 Edge Okeechobee Lake Average (Avg-Daily values):

L001	L005	L006	LZ40	S4	S352	S308	S133
14.37	14.45	14.32	14.31	14.37	14.40	14.29	14.26

*Combination Okeechobee Avg-Daily Lake Average = 14.35
(*See Note)

Okeechobee Inflows (cfs):

S65E	2491	S65EX1	0	Fisheating Cr	688
S154	190	S191	363	S135 Pumps	521
S84	1119	S133 Pumps	102	S2 Pumps	0
S84X	347	S127 Pumps	202	S3 Pumps	0
S71	880	S129 Pumps	63	S4 Pumps	0
S72	393	S131 Pumps	34	C5	0
Total Inflows: 7393					

Okeechobee Outflows (cfs):

S135 Culverts	0	S354	0	S77	2
S127 Culverts	0	S351	0	S308	0
S129 Culverts	0	S352	0		
S131 Culverts	0	L8 Canal Pt	-NR-		
Total Outflows: 2					

****S77 structure flow is being used to compute Total Outflow.
****S308 structure flow is being used to compute Total Outflow.

Okeechobee Pan Evaporation (inches):

S77	0.25	S308	0.03
Average Pan Evap x 0.75 Pan Coefficient = 0.11" = 0.01'			

Lake Average Precipitation using NEXRAD: = -NR-" = -NR-'

Evaporation - Precipitation: = -NR-" = -NR-'
Evaporation - Precipitation using Lake Area of 730 square miles

is equal to -NR-

Lake Okeechobee (Change in Storage) Flow is 14823 cfs or 29400 AC-FT

	Headwater Elevation (ft-msl)	Tailwater Elevation (ft-msl)	Disch (cfs)	----- Gate Positions -----							
				#1 (ft)	#2 (ft)	#3 (ft)	#4 (ft)	#5 (ft)	#6 (ft)	#7 (ft)	#8 (ft)
(I) see note at bottom											
North East Shore											
S133 Pumps:	13.26	14.31	102	0	0	119	0	0	(cfs)		
S193:											
S191:	19.45	14.30	363	0.5	0.0	0.5					
S135 Pumps:	13.28	14.25	521	135	142	129	129		(cfs)		
S135 Culverts:			0	0.0	0.0						
North West Shore											
S65E:	20.99	14.17	2491	1.6	1.3	1.5	0.9	0.9	-0.0		
S65EX1:	20.99	14.17	0								
S127 Pumps:	13.25	14.36	202	122	22	0	72	0	(cfs)		
S127 Culvert:			0	0.0							
S129 Pumps:	12.86	14.44	63	25	0	43			(cfs)		
S129 Culvert:			0	0.0							
S131 Pumps:	12.88	14.52	34	37	0				(cfs)		
S131 Culvert:			0								
Fisheating Creek											
nr Palmdale		32.60	688								
nr Lakeport											
C5:		-NR-	0	-NR-	-NR-	-NR-					
South Shore											
S4 Pumps:	11.78	14.35	0	0	0	0			(cfs)		
S169:		-NR-	-NR-	-NR-	-NR-	-NR-					
S310:	14.30		-32								
S3 Pumps:	9.64	14.31	0	0	0	0			(cfs)		
S354:	14.31	9.64	0	0.0	0.0						
S2 Pumps:	9.13	-NR-	0	-NR-	-NR-	-NR-	-NR-		(cfs)		
S351:	-NR-	9.13	0	0.0	0.0	0.0					
S352:	14.45	9.78	0	0.0	0.0						
C10A:	-NR-	14.44		8.0	8.0	8.0	0.0	0.0			
L8 Canal PT			-NR-								

S351 and S352 Temporary Pumps/S354 Spillway

S351:	9.13	-NR-	0	-NR-	-NR-	-NR-	-NR-	-NR-	-NR-
S352:	9.78	14.45	0	-NR-	-NR-	-NR-	-NR-		
S354:	9.64	14.31	0	-NR-	-NR-	-NR-	-NR-		

Caloosahatchee River (S77, S78, S79)

S47B:	14.54	12.70		0.0	0.0
S47D:	12.72	10.84	8	0.0	

S77:

Spillway and Sector Preferred Flow:

	14.33	10.75	0	0.0	0.0	0.0	0.0
--	-------	-------	---	-----	-----	-----	-----

Flow Due to Lockages+: 2

S78:

Spillway and Sector Flow:

10.76	2.93	1135	0.5	0.0	2.5	0.0
-------	------	------	-----	-----	-----	-----

Flow Due to Lockages+:	2
------------------------	---

S79:

Spillway and Sector Flow:

3.11	2.17	3320	0.0	2.0	2.0	2.0	2.0	2.0	2.0	2.0
------	------	------	-----	-----	-----	-----	-----	-----	-----	-----

Flow Due to Lockages+:	2
------------------------	---

Percent of flow from S77	0%
--------------------------	----

Chloride	(ppm)	0
----------	-------	---

St. Lucie Canal (S308, S80)

S308:

Spillway and Sector Preferred Flow:

14.31	14.09	0	0.0	0.0	0.0	0.0
-------	-------	---	-----	-----	-----	-----

Flow Due to Lockages+:	0
------------------------	---

S153:	19.07	13.75	129	0.0	0.5
-------	-------	-------	-----	-----	-----

S80:

Spillway and Sector Flow:

14.02	0.32	526	0.0	0.0	0.3	0.4	0.0	0.0	0.0
-------	------	-----	-----	-----	-----	-----	-----	-----	-----

Flow Due to Lockages+:	6
------------------------	---

Percent of flow from S308	0%
---------------------------	----

Steele Point Top Salinity	(mg/ml)	****
---------------------------	---------	------

Steele Point Bottom Salinity	(mg/ml)	****
------------------------------	---------	------

Speedy Point Top Salinity	(mg/ml)	7981
---------------------------	---------	------

Speedy Point Bottom Salinity	(mg/ml)	8243
------------------------------	---------	------

+ Flow Due to lockages is computed utilizing average daily headwater and tailwater along with total number of lockages for the day to calculate a volume which is then converted to an average discharge in cfs.

++ Preferred flow is determined from either the spillway discharge or the below flow meter daily

Daily Precipitation Totals	1-Day (inches)	3-Day (inches)	7-Day (inches)	----- Wind -----	
				Direction (Deg)	Speed (mph)
S133 Pump Station:	-NR-	0.00	0.00		
S193:	-NR-	0.00	0.00	-NR-	-NR-
Okeechobee Field Station:	-NR-	0.00	0.00		
S135 Pump Station:	-NR-	0.00	0.00		
S127 Pump Station:	-NR-	0.00	0.00		
S129 Pump Station:	-NR-	0.00	0.00		
S131 Pump Station:	-NR-	0.00	0.00		
S77:	0.04	1.61	2.24	139	5
S78:	0.00	2.00	2.00	140	1
S79:	0.00	2.11	3.48	25	7
S4 Pump Station:	-NR-	0.00	0.00		
Clewiston Field Station:	-NR-	0.00	0.00		
S3 Pump Station:	-NR-	0.00	0.00		
S2 Pump Station:	-NR-	0.00	0.00		
S308:	0.00	2.61	4.10	86	2
S80:	0.00	2.05	2.28	85	2
Okeechobee Average (Sites S78, S79 and S80 not included)	0.02	0.32	0.49		

Oke Nexrad Basin Avg	-NR-	0.00	0.00		

Okeechobee Lake Elevations	15 AUG 2021	14.35	Difference from 15AUG21
15AUG21 -1 Day =	14 AUG 2021	14.28	-0.07

15AUG21	-2 Days =	13 AUG 2021	14.17	-0.18
15AUG21	-3 Days =	12 AUG 2021	14.13	-0.22
15AUG21	-4 Days =	11 AUG 2021	14.09	-0.26
15AUG21	-5 Days =	10 AUG 2021	14.04	-0.31
15AUG21	-6 Days =	09 AUG 2021	14.01	-0.34
15AUG21	-7 Days =	08 AUG 2021	14.00	-0.35
15AUG21	-30 Days =	16 JUL 2021	13.44	-0.91
15AUG21	-1 Year =	15 AUG 2020	13.83	-0.52
15AUG21	-2 Year =	15 AUG 2019	12.67	-1.68

Long Term Mean 30day Avearge ET for Lake Alfred (Inches) = -NR-

Lake Okeechobee Net Inflow (LONIN)

Average Flow over the previous 14 days				Avg-Daily Flow
15AUG21	Today =	15 AUG 2021	10148 MON	14823
15AUG21	-1 Day =	14 AUG 2021	9333 SUN	23444
15AUG21	-2 Days =	13 AUG 2021	7856 SAT	8672
15AUG21	-3 Days =	12 AUG 2021	7514 FRI	8621
15AUG21	-4 Days =	11 AUG 2021	7340 THU	10715
15AUG21	-5 Days =	10 AUG 2021	7656 WED	6353
15AUG21	-6 Days =	09 AUG 2021	7493 TUE	-NR-
15AUG21	-7 Days =	08 AUG 2021	7130 MON	6353
15AUG21	-8 Days =	07 AUG 2021	6978 SUN	10588
15AUG21	-9 Days =	06 AUG 2021	6391 SAT	10588
15AUG21	-10 Days =	05 AUG 2021	5806 FRI	4235
15AUG21	-11 Days =	04 AUG 2021	5664 THU	12705
15AUG21	-12 Days =	03 AUG 2021	4767 WED	12705
15AUG21	-13 Days =	02 AUG 2021	4052 TUE	2118

S65E

Average Flow over previous 14 days				Avg-Daily Flow
15AUG21	Today=	15 AUG 2021	2192 MON	2703
15AUG21	-1 Day =	14 AUG 2021	2126 SUN	2762
15AUG21	-2 Days =	13 AUG 2021	2046 SAT	2316
15AUG21	-3 Days =	12 AUG 2021	1999 FRI	2714
15AUG21	-4 Days =	11 AUG 2021	1937 THU	2469
15AUG21	-5 Days =	10 AUG 2021	1888 WED	1960
15AUG21	-6 Days =	09 AUG 2021	1877 TUE	1931
15AUG21	-7 Days =	08 AUG 2021	1876 MON	1944
15AUG21	-8 Days =	07 AUG 2021	1844 SUN	1999
15AUG21	-9 Days =	06 AUG 2021	1810 SAT	2045
15AUG21	-10 Days =	05 AUG 2021	1771 FRI	2078
15AUG21	-11 Days =	04 AUG 2021	1733 THU	2147
15AUG21	-12 Days =	03 AUG 2021	1696 WED	1909
15AUG21	-13 Days =	02 AUG 2021	1674 TUE	1715

S65EX1

Average Flow over previous 14 days				Avg-Daily Flow
15AUG21	Today=	15 AUG 2021	0 MON	0
15AUG21	-1 Day =	14 AUG 2021	0 SUN	0
15AUG21	-2 Days =	13 AUG 2021	0 SAT	0
15AUG21	-3 Days =	12 AUG 2021	0 FRI	0
15AUG21	-4 Days =	11 AUG 2021	0 THU	0
15AUG21	-5 Days =	10 AUG 2021	0 WED	0
15AUG21	-6 Days =	09 AUG 2021	0 TUE	0
15AUG21	-7 Days =	08 AUG 2021	0 MON	0
15AUG21	-8 Days =	07 AUG 2021	0 SUN	0
15AUG21	-9 Days =	06 AUG 2021	0 SAT	0
15AUG21	-10 Days =	05 AUG 2021	0 FRI	0
15AUG21	-11 Days =	04 AUG 2021	0 THU	0
15AUG21	-12 Days =	03 AUG 2021	0 WED	0
15AUG21	-13 Days =	02 AUG 2021	0 TUE	0

Lake Okeechobee Outlets Last 14 Days

DATE	S-77 Discharge (ALL DAY) (AC-FT)	Below S-77 Discharge (ALL-DAY) (AC-FT)	S-78 Discharge (ALL DAY) (AC-FT)	S-79 Discharge (ALL DAY) (AC-FT)
15 AUG 2021	3	117	2231	6600
14 AUG 2021	2	48	2612	6170
13 AUG 2021	4	276	1852	4924
12 AUG 2021	5	245	1468	3696
11 AUG 2021	190	376	1012	3272
10 AUG 2021	2	403	1780	4866
09 AUG 2021	2	198	2162	6135
08 AUG 2021	8	434	2708	7141
07 AUG 2021	9	612	3243	7065
06 AUG 2021	5	376	3526	7776
05 AUG 2021	7	379	3928	7865
04 AUG 2021	7	358	3403	9253
03 AUG 2021	2	49	1401	3282
02 AUG 2021	1	171	1119	4240

DATE	S-310 Discharge (ALL DAY) (AC-FT)	S-351 Discharge (ALL DAY) (AC-FT)	S-352 Discharge (ALL DAY) (AC-FT)	S-354 Discharge (ALL DAY) (AC-FT)	L8 Canal Pt Discharge (ALL DAY) (AC-FT)
15 AUG 2021	-63	0	0	0	-NR-
14 AUG 2021	-84	0	0	0	-NR-
13 AUG 2021	-109	0	0	0	-NR-
12 AUG 2021	-84	0	0	0	-NR-
11 AUG 2021	*****	0	0	0	-NR-
10 AUG 2021	-14	0	0	0	-NR-
09 AUG 2021	-99	0	0	0	-NR-
08 AUG 2021	-129	0	0	0	-NR-
07 AUG 2021	-64	0	0	0	-NR-
06 AUG 2021	-71	0	0	0	-NR-
05 AUG 2021	-76	0	0	0	-NR-
04 AUG 2021	-36	0	0	0	-NR-
03 AUG 2021	-32	0	0	0	-NR-
02 AUG 2021	-43	0	0	0	-NR-

DATE	S-308 Discharge (ALL DAY) (AC-FT)	Below S-308 Discharge (ALL-DAY) (AC-FT)	S-80 Discharge (ALL-DAY) (AC-FT)
15 AUG 2021	0	68	1047
14 AUG 2021	-0	65	1094
13 AUG 2021	0	82	18
12 AUG 2021	0	61	33
11 AUG 2021	-0	120	15
10 AUG 2021	-0	-75	8
09 AUG 2021	-318	-170	19
08 AUG 2021	-726	-626	38
07 AUG 2021	-654	-677	31
06 AUG 2021	-650	-684	31
05 AUG 2021	-887	-986	39
04 AUG 2021	-340	-566	16
03 AUG 2021	-170	-299	19
02 AUG 2021	-445	-506	24

*** NOTE: Discharge (ALL DAY) is computed using Spillway, Sector Gate and Lockages Discharges from 0015 hrs to 2400 hrs.


(I) - Flows preceeded by "I" signify an instantaneous flow computed from the single value reported for the day

-
- * On 11 May 1999, Lake Okeechobee Elevation was switched from Instantaneous 2400 value to an average-daily lake average.
 - On 14 Mar 2001, due to the isolation of various gages within the standard 10 stations, the average of the interior 4 station gages was used as the Lake Okeechobee Elevation.
 - On 05 November 2010, Lake Okeechobee Elevation was switched to a 9 gage mix of interior and edge gages to obtain a more reliable representation of the lake level.
 - On 09 May 2011, Lake Okeechobee Elevation was switched to a 8 gage mix of interior and edge gages to obtain a more reliable representation of the lake level due to isolation of S135 from low lake levels.
 - Today Lake Okeechobee elevation is determined from the 4 Int & 4 Edge stations
 - ++ For more information see the Jacksonville District Navigation website at <http://www.saj.usace.army.mil/>
 - \$ For information regarding Lake Okeechobee Service Area water restrictions please refer to www.sfwmd.gov

Report Generated 16AUG2021 @ 16:15 ** Preliminary Data - Subject to Revision **

Lake Okeechobee

17AUG21 07:01:06

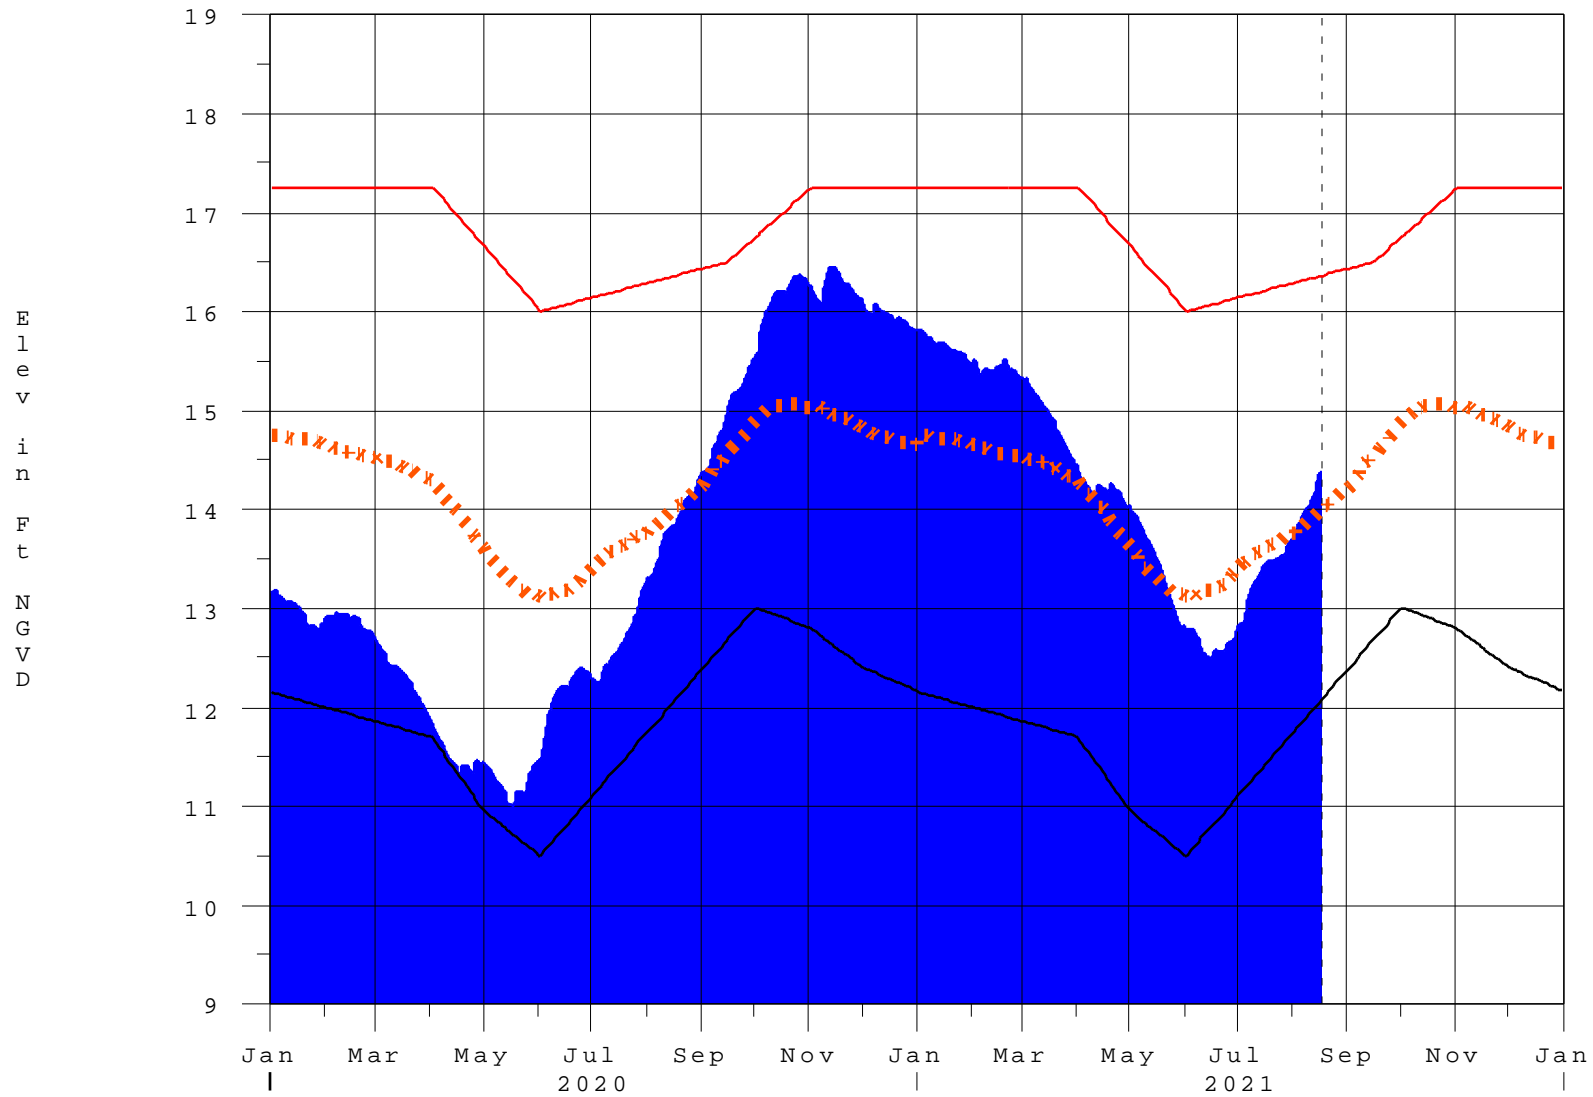

- High Lake Management
- Okeechobee Avg Elev
- Average Elev [1965-2007]
- Water Shortage Management

Classification Tables

Supplemental Tables used in conjunction with the LORS2008 Release

Guidance Flow Charts

- [Class Limits for Tributary Hydrologic Conditions](#)

Table K-2 in the Lake Okeechobee Water Control Plan

- [6-15 Day Precipitation Outlook Categories](#)

Table ?? in the Lake Okeechobee Water Control Plan

- [Classification of Lake Okeechobee Net Inflow for Seasonal Outlook](#)

Table K-3 in the Lake Okeechobee Water Control Plan

- [Classification of Lake Okeechobee Net Inflow for Multi-Seasonal Outlook](#)

Table K-4 in the Lake Okeechobee Water Control Plan

[Back to Lake Okeechobee Operations Main Page](#)

[Back to U.S. Army Corps of Engineers Lake Okeechobee Operations Homepage](#)

Tributary Hydrologic Classification*	Palmer Index Class Limits	2-wk Mean L.O. Net Inflow Class Limits
Very Wet	3.0 or greater	Greater \geq 6000 cfs
Wet	1.5 to 2.99	2500 - 5999 cfs
Near Normal	-1.49 to 1.49	500 - 2499 cfs
Dry	-2.99 to -1.5	-5000 – 500 cfs
Very Dry	-3.0 or less	Less than -5000 cfs

* use the wettest of the two indicators

Classification of Lake Okeechobee Net Inflow Seasonal Outlook*

Lake Net Inflow Prediction [million acre-feet]	Equivalent Depth** [feet]	Lake Okeechobee Net Inflow Seasonal Outlook
> 0.93	> 2.0	Very Wet
0.71 to 0.93	1.51 to 2.0	Wet
0.35 to 0.70	0.75 to 1.5	Normal
< 0.35	< 0.75	Dry

****Volume-depth conversion based on average lake surface area of 467,000 acres**

Classification of Lake Okeechobee Net Inflow Multi-Seasonal Outlook*

Lake Net Inflow Prediction [million acre-feet]	Equivalent Depth** [feet]	Lake Okeechobee Net Inflow Multi-Seasonal Outlook
> 2.0	> 4.3	Very Wet
1.18 to 2.0	2.51 to 4.3	Wet
0.5 to 1.17	1.1 to 2.5	Normal
< 0.5	< 1.1	Dry

****Volume-depth conversion based on average lake surface area of 467,000 acres**

6-15 Day Precipitation Outlook Categories*

6-15 Day Precipitation Outlook Categories	WSE Decision Tree Categories
Above Normal	Wet to Very Wet
Normal	Normal
Below Normal	Dry

*** Corresponds to Table 7-6 in the Lake Okeechobee Water Control Plan**

Under Construction