

Application of the Lake Okeechobee Regulation Schedule (LORS2008) on 12/19/2022 (ENSO Condition: La Niña)

Lake Okeechobee Net Inflow Outlook:

The Lake Okeechobee Net Inflow Outlook has been computed using methods described in the LORS2008 Water Control Plan: Croley's method, the SFWMD empirical method, a sub-sampling of La Niña years and a sub-sampling of warm years of the Atlantic Multi-decadal Oscillation (AMO) in combination with La Niña ENSO years. The results for Croley's method and the SFWMD empirical method are based on the CPC Outlook.

Table of the Lake Okeechobee Net Inflow Outlooks in feet of equivalent depth. All methods are updated on a weekly basis with observed net inflow for the current month.

Season	Croley's Method*		SFWMD Empirical Method		Sub-sampling of La Niña ENSO Years**		Sub-sampling of AMO Warm + La Niña ENSO Years***	
	Value (ft)	<u>Condition</u>	Value (ft)	<u>Condition</u>	Value (ft)	<u>Condition</u>	Value (ft)	<u>Condition</u>
Current (Dec-May)	N/A	N/A	-0.05	Dry	-0.07	Dry	-0.32	Dry
Multi Seasonal (Dec-Oct)	N/A	N/A	2.50	Wet	2.68	Wet	2.17	Normal

*Croley's Method Not Produced for This Report

See Seasonal and Multi-Seasonal tables for the classification of Lake Okeechobee Outlooks.

The recommended methods and values for estimating the Lake Okeechobee Net Inflow Outlook are shaded and should be used in the LORS2008 Release Guidance Flow Charts.

**Sub-sampling is a weighted average of ENSO conditions based on the IRI ENSO forecast published.

***Sub-sampling based on combination of ENSO and AMO conditions. For this predominant ENSO categorization is used instead of weights.

Tributary Hydrologic Conditions:

685 cfs 14-day running average for Lake Okeechobee Net Inflow through 12/19/2022. According to the classification in Tributary Hydrologic Conditions table, this condition is Near Normal.

0.61 for Palmer Drought Index on 12/17/2022.

According to the classification in Tributary Hydrologic Conditions table, this condition is Near Normal.

The wetter of the two conditions above is **Normal**.

LORS2008 Classification Tables:

Lake Okeechobee Stage on 12/19/2022:

Lake Okeechobee Stage: **16.41 feet**

Lake Okeechobee Management Zone/Band		Bottom Elevation (feet, NGVD)	Current Lake Stage
High Lake Management Band		17.25	
Operational Band	High sub-band	16.88	
	Intermediate sub-band	16.25	← 16.41 ft
	Low sub-band	14.21	
Base Flow sub-band		12.66	
Beneficial Use sub-band		12.26	
Water Shortage Management Band			

Part C of LORS2008: Discharge to WCAs

Maximum practicable to WCAs if “All downstream WCAs < max. of upper schedule + 0.25 ft”. Currently, all WCAs have the potential to receive regulatory releases from Lake Okeechobee.

Part D of LORS2008: Discharge to Tide


Up to 4000 cfs at S-77 and up to 1800 cfs at S-80.

LORS2008 Implementation on 12/19/2022 (ENSO Condition- La Niña Watch):**Status for week ending 12/19/2022:****Water Supply Risk Evaluation**

Area	Indicator	Value	Color Coded Scoring Scheme
LOK	Projected LOK Stage for the next two months	Intermediate Sub-band	L
	Palmer Drought Index for LOK Tributary Conditions	0.61 (Normal to Extremely Wet)	L
	CPC Precipitation Outlook	1 month: Below Normal	M
		3 months: Below Normal	M
	LOK Seasonal Net Inflow Outlook	-0.07 ft	H
	ENSO Forecast	Extremely Dry	
	LOK Multi-Seasonal Net Inflow Outlook	2.68 ft	M
	ENSO Forecast	Normal	
WCAs	WCA 1: 3 Station Average (Sites 1-7, 1-8T, 1-9)	Above Line 1 (17.34 ft)	L
	WCA 2A: Site 2-17	Above Line 1 (12.76 ft)	L
	WCA-3A: 3 Station Average (Sites 63, 64, and 65)	Above Line 1 (10.35 ft)	L
LEC	Service Area 1	Year-Round Irrigation Rule in effect	L
	Service Area 2	Year-Round Irrigation Rule in effect	L
	Service Area 3	Year-Round Irrigation Rule in effect	L



Note: The water supply risk classification based on the Palmer index, as well as the LOK seasonal and multi-seasonal net inflow outlooks use slightly different classification intervals than those used by the 2008-LORS.

Lake Okeechobee SFWMM December 2022 Position Analysis

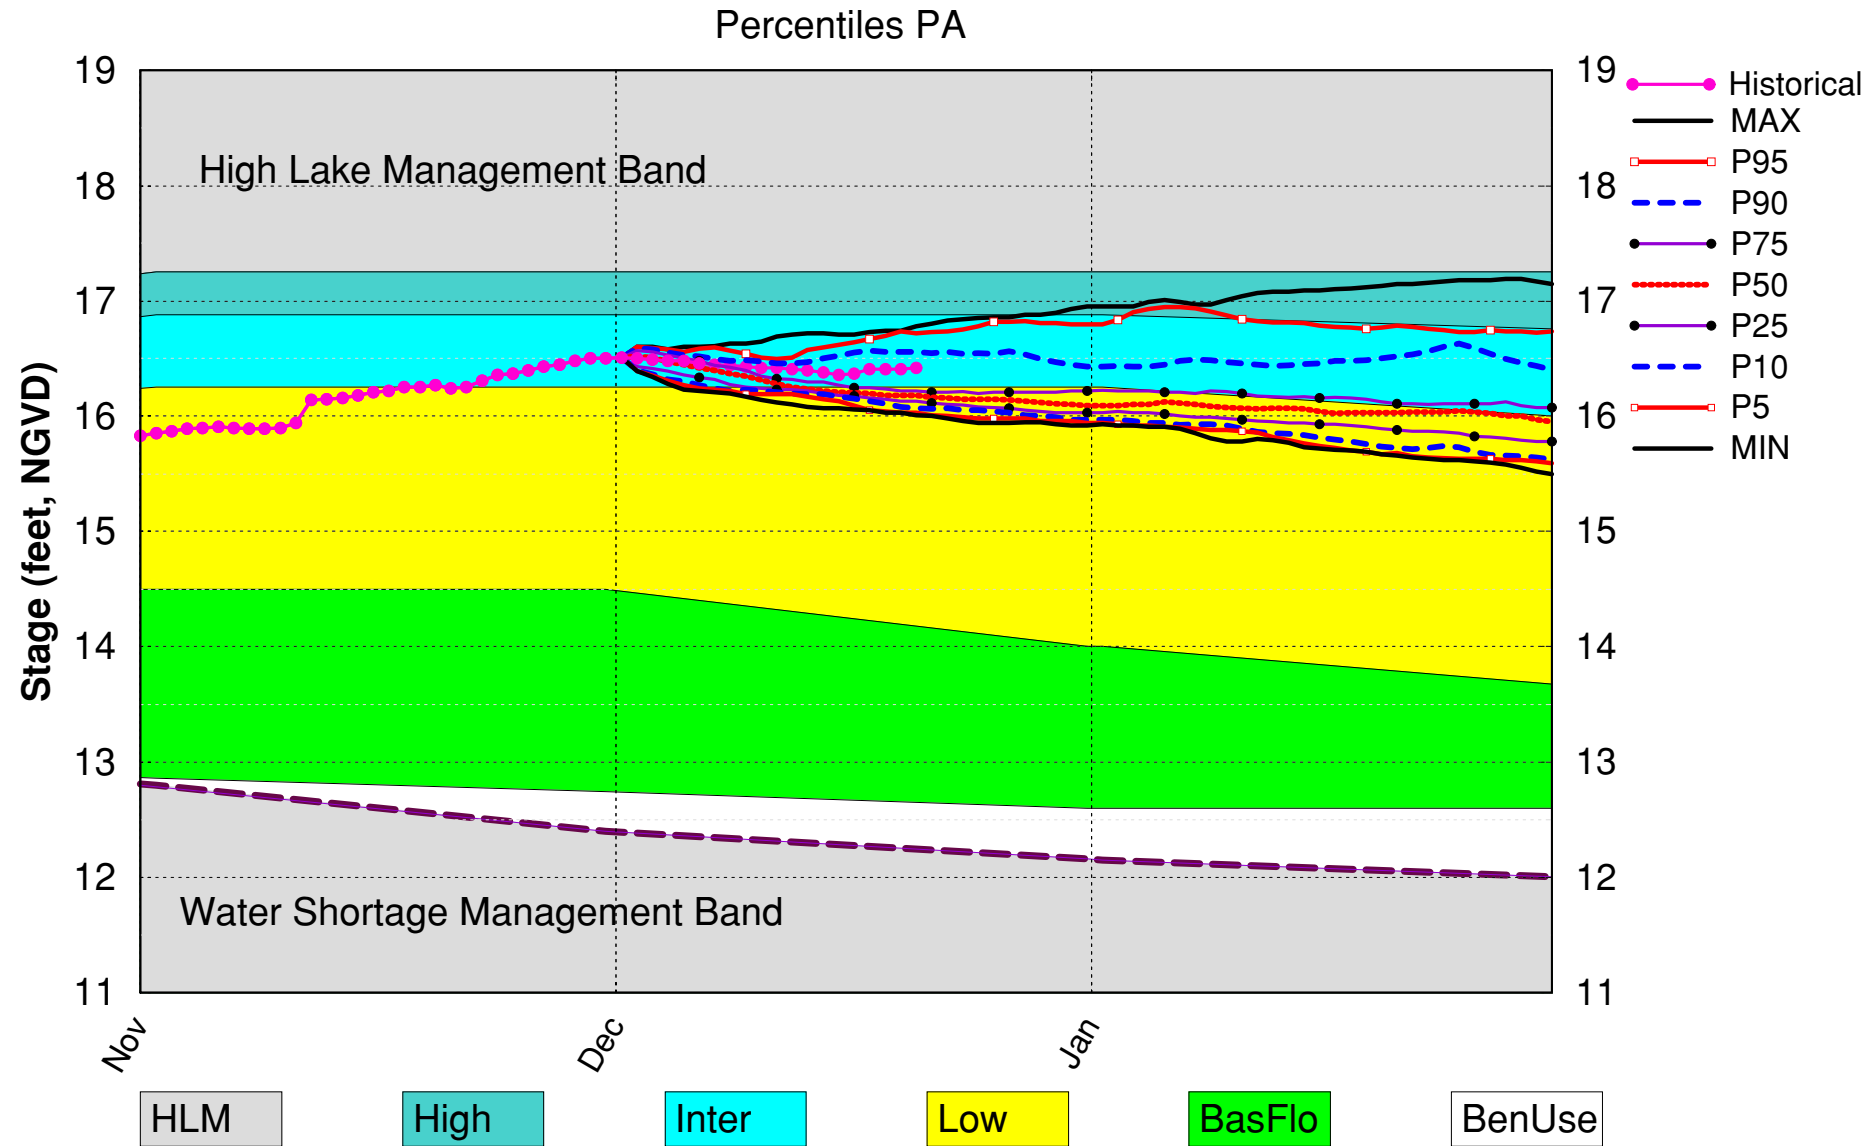

(See assumptions on the Position Analysis Results website)

Tributary Basin Condition Indicators as of December 18 2022

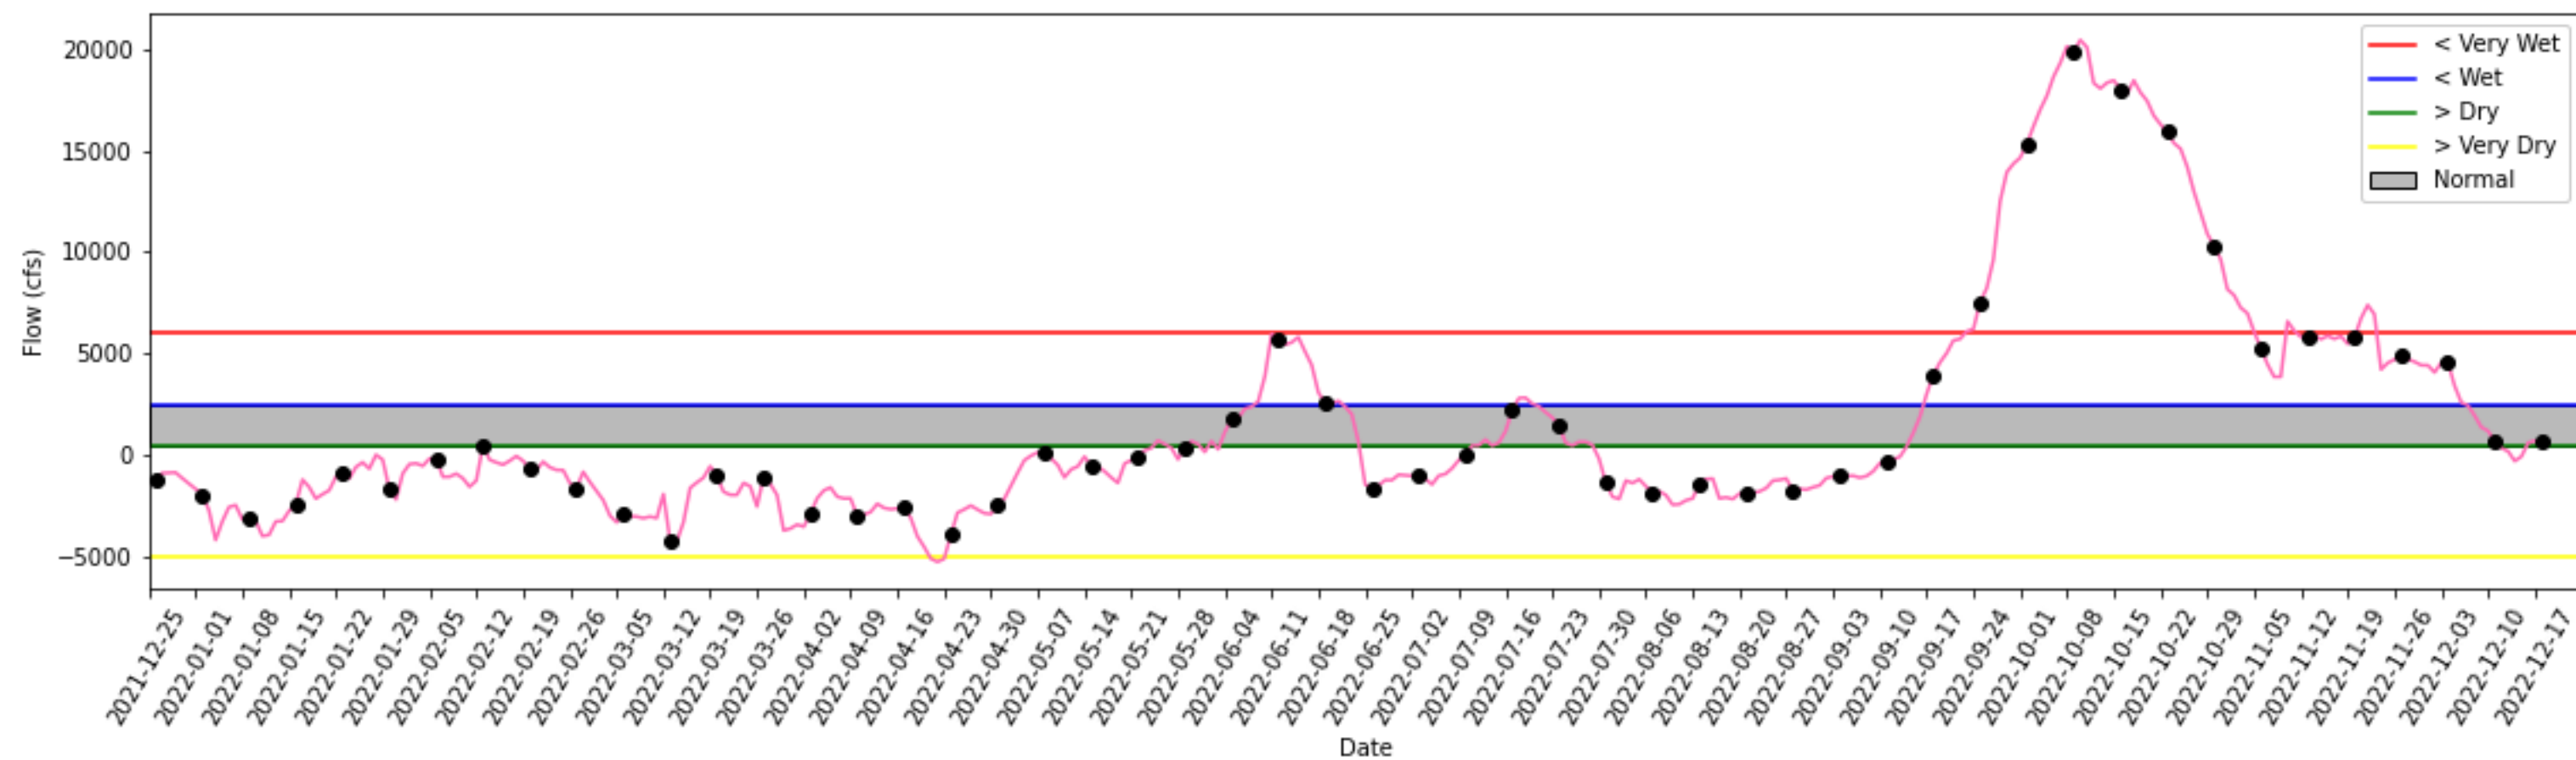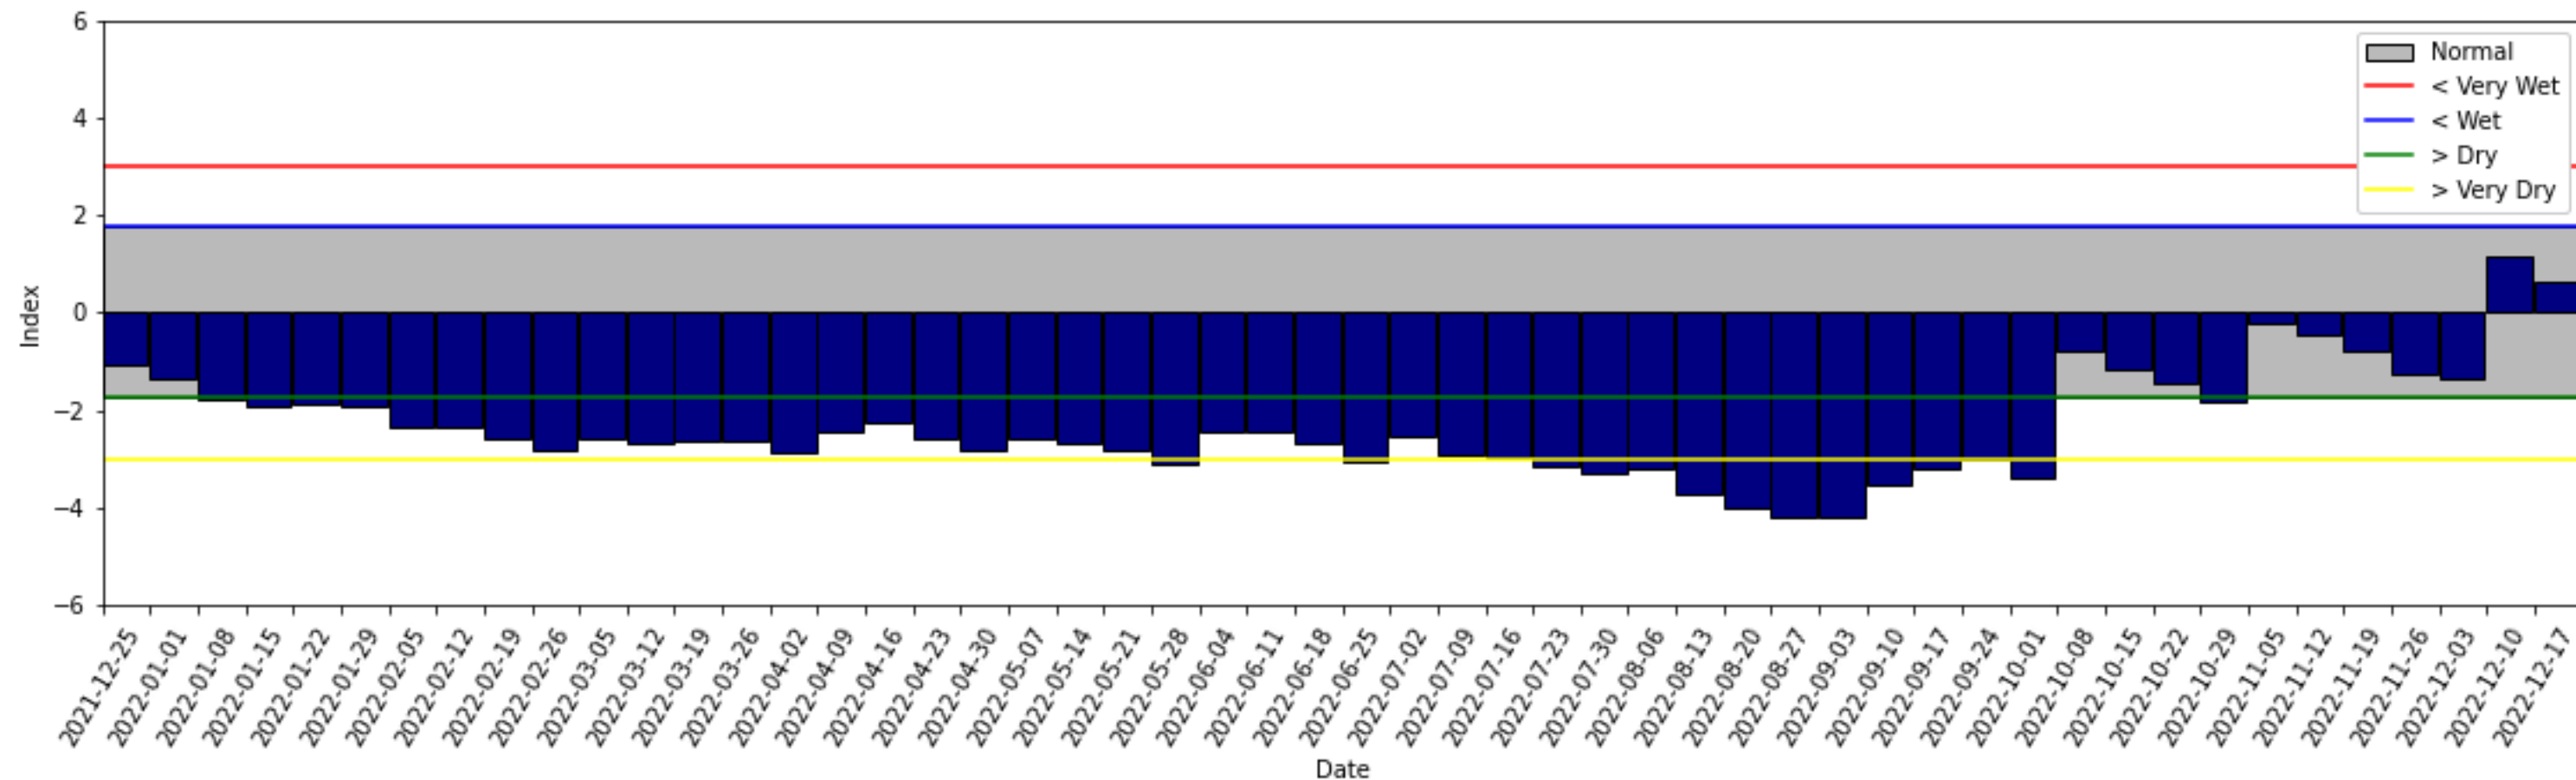

2008 LORS

Part C: Establish Allowable Lake Okeechobee Releases to the Water Conservation Areas

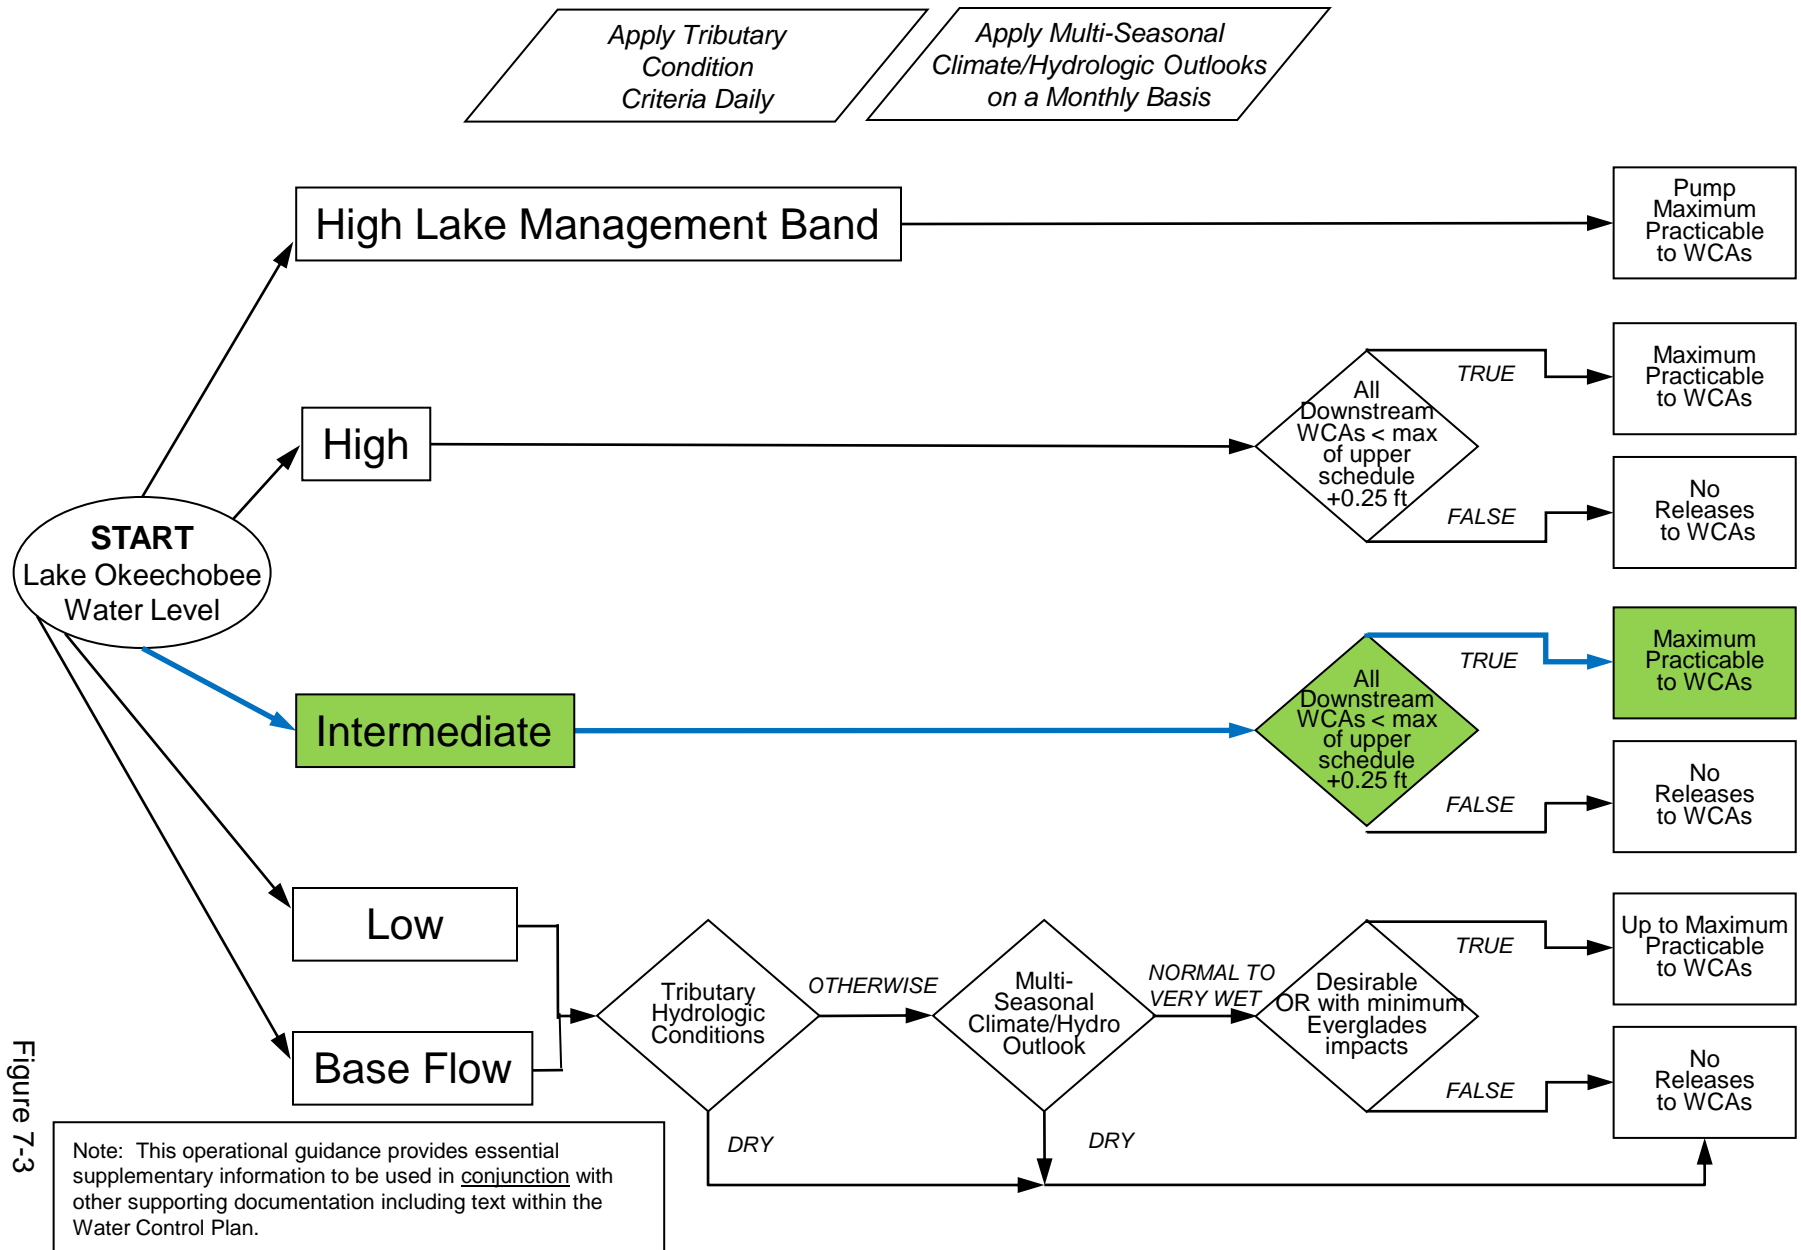


Figure 7-3


2008 LORS

Part D: Establish Allowable Lake Okeechobee Releases to Tide (Estuaries)


Note: This operational guidance provides essential supplementary information to be used in conjunction with other supporting documentation including text within the Water Control Plan.

When conducting Base Flow releases, flows can be distributed East and West up to 650 cfs as needed to minimize impacts or provide benefits through S-80 and S-79

Apply Meteorological Forecasts on a Weekly Basis; apply Seasonal and Multi-Seasonal Climate/Hydrologic Outlooks on a Monthly Basis

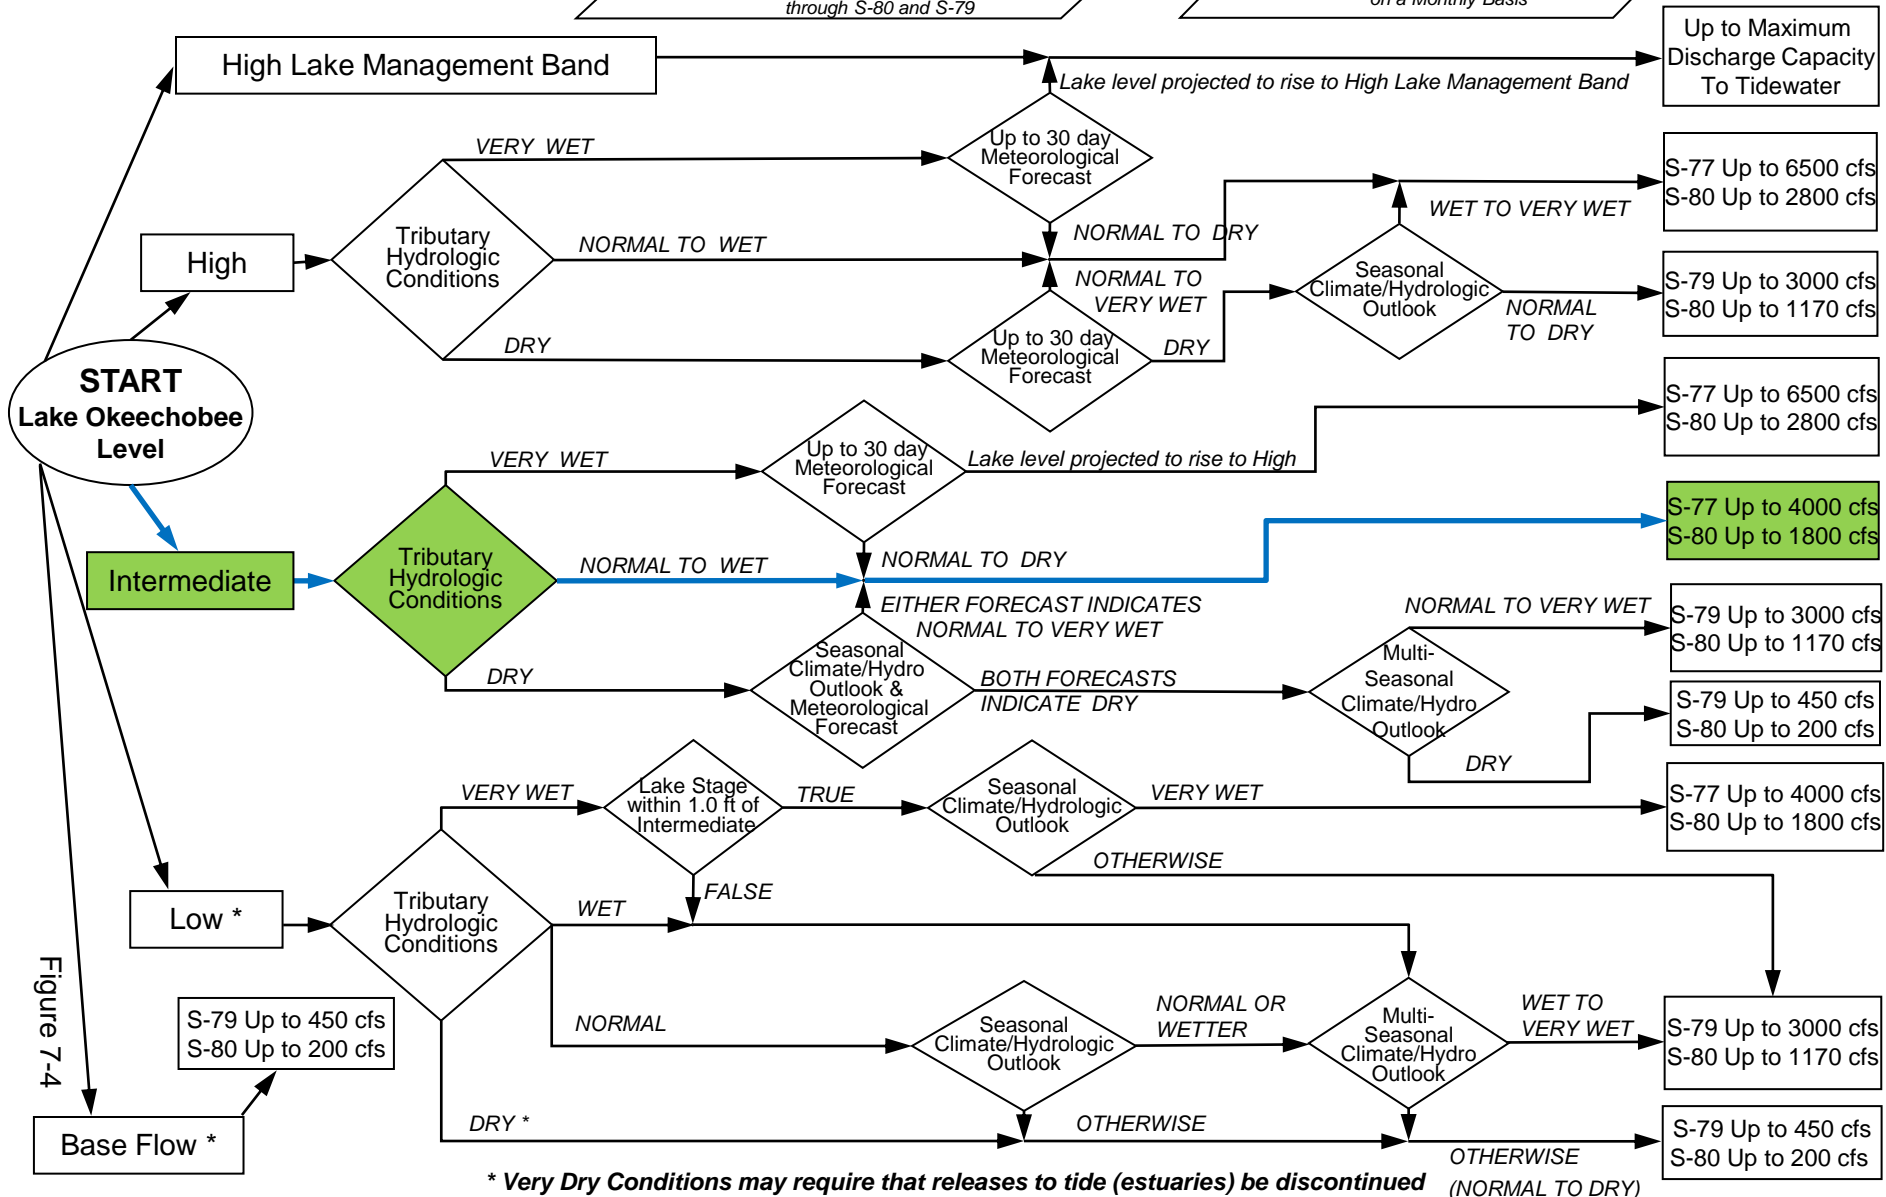

Lake Okeechobee Water Level History and Projected Stages

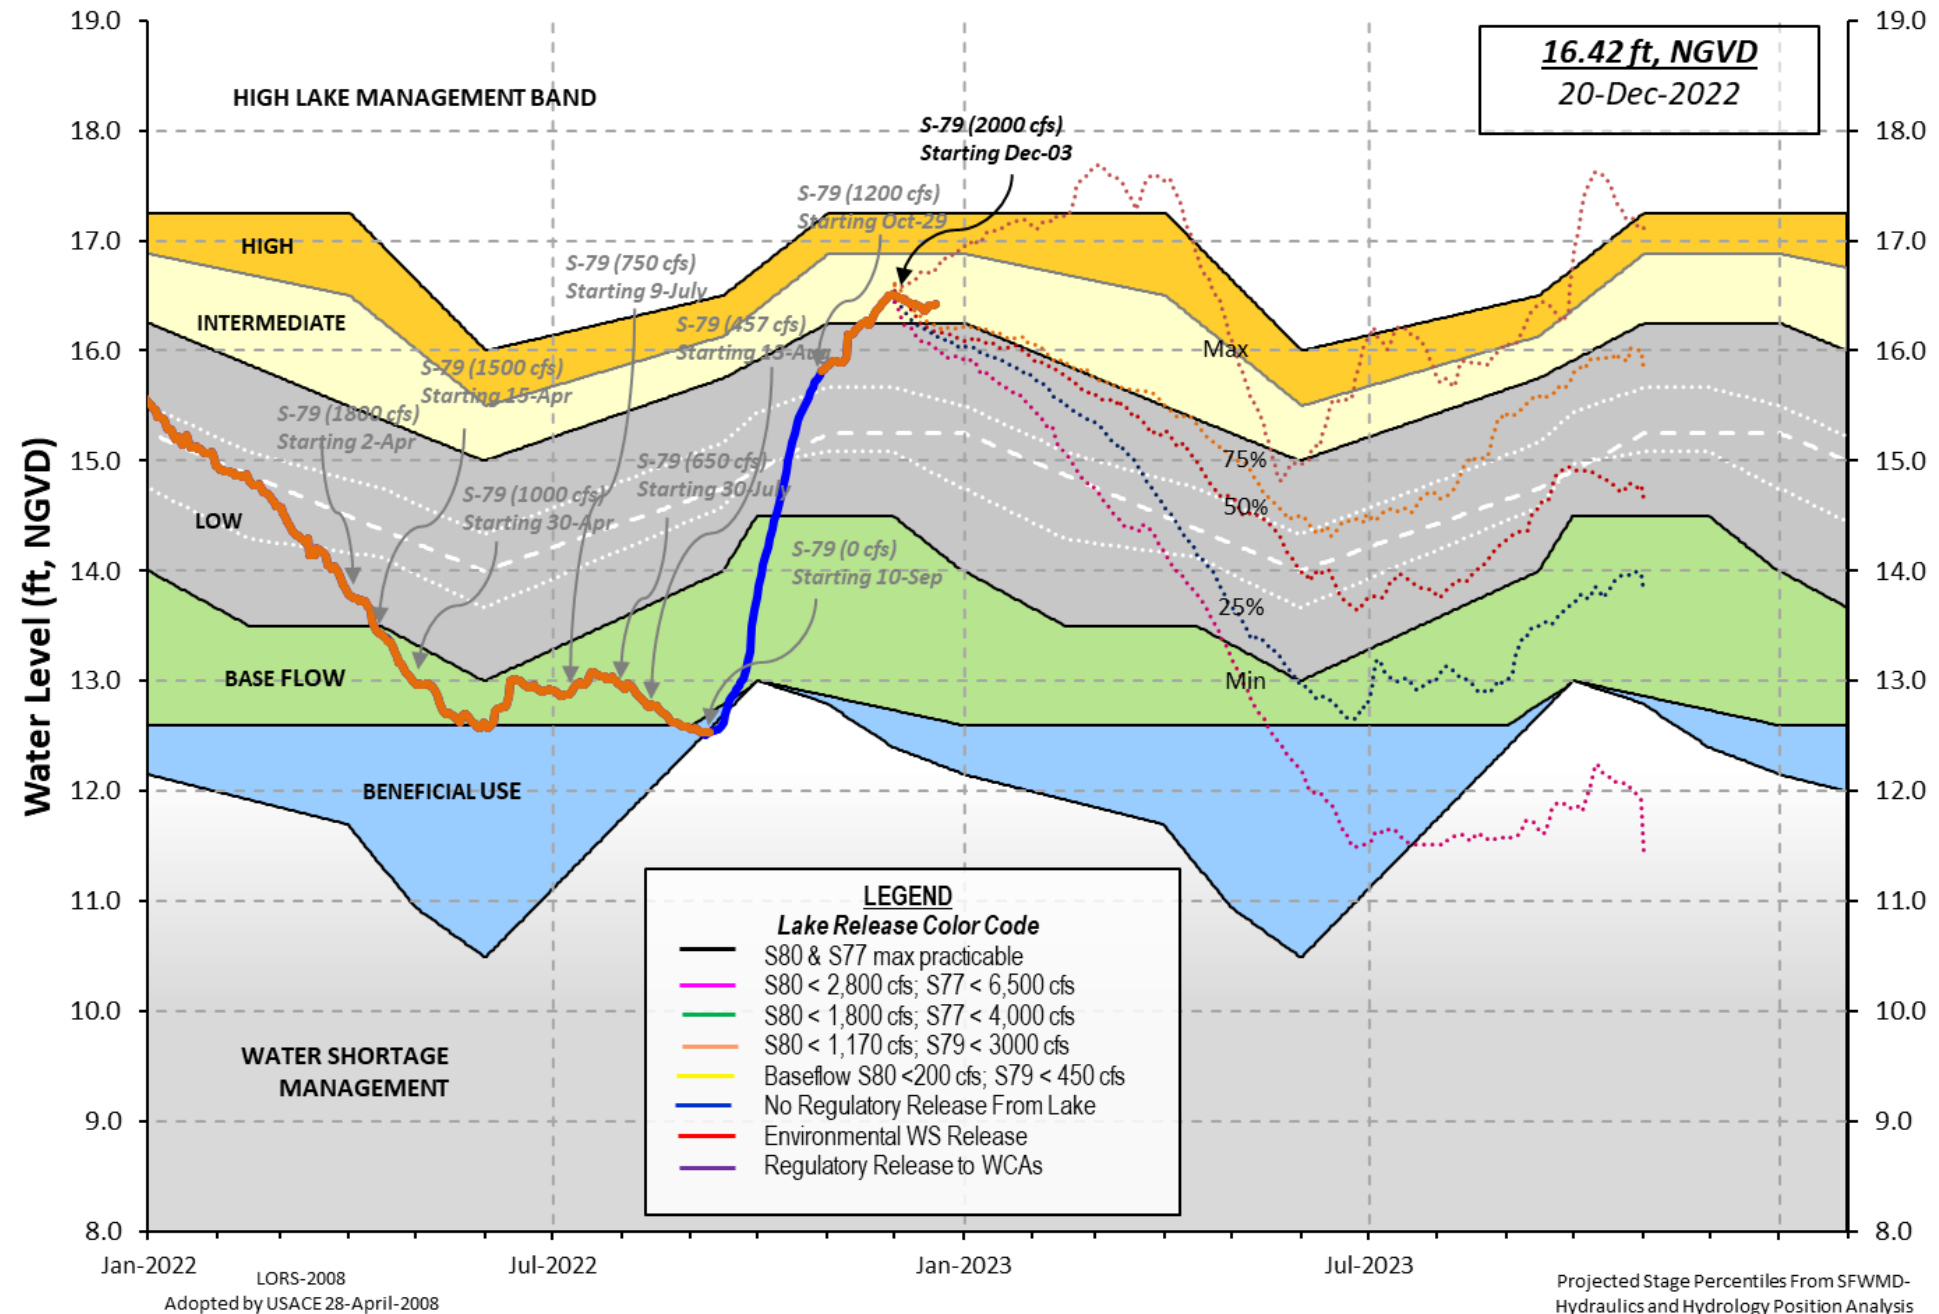

U. S. Army Corps of Engineers, Jacksonville District
Lake Okeechobee and Vicinity Report
** Preliminary Data - Subject to Revision **

Data Ending 2400 hours 18 DEC 2022

Okeechobee Lake Regulation	Elevation (ft-NGVD)	Last Year (ft-NGVD)	2YRS Ago (ft-NGVD)
*Okeechobee Lake Elevation	16.41	15.73	15.92 (Official Elv)

Bottom of High Lake Mngmt= 17.25 Top of Water Short Mngmt= 12.26
Currently in Operational Management Band

Simulated Average LORS2008 [1965-2000] 13.61
Difference from Average LORS2008 2.80

18DEC (1965-2007) Period of Record Average 14.70
Difference from POR Average 1.71

Today Lake Okeechobee elevation is determined from the 4 Int & 4 Edge stations

++Navigation Depth (Based on 2007 Channel Condition Survey) Route 1 ♦ 10.35'
++Navigation Depth (Based on 2008 Channel Condition Survey) Route 2 ♦ 8.55'
Bridge Clearance = 49.35'

4 Interior and 4 Edge Okeechobee Lake Average (Avg-Daily values):

L001	L005	L006	LZ40	S4	S352	S308	S133
16.37	16.48	16.55	16.43	16.57	16.61	16.02	16.23

*Combination Okeechobee Avg-Daily Lake Average = 16.41
(*See Note)

Okeechobee Inflows (cfs):

S65E	1626	S65EX1	0	Fisheating Cr	122
S154	0	S191	0	S135 Pumps	0
S84	0	S133 Pumps	0	S2 Pumps	0
S84X	0	S127 Pumps	0	S3 Pumps	0
S71	158	S129 Pumps	0	S4 Pumps	0
S72	194	S131 Pumps	0	C5	0
Total Inflows:	2100				

Okeechobee Outflows (cfs):

S135 Culverts	0	S354	0	S77	1869
S127 Culverts	0	S351	0	S308	2
S129 Culverts	0	S352	0		
S131 Culverts	0	L8 Canal Pt	-2		
Total Outflows:	1869				

****S77 structure flow is being used to compute Total Outflow.
****S308 structure flow is being used to compute Total Outflow.

Okeechobee Pan Evaporation (inches):

S77	0.14	S308	0.20
-----	------	------	------

Average Pan Evap x 0.75 Pan Coefficient = 0.13" = 0.01'

Lake Average Precipitation using NEXRAD: = -NR-" = -NR-'

Evaporation - Precipitation: = -NR-" = -NR-'

Evaporation - Precipitation using Lake Area of 730 square miles

is equal to -NR-
Lake Okeechobee (Change in Storage) Flow is 0 cfs or 0 AC-FT

	Headwater Elevation (ft-msl)	Tailwater Elevation (ft-msl)	Disch (cfs)	----- Gate Positions -----							
				#1 (ft)	#2 (ft)	#3 (ft)	#4 (ft)	#5 (ft)	#6 (ft)	#7 (ft)	#8 (ft)

(I) see note at bottom

North East Shore

S133 Pumps:	13.57	16.15	0	0	0	0	0	0	0	(cfs)
S193:										
S191:	19.07	16.14	0	0.0	0.0	0.0				
S135 Pumps:	13.51	16.19	0	0	0	0	0			(cfs)
S135 Culverts:			0	0.0	0.0					

North West Shore

S65E:	20.89	16.10	1626	0.5	0.5	1.2	0.5	1.2	0.9	
S65EX1:	20.89	16.10	0							
S127 Pumps:	13.49	16.14	0	0	0	0	0	0	(cfs)	
S127 Culvert:			0	0.0						
S129 Pumps:	12.95	16.37	0	0	0	0			(cfs)	
S129 Culvert:			0	0.0						
S131 Pumps:	12.90	16.33	0	0	0				(cfs)	
S131 Culvert:			0							

Fisheating Creek
nr Palmdale
nr Lakeport

		31.02	122						
C5:		-NR-	0	-NR-	-NR-	-NR-			

South Shore

S4 Pumps:	11.37	-NR-	0	0	0	0			(cfs)
S169:		-NR-	-NR-	-NR-	-NR-	-NR-			
S310:	16.75		3						
S3 Pumps:	9.41	16.81	0	0	0	0			(cfs)
S354:	16.81	9.41	0	0.1	0.0				
S2 Pumps:	9.77	16.83	0	0	0	0	0		(cfs)
S351:	16.83	9.77	0	0.0	0.0	0.0			
S352:	16.62	9.84	0	0.1	0.0				
C10A:	-NR-	-NR-		-NR-	-NR-	-NR-	-NR-	-NR-	
L8 Canal PT		14.57	-2						

S351 and S352 Temporary Pumps/S354 Spillway

S351:	9.77	16.83	0	-NR-	-NR-	-NR-	-NR-	-NR-	
S352:	9.84	16.62	0	-NR-	-NR-	-NR-	-NR-		
S354:	9.41	16.81	0	-NR-	-NR-	-NR-	-NR-		

Caloosahatchee River (S77, S78, S79)

S47B:	14.22	12.45		0.0	0.5			
S47D:	12.42	11.30	40	1.0				
S77:								
Spillway and Sector Preferred Flow:	16.35	11.18	1867	0.0	2.5	2.5	0.5	
Flow Due to Lockages+:			2					

S78:

Spillway and Sector Flow:
11.14 2.87 1817 2.0 0.0 2.5 1.0
Flow Due to Lockages+: 4

S79:

Spillway and Sector Flow:
3.03 1.82 3084 0.0 0.0 0.0 3.0 3.0 3.0 2.5 0.0
Flow Due to Lockages+: 5
Percent of flow from S77 61%
Chloride (ppm) 0

St. Lucie Canal (S308, S80)

S308:

Spillway and Sector Preferred Flow:
16.24 14.15 0 0.0 0.0 0.0 0.0
Flow Due to Lockages+: 2

S153: 18.85 14.25 23 0.0 0.5

S80:

Spillway and Sector Flow:
14.51 0.83 0 0.0 0.0 0.0 0.0 0.0 0.0 0.0
Flow Due to Lockages+: 15
Percent of flow from S308 NA %

Steele Point Top Salinity (mg/ml) ****
Steele Point Bottom Salinity (mg/ml) ****

Speedy Point Top Salinity (mg/ml) ****
Speedy Point Bottom Salinity (mg/ml) ****

+ Flow Due to lockages is computed utilizing average daily headwater and tailwater along with total number of lockages for the day to calculate a volume which is then converted to an average discharge in cfs.

++ Preferred flow is determined from either the spillway discharge or the below flow meter daily

Daily Precipitation Totals	1-Day (inches)	3-Day (inches)	7-Day (inches)	----- Wind -----	
				Direction (Deg \diamond)	Speed (mph)
S133 Pump Station:	-NR-	0.00	0.00		
S193:	-NR-	0.00	0.00	-NR-	-NR-
Okeechobee Field Station:	-NR-	0.00	0.00		
S135 Pump Station:	-NR-	0.00	0.00		
S127 Pump Station:	-NR-	0.00	0.00		
S129 Pump Station:	-NR-	0.00	0.00		
S131 Pump Station:	-NR-	0.00	0.00		
S77:	-NR-	0.00	0.00	27	12
S78:	-NR-	0.00	0.00	334	3
S79:	-NR-	0.00	0.00	1	2
S4 Pump Station:	-NR-	0.00	0.00		
Clewiston Field Station:	-NR-	0.00	0.00		
S3 Pump Station:	-NR-	0.00	0.00		
S2 Pump Station:	-NR-	0.00	0.00		
S308:	-NR-	0.00	0.00	352	4
S80:	-NR-	0.00	0.00	22	4
Okeechobee Average (Sites S78, S79 and S80 not included)	-NR-	0.00	0.00		

Oke Nexrad Basin Avg	-NR-	0.00	0.00		

Okeechobee Lake Elevations	18 DEC 2022	16.41	Difference from 18DEC22
18DEC22 -1 Day =	17 DEC 2022	16.41	0.00

18DEC22	-2 Days =	16 DEC 2022	16.41	0.00
18DEC22	-3 Days =	15 DEC 2022	16.37	-0.04
18DEC22	-4 Days =	14 DEC 2022	16.36	-0.05
18DEC22	-5 Days =	13 DEC 2022	16.38	-0.03
18DEC22	-6 Days =	12 DEC 2022	16.40	-0.01
18DEC22	-7 Days =	11 DEC 2022	16.41	0.00
18DEC22	-30 Days =	18 NOV 2022	16.27	-0.14
18DEC22	-1 Year =	18 DEC 2021	15.73	-0.68
18DEC22	-2 Year =	18 DEC 2020	15.92	-0.49

Long Term Mean 30day Avearge ET for Lake Alfred (Inches) = -NR-

Lake Okeechobee Net Inflow (LONIN)					
Average Flow over the previous 14 days				Avg-Daily Flow	
18DEC22	Today =	18 DEC 2022	687 MON	1867	
18DEC22	-1 Day =	17 DEC 2022	721 SUN	1304	
18DEC22	-2 Days =	16 DEC 2022	622 SAT	9100	
18DEC22	-3 Days =	15 DEC 2022	-50 FRI	3062	
18DEC22	-4 Days =	14 DEC 2022	-274 THU	-2259	
18DEC22	-5 Days =	13 DEC 2022	206 WED	-1784	
18DEC22	-6 Days =	12 DEC 2022	370 TUE	482	
18DEC22	-7 Days =	11 DEC 2022	680 MON	-597	
18DEC22	-8 Days =	10 DEC 2022	1211 SUN	2067	
18DEC22	-9 Days =	09 DEC 2022	1390 SAT	-1193	
18DEC22	-10 Days =	08 DEC 2022	1963 FRI	-147	
18DEC22	-11 Days =	07 DEC 2022	2461 THU	226	
18DEC22	-12 Days =	06 DEC 2022	2609 WED	-162	
18DEC22	-13 Days =	05 DEC 2022	3432 TUE	-2352	

S65E					
Average Flow over previous 14 days				Avg-Daily Flow	
18DEC22	Today=	18 DEC 2022	1798 MON	1767	
18DEC22	-1 Day =	17 DEC 2022	1829 SUN	1659	
18DEC22	-2 Days =	16 DEC 2022	1871 SAT	1785	
18DEC22	-3 Days =	15 DEC 2022	1913 FRI	1680	
18DEC22	-4 Days =	14 DEC 2022	1987 THU	1675	
18DEC22	-5 Days =	13 DEC 2022	2068 WED	1704	
18DEC22	-6 Days =	12 DEC 2022	2157 TUE	1707	
18DEC22	-7 Days =	11 DEC 2022	2260 MON	1750	
18DEC22	-8 Days =	10 DEC 2022	2381 SUN	1735	
18DEC22	-9 Days =	09 DEC 2022	2519 SAT	1783	
18DEC22	-10 Days =	08 DEC 2022	2645 FRI	1755	
18DEC22	-11 Days =	07 DEC 2022	2763 THU	1940	
18DEC22	-12 Days =	06 DEC 2022	2849 WED	2058	
18DEC22	-13 Days =	05 DEC 2022	2926 TUE	2167	

S65EX1					
Average Flow over previous 14 days				Avg-Daily Flow	
18DEC22	Today=	18 DEC 2022	0 MON	0	
18DEC22	-1 Day =	17 DEC 2022	0 SUN	0	
18DEC22	-2 Days =	16 DEC 2022	0 SAT	0	
18DEC22	-3 Days =	15 DEC 2022	0 FRI	0	
18DEC22	-4 Days =	14 DEC 2022	0 THU	0	
18DEC22	-5 Days =	13 DEC 2022	0 WED	0	
18DEC22	-6 Days =	12 DEC 2022	3 TUE	0	
18DEC22	-7 Days =	11 DEC 2022	14 MON	0	
18DEC22	-8 Days =	10 DEC 2022	26 SUN	0	
18DEC22	-9 Days =	09 DEC 2022	38 SAT	0	
18DEC22	-10 Days =	08 DEC 2022	50 FRI	0	
18DEC22	-11 Days =	07 DEC 2022	62 THU	0	
18DEC22	-12 Days =	06 DEC 2022	73 WED	0	
18DEC22	-13 Days =	05 DEC 2022	85 TUE	0	

Lake Okeechobee Outlets Last 14 Days

		S-77	Below S-77	S-78	S-79
		Discharge	Discharge	Discharge	Discharge
		(ALL DAY)	(ALL-DAY)	(ALL DAY)	(ALL DAY)
DATE		(AC-FT)	(AC-FT)	(AC-FT)	(AC-FT)
18 DEC 2022		3699	4320	3613	6153
17 DEC 2022		2638	2915	3241	4639
16 DEC 2022		15	-NR-	1387	-NR-
15 DEC 2022		1333	-NR-	1286	-NR-
14 DEC 2022		4091	3242	2391	2939
13 DEC 2022		4073	3530	2954	3825
12 DEC 2022		4075	3410	3081	4319
11 DEC 2022		1312	1559	1706	2656
10 DEC 2022		990	1382	656	1592
09 DEC 2022		757	1227	1508	1701
08 DEC 2022		2347	2717	1825	2865
07 DEC 2022		2893	3271	2551	3491
06 DEC 2022		2717	2808	2556	3648
05 DEC 2022		3498	3807	3146	4680

		S-310	S-351	S-352	S-354	L8 Canal Pt
		Discharge	Discharge	Discharge	Discharge	Discharge
		(ALL DAY)	(ALL DAY)	(ALL DAY)	(ALL DAY)	(ALL DAY)
DATE		(AC-FT)	(AC-FT)	(AC-FT)	(AC-FT)	(AC-FT)
18 DEC 2022		6	0	0	0	-4
17 DEC 2022		9	0	0	0	-2
16 DEC 2022		-NR-	0	49	0	-NR-
15 DEC 2022		-NR-	0	154	60	-NR-
14 DEC 2022		7	0	152	283	13
13 DEC 2022		5	678	157	514	48
12 DEC 2022		8	885	197	241	102
11 DEC 2022		3	1036	737	249	67
10 DEC 2022		7	1525	759	832	13
09 DEC 2022		9	594	407	238	96
08 DEC 2022		7	737	605	331	201
07 DEC 2022		7	892	493	459	224
06 DEC 2022		15	610	303	492	17
05 DEC 2022		11	291	248	106	211

		S-308	Below S-308	S-80
		Discharge	Discharge	Discharge
		(ALL DAY)	(ALL-DAY)	(ALL-DAY)
DATE		(AC-FT)	(AC-FT)	(AC-FT)
18 DEC 2022		3	-NR-	30
17 DEC 2022		12	-NR-	44
16 DEC 2022		7	-NR-	44
15 DEC 2022		10	-NR-	629
14 DEC 2022		6	-NR-	514
13 DEC 2022		8	-NR-	44
12 DEC 2022		7	-NR-	26
11 DEC 2022		8	-NR-	-NR-
10 DEC 2022		10	-NR-	34
09 DEC 2022		10	-NR-	50
08 DEC 2022		9	-NR-	31
07 DEC 2022		11	-NR-	53
06 DEC 2022		16	-NR-	42
05 DEC 2022		7	-NR-	41

*** NOTE: Discharge (ALL DAY) is computed using Spillway, Sector Gate and Lockages Discharges from 0015 hrs to 2400 hrs.

(I) - Flows preceeded by "I" signify an instantaneous flow computed from the single value reported for the day

* On 11 May 1999, Lake Okeechobee Elevation was switched from Instantaneous 2400 value to an average-daily lake average.
On 14 Mar 2001, due to the isolation of various gages within the standard 10 stations, the average of the interior 4 station gages was used as the Lake Okeechobee Elevation.
On 05 November 2010, Lake Okeechobee Elevation was switched to a 9 gage mix of interior and edge gages to obtain a more reliable representation of the lake level.
On 09 May 2011, Lake Okeechobee Elevation was switched to a 8 gage mix of interior and edge gages to obtain a more reliable representation of the lake level due to isolation of S135 from low lake levels.
Today Lake Okeechobee elevation is determined from the 4 Int & 4 Edge stations


++ For more information see the Jacksonville District Navigation website at <http://www.saj.usace.army.mil/>

\$ For information regarding Lake Okeechobee Service Area water restrictions please refer to www.sfwmd.gov

Report Generated 19DEC2022 @ 13:15 ** Preliminary Data - Subject to Revision **

Lake Okeechobee

19DEC22 13:45:22

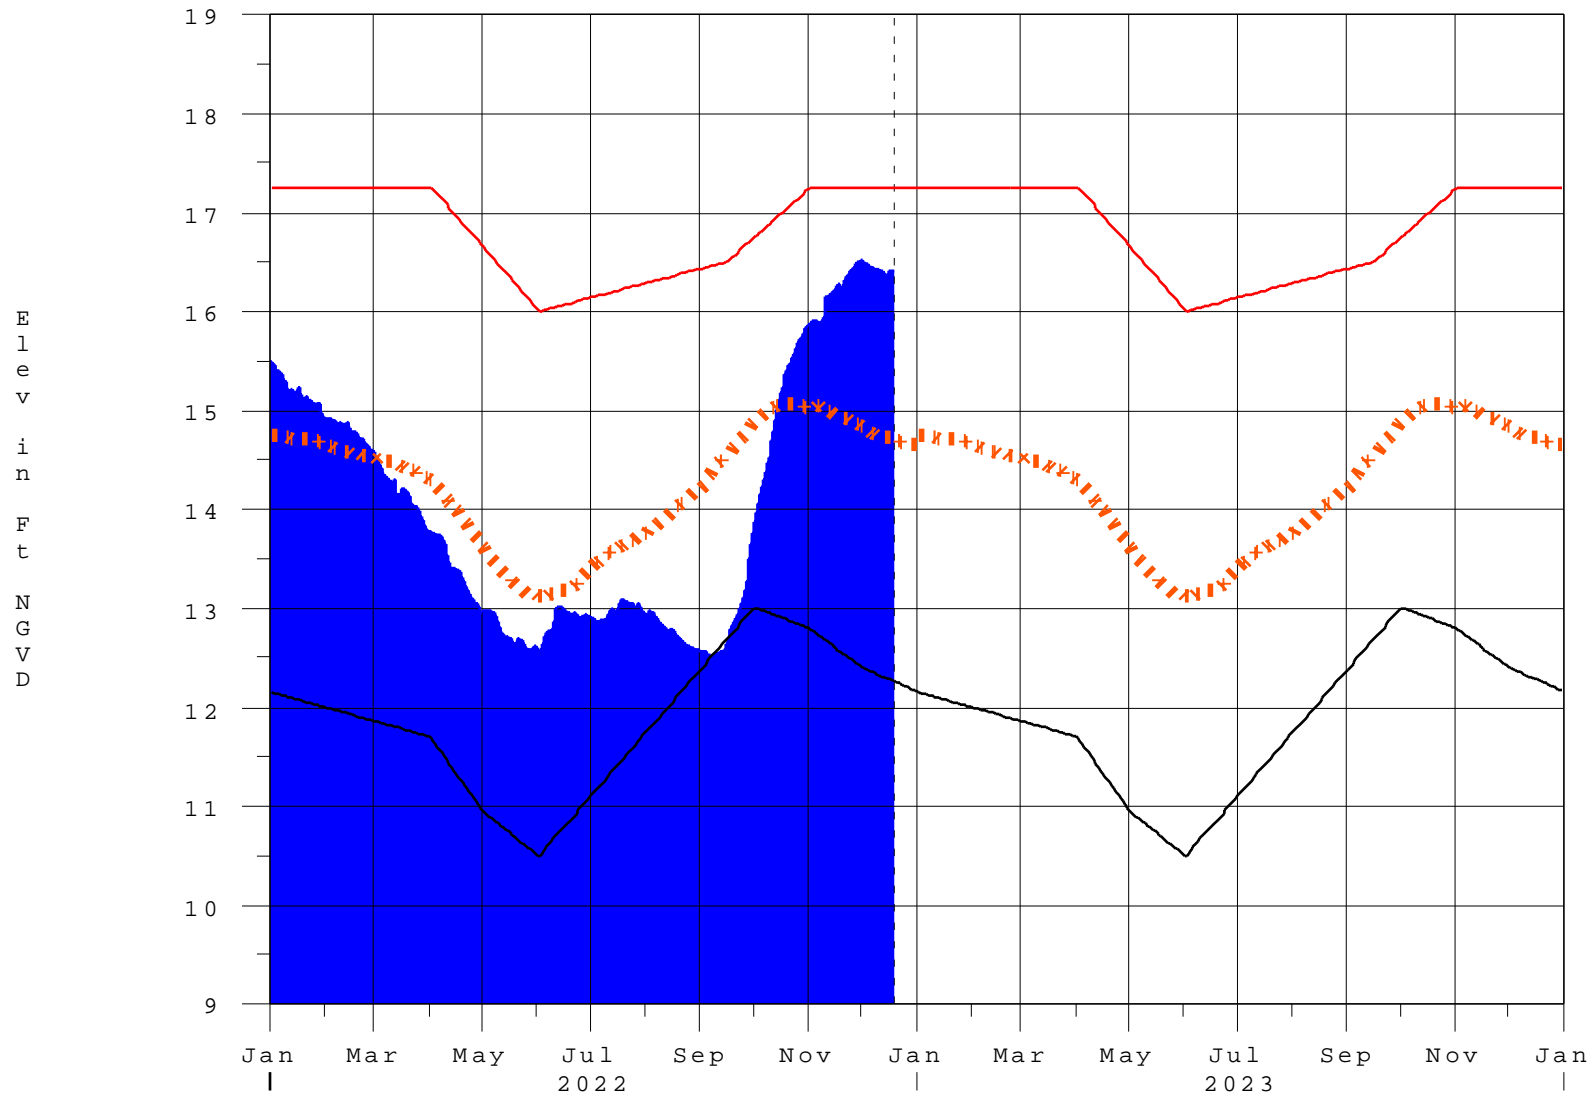

- High Lake Management
- Okeechobee Avg Elev
- Average Elev [1965-2007]
- Water Shortage Management

Classification Tables

Supplemental Tables used in conjunction with the LORS2008 Release

Guidance Flow Charts

- [Class Limits for Tributary Hydrologic Conditions](#)

Table K-2 in the Lake Okeechobee Water Control Plan

- [6-15 Day Precipitation Outlook Categories](#)

Table ?? in the Lake Okeechobee Water Control Plan

- [Classification of Lake Okeechobee Net Inflow for Seasonal Outlook](#)

Table K-3 in the Lake Okeechobee Water Control Plan

- [Classification of Lake Okeechobee Net Inflow for Multi-Seasonal Outlook](#)

Table K-4 in the Lake Okeechobee Water Control Plan

[**Back to Lake Okeechobee Operations Main Page**](#)

[**Back to U.S. Army Corps of Engineers Lake Okeechobee Operations Homepage**](#)

Tributary Hydrologic Classification*	Palmer Index Class Limits	2-wk Mean L.O. Net Inflow Class Limits
Very Wet	3.0 or greater	Greater \geq 6000 cfs
Wet	1.5 to 2.99	2500 - 5999 cfs
Near Normal	-1.49 to 1.49	500 - 2499 cfs
Dry	-2.99 to -1.5	-5000 – 500 cfs
Very Dry	-3.0 or less	Less than -5000 cfs

* use the wettest of the two indicators

Classification of Lake Okeechobee Net Inflow Seasonal Outlook*

Lake Net Inflow Prediction [million acre-feet]	Equivalent Depth** [feet]	Lake Okeechobee Net Inflow Seasonal Outlook
> 0.93	> 2.0	Very Wet
0.71 to 0.93	1.51 to 2.0	Wet
0.35 to 0.70	0.75 to 1.5	Normal
< 0.35	< 0.75	Dry

****Volume-depth conversion based on average lake surface area of 467,000 acres**

Classification of Lake Okeechobee Net Inflow Multi-Seasonal Outlook*

Lake Net Inflow Prediction [million acre-feet]	Equivalent Depth** [feet]	Lake Okeechobee Net Inflow Multi-Seasonal Outlook
> 2.0	> 4.3	Very Wet
1.18 to 2.0	2.51 to 4.3	Wet
0.5 to 1.17	1.1 to 2.5	Normal
< 0.5	< 1.1	Dry

****Volume-depth conversion based on average lake surface area of 467,000 acres**

6-15 Day Precipitation Outlook Categories*

6-15 Day Precipitation Outlook Categories	WSE Decision Tree Categories
Above Normal	Wet to Very Wet
Normal	Normal
Below Normal	Dry

*** Corresponds to Table 7-6 in the Lake Okeechobee Water Control Plan**