

Application of the Lake Okeechobee Regulation Schedule (LORS2008) on 08/21/2023 (ENSO Condition: El Niño)

Lake Okeechobee Net Inflow Outlook:

The Lake Okeechobee Net Inflow Outlook has been computed using methods described in the LORS2008 Water Control Plan: Croley's method, the SFWMD empirical method, a sub-sampling of El Niño years and a sub-sampling of warm years of the Atlantic Multi-decadal Oscillation (AMO) in combination with El Niño ENSO years. The results for Croley's method and the SFWMD empirical method are based on the CPC Outlook.

Table of the Lake Okeechobee Net Inflow Outlooks in feet of equivalent depth. All methods are updated on a weekly basis with observed net inflow for the current month.

Season	Croley's Method*		SFWMD Empirical Method		Sub-sampling of El Niño ENSO Years**		Sub-sampling of AMO Warm + El Niño ENSO Years***	
	Value (ft)	<u>Condition</u>	Value (ft)	<u>Condition</u>	Value (ft)	<u>Condition</u>	Value (ft)	<u>Condition</u>
Current (Aug-Jan)	N/A	N/A	2.38	Very Wet	2.47	Very Wet	3.56	Very Wet
Multi Seasonal (Aug-Apr)	N/A	N/A	2.49	Normal	3.31	Wet	4.32	Very Wet

*Croley's Method Not Produced for This Report

See Seasonal and Multi-Seasonal tables for the classification of Lake Okeechobee Outlooks.

The recommended methods and values for estimating the Lake Okeechobee Net Inflow Outlook are shaded and should be used in the LORS2008 Release Guidance Flow Charts.

**Sub-sampling is a weighted average of ENSO conditions based on the IRI ENSO forecast published.

***Sub-sampling based on combination of ENSO and AMO conditions. For this predominant ENSO categorization is used instead of weights.

Tributary Hydrologic Conditions:

1223 cfs 14-day running average for Lake Okeechobee Net Inflow through 08/20/2023. According to the classification in Tributary Hydrologic Conditions table, this condition is Near Normal.

-2.16 for Palmer Drought Index on 08/19/2023.

According to the classification in Tributary Hydrologic Conditions table, this condition is Dry.

The wetter of the two conditions above is **Normal**.

LORS2008 Classification Tables:

Lake Okeechobee Stage on 08/21/2023:

Lake Okeechobee Stage: **15.36 feet**

Lake Okeechobee Management Zone/Band		Bottom Elevation (feet, NGVD)	Current Lake Stage
High Lake Management Band		16.38	
Operational Band	High sub-band	15.98	
	Intermediate sub-band	15.57	
	Low sub-band	13.76	← 15.36 ft
Base Flow sub-band		12.60	
Beneficial Use sub-band		12.15	
Water Shortage Management Band			

Part C of LORS2008: Discharge to WCAs

Up to Maximum Practicable to the WCAs if desirable or with minimum Everglades impact; otherwise no releases to WCAs.

Part D of LORS2008: Discharge to Tide

Up to 3000 cfs at S-79 and up to 1170 cfs at S-80.

LORS2008 Implementation on 08/21/2023 (ENSO Condition- El Niño):

Status for week ending 08/21/2023*:

Water Supply Risk Evaluation


Area	Indicator	Value	Color Coded Scoring Scheme
LOK	Projected LOK Stage for the next two months	Low Sub-band	L
	Palmer Drought Index for LOK Tributary Conditions	-2.16 (Extremely Dry)	H
	CPC Precipitation Outlook	1 month: Above Normal	L
		3 months: Above Normal	L
	LOK Seasonal Net Inflow Outlook	2.47 ft	L
	ENSO Forecast	Normal to Extremely Wet	L
	LOK Multi-Seasonal Net Inflow Outlook	3.31 ft	L
	ENSO Forecast	Wet	L
WCAs	WCA 1: 3 Station Average (Sites 1-7, 1-8T, and 1-9)	Above Line 1 (16.79 ft)	L
	WCA 2A: Site 2-17	Above Line 1 (12.79 ft)	L
	WCA-3A: 3 Station Average (Sites 63, 64, and 65)	Above Line 1 (10.89 ft)	L
LEC	Service Area 1	Year-Round Irrigation Rule in effect	L
	Service Area 2	Year-Round Irrigation Rule in effect	L
	Service Area 3	Year-Round Irrigation Rule in effect	L

Note: The water supply risk classification based on the Palmer index, as well as the LOK seasonal and multi-seasonal net inflow outlooks use slightly different classification intervals than those used by the 2008-LORS.

*- S80 flow data for August 19 & 20 is not available from USACE Daily Reports and was assumed to be 0.



Lake Okeechobee SFWMM August 2023 Position Analysis

Percentiles PA

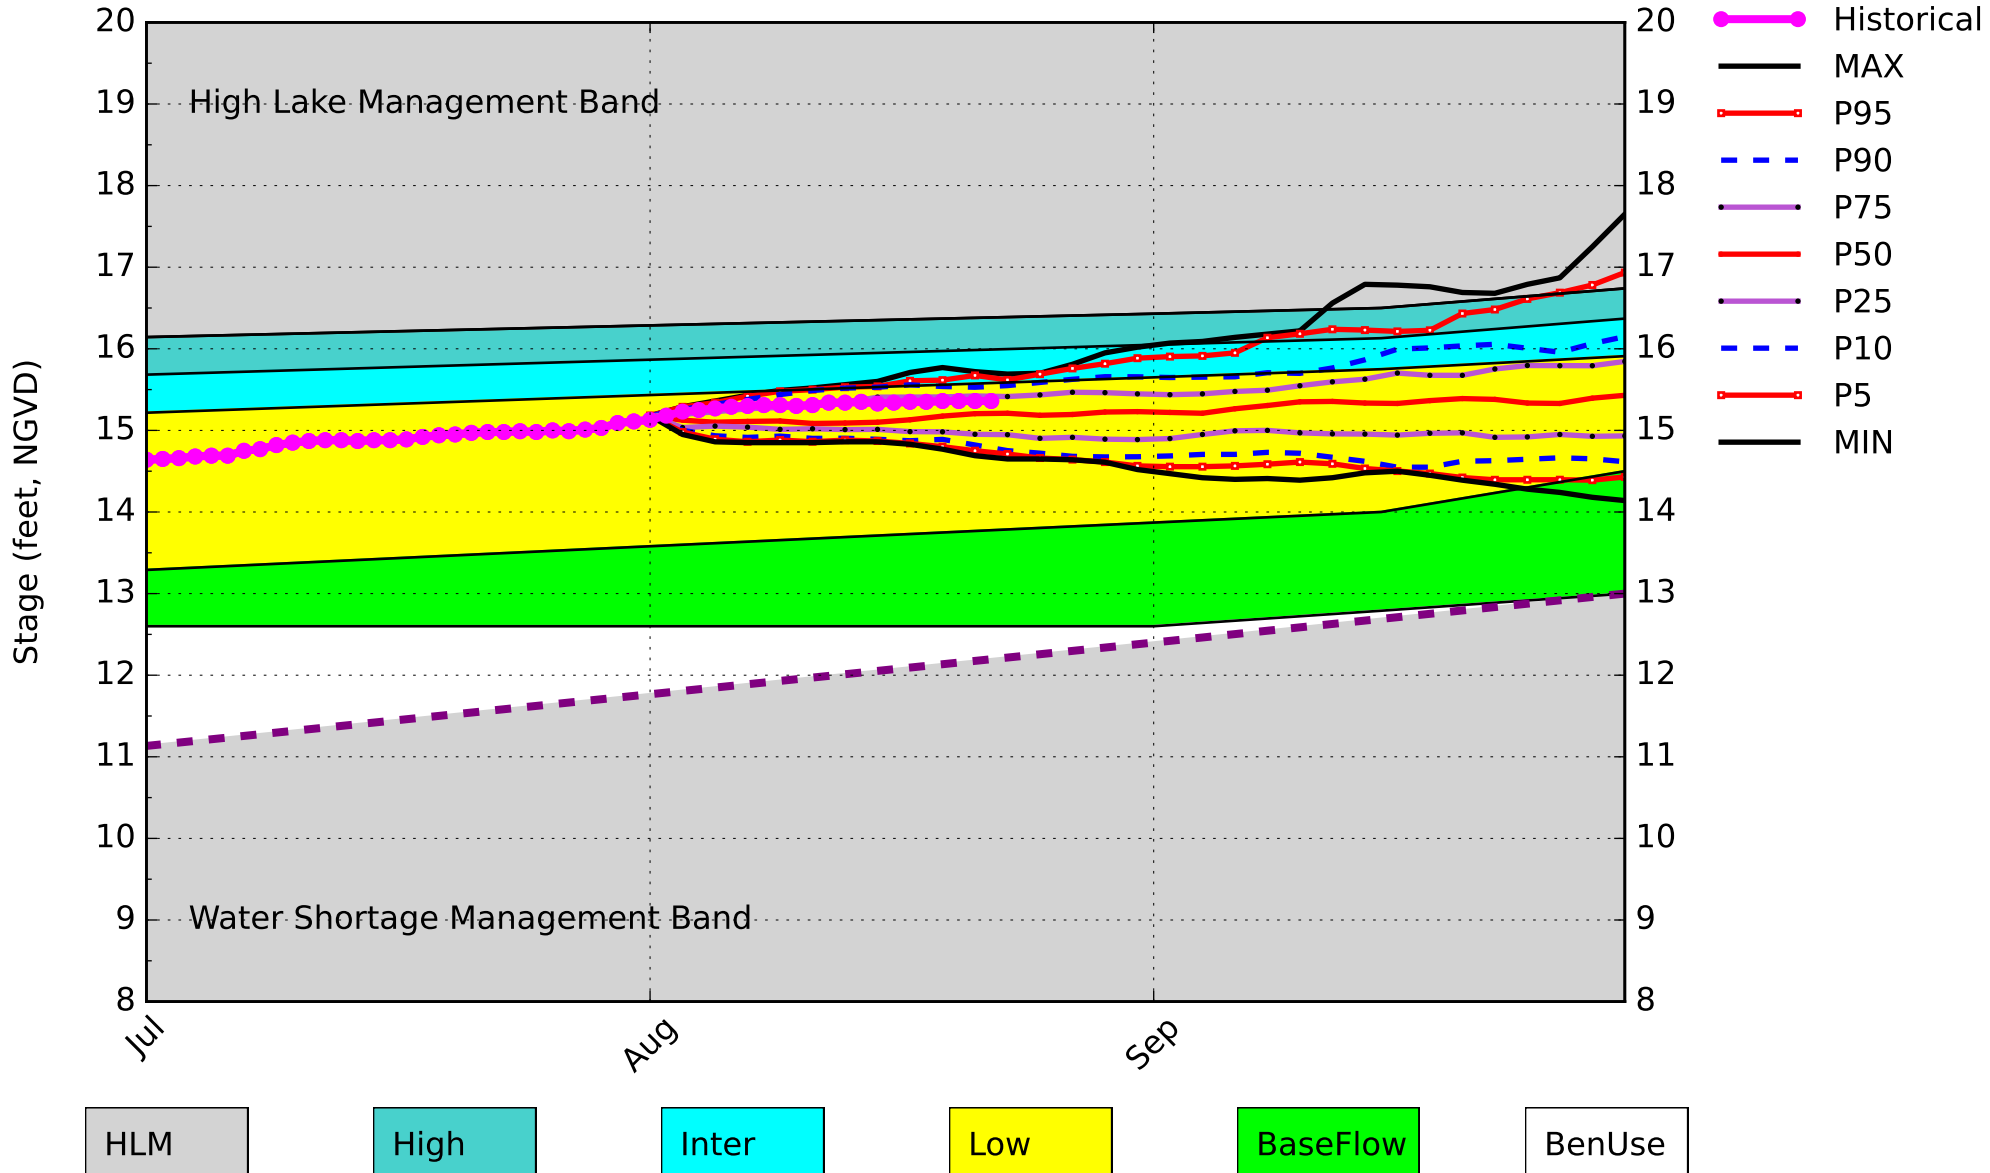

(See assumptions on the Position Analysis Results website)

Tributary Basin Condition Indicators as of August 20 2023

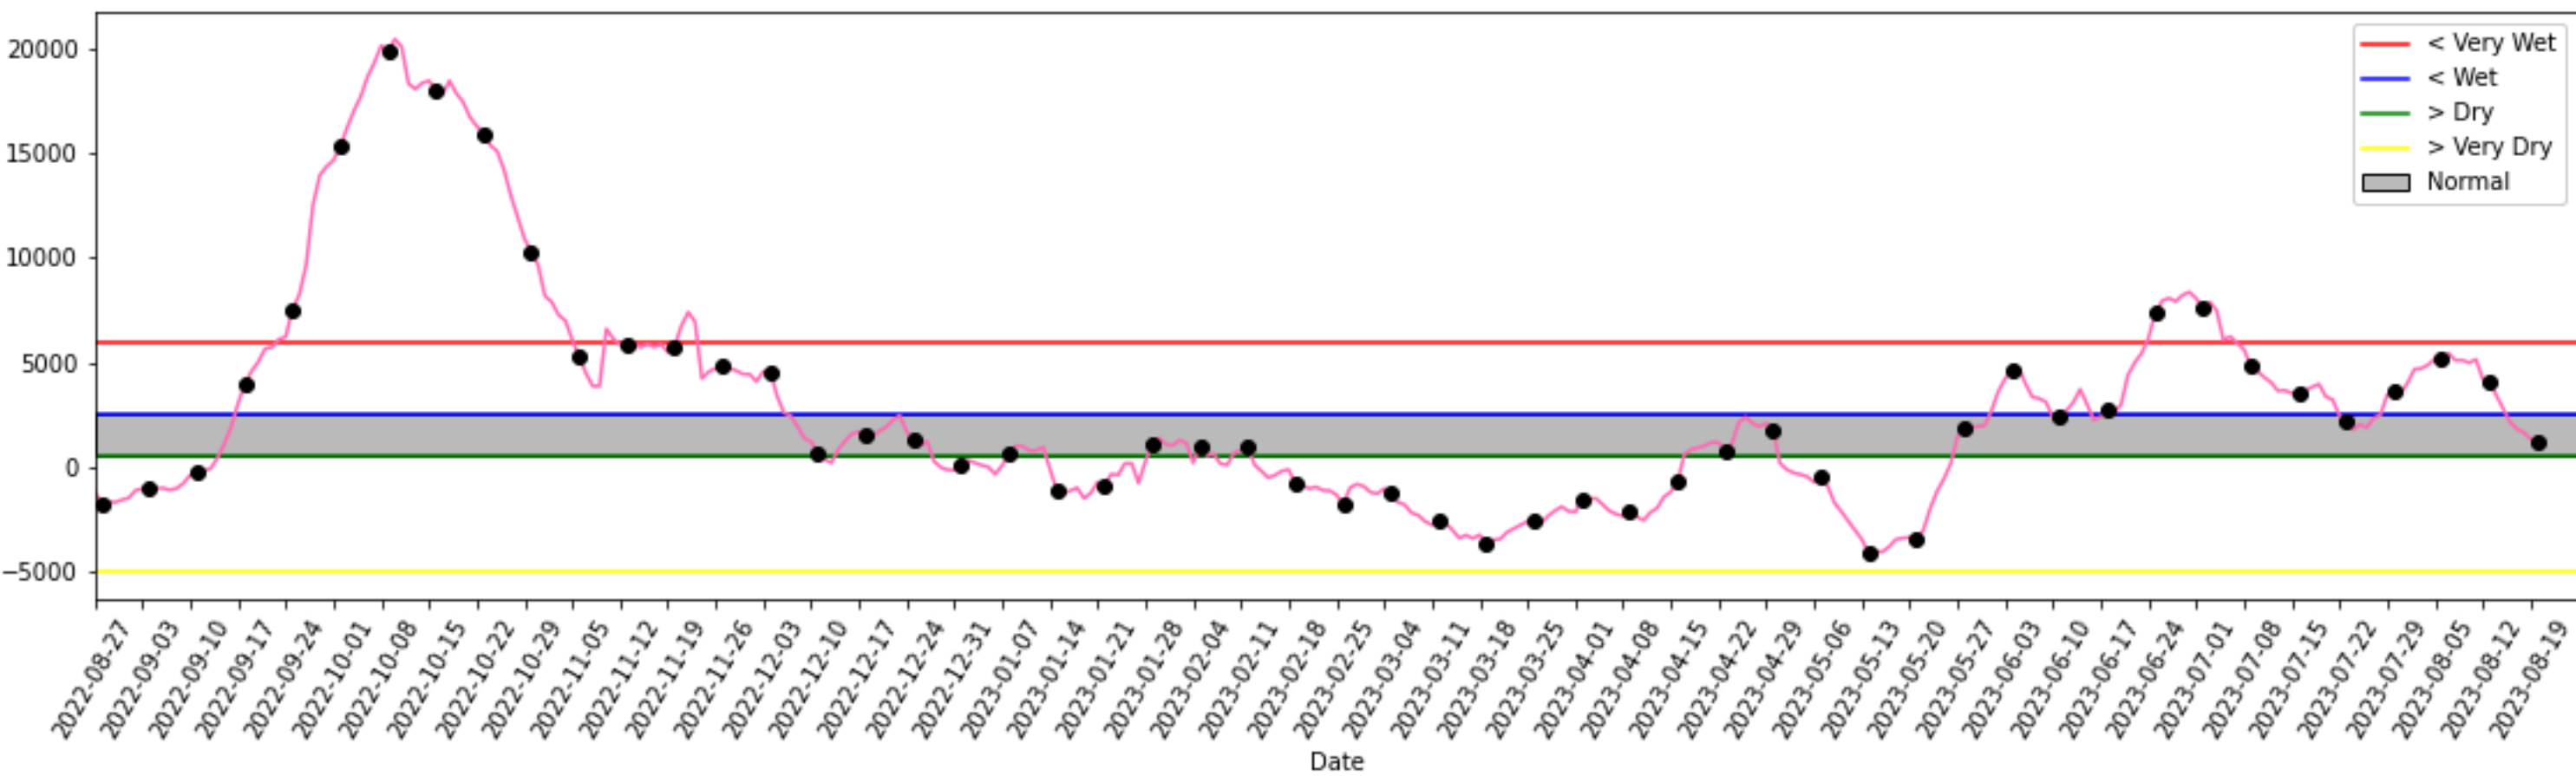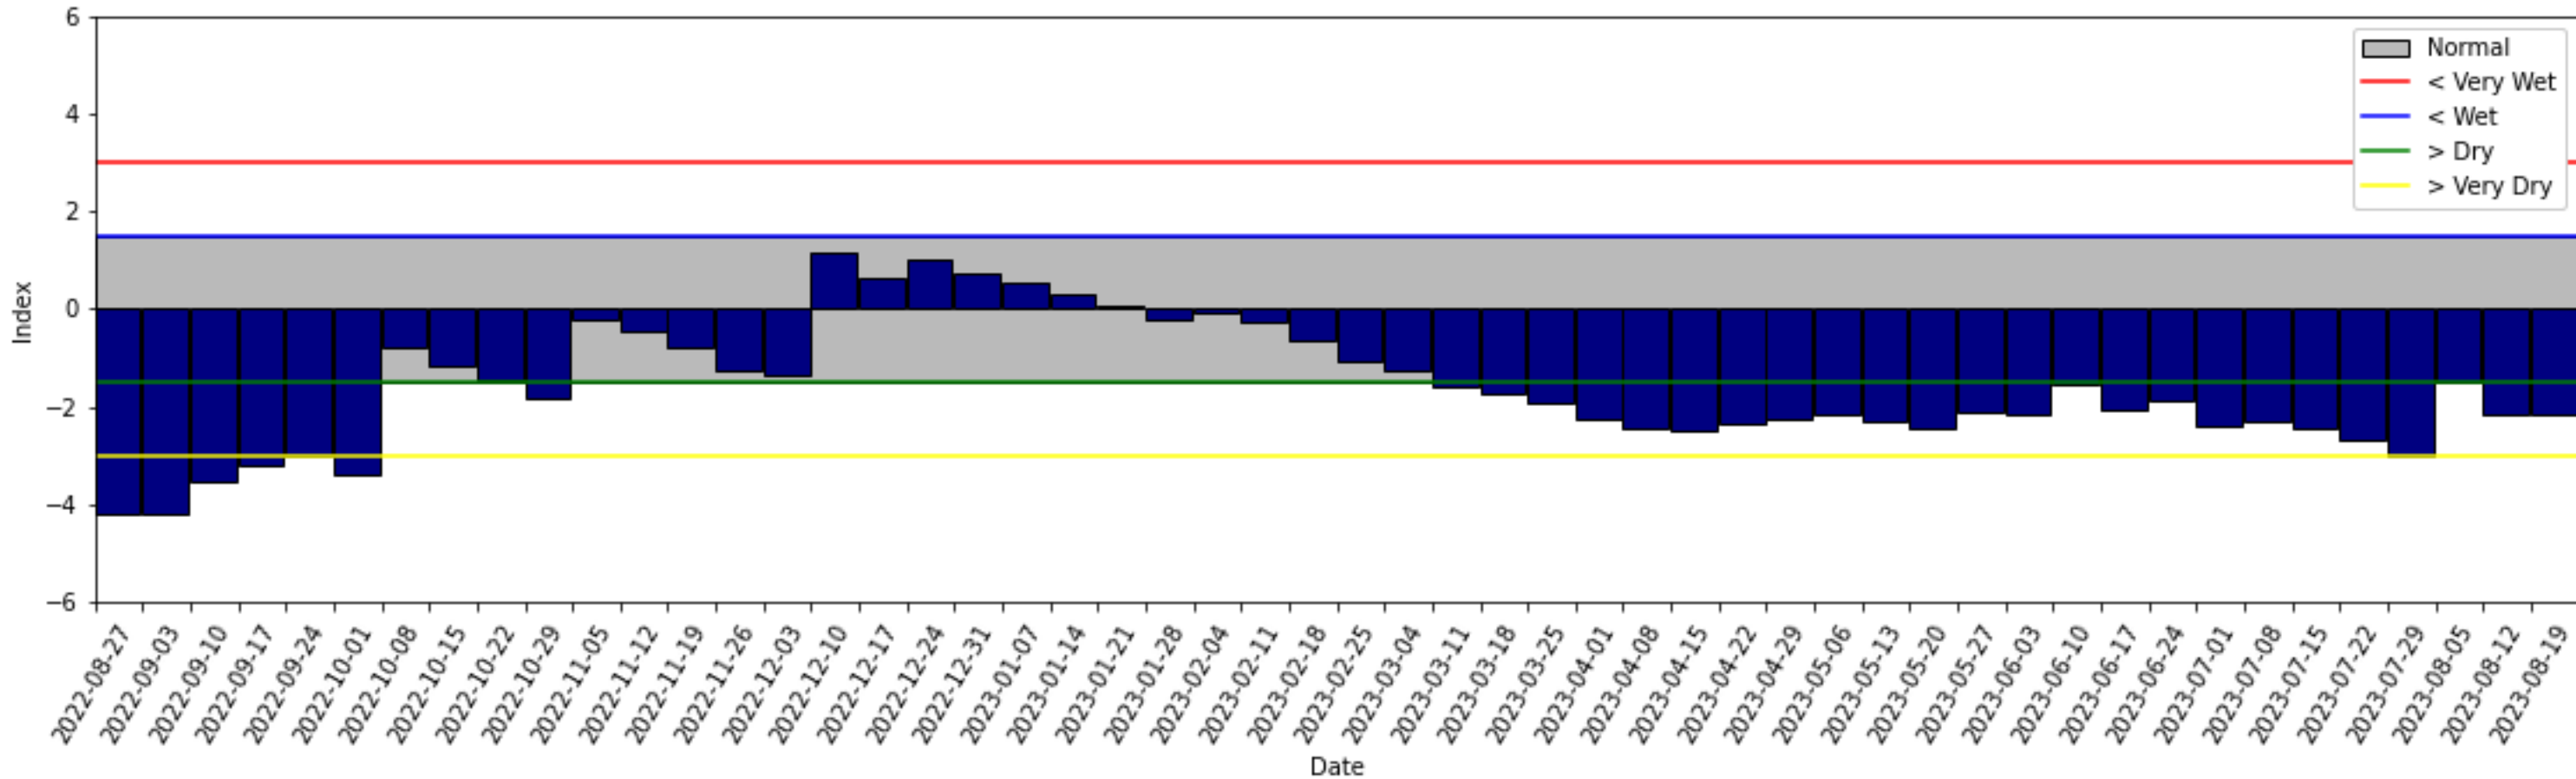

2008 LORS

Part C: Establish Allowable Lake Okeechobee Releases to the Water Conservation Areas

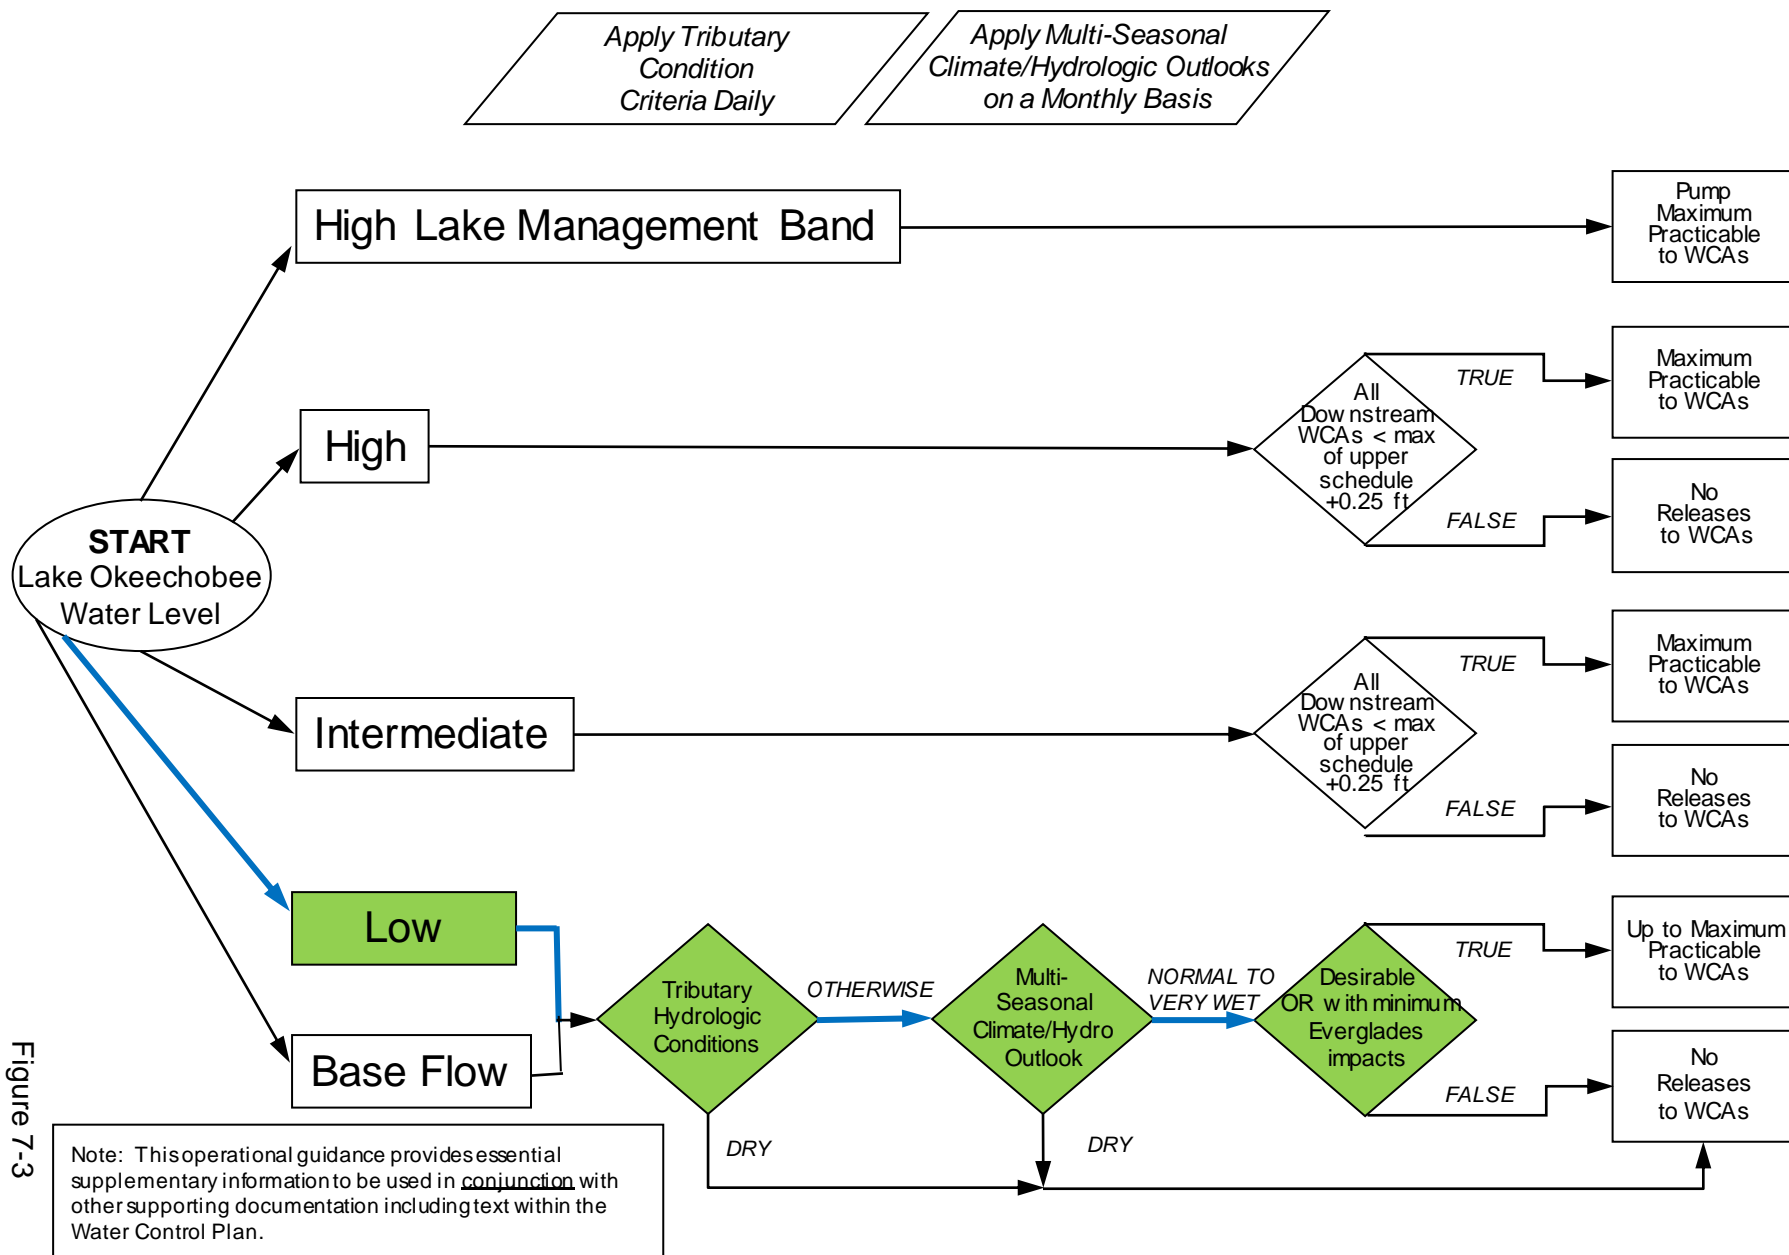


Figure 7-3

2008 LORS

Part D: Establish Allowable Lake Okeechobee Releases to Tide (Estuaries)

Note: This operational guidance provides essential supplementary information to be used in conjunction with other supporting documentation including text within the Water Control Plan.

When conducting Base Flow releases, flows can be distributed East and West up to 650 cfs as needed to minimize impacts or provide benefits through S-80 and S-79

Apply Meteorological Forecasts on a Weekly Basis; apply Seasonal and Multi-Seasonal Climate/Hydrologic Outlooks on a Monthly Basis


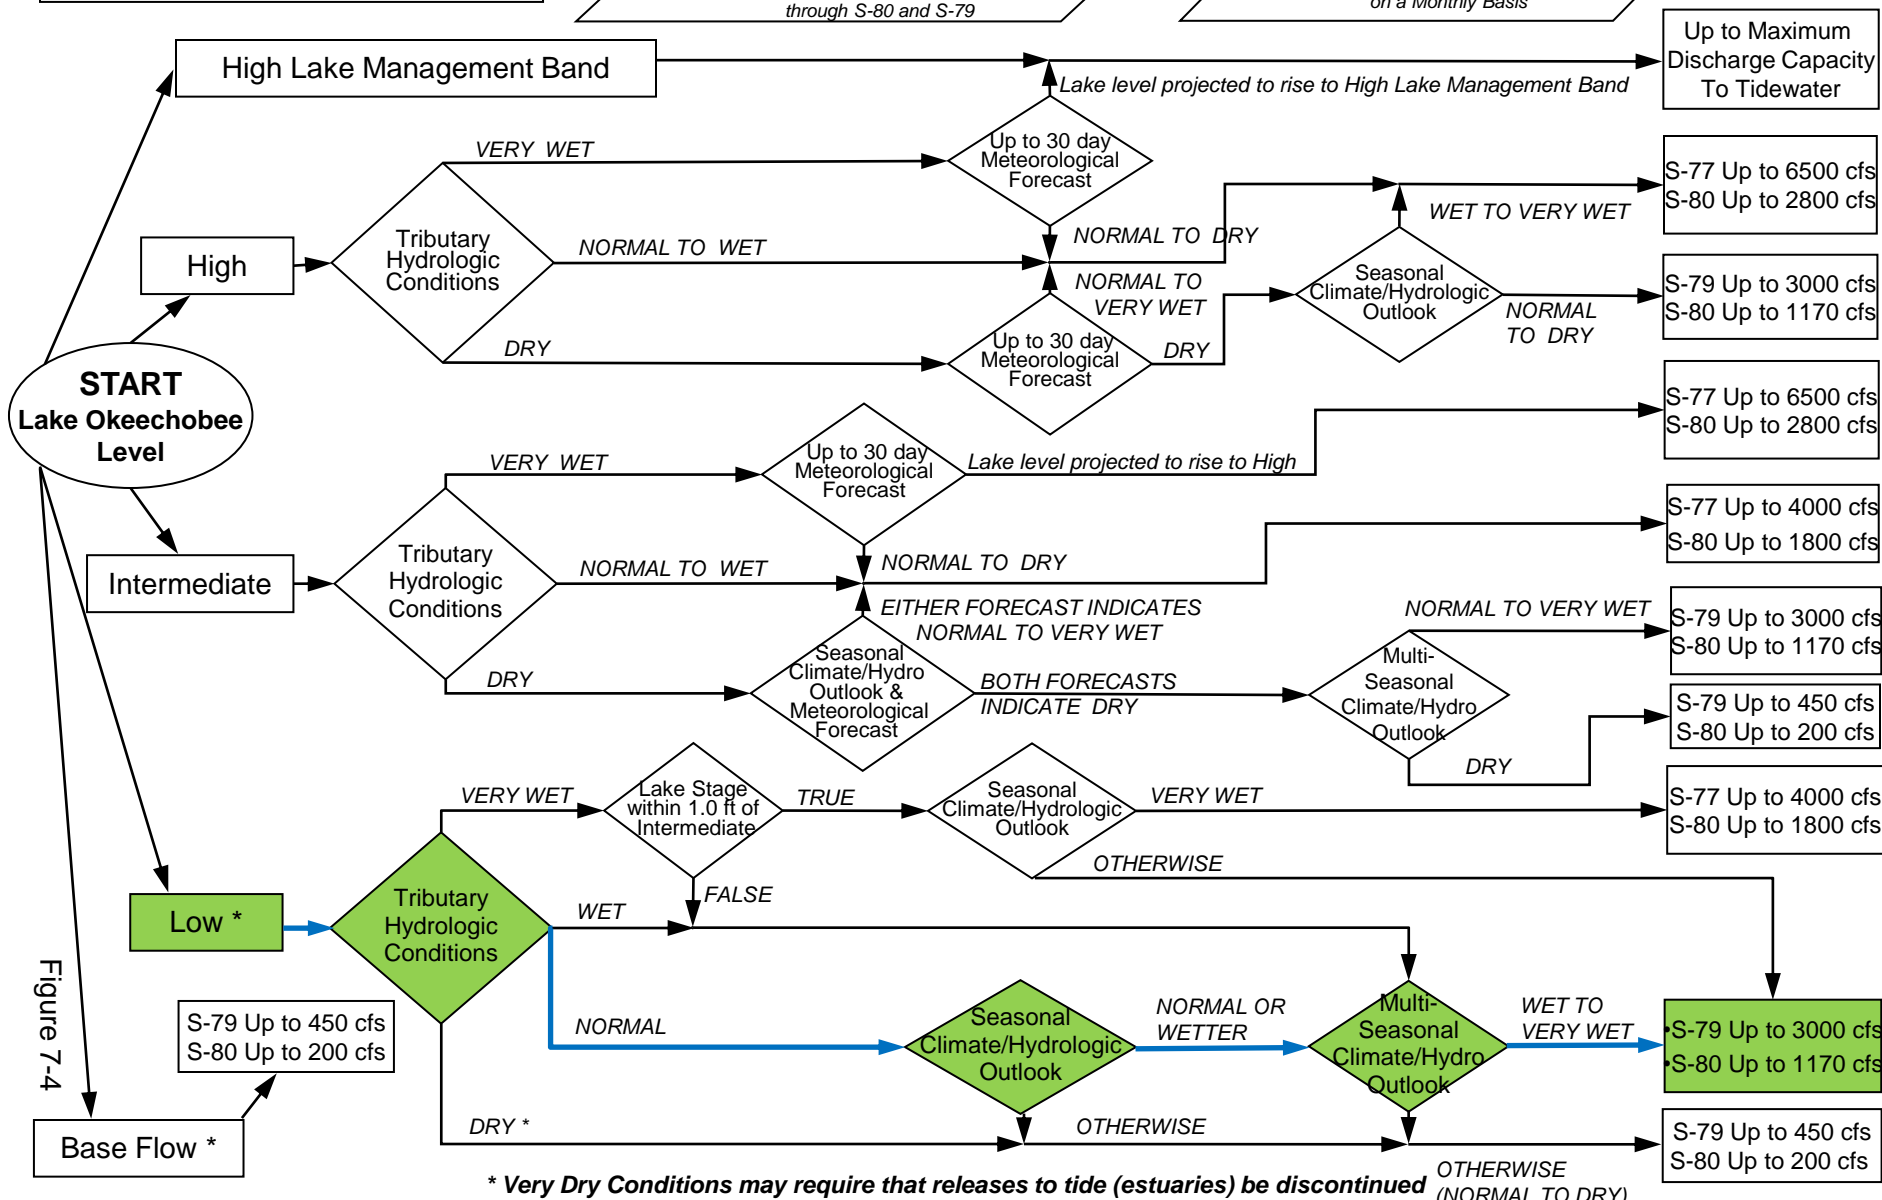


Figure 7-4

Lake Okeechobee Water Level History and Projected Stages

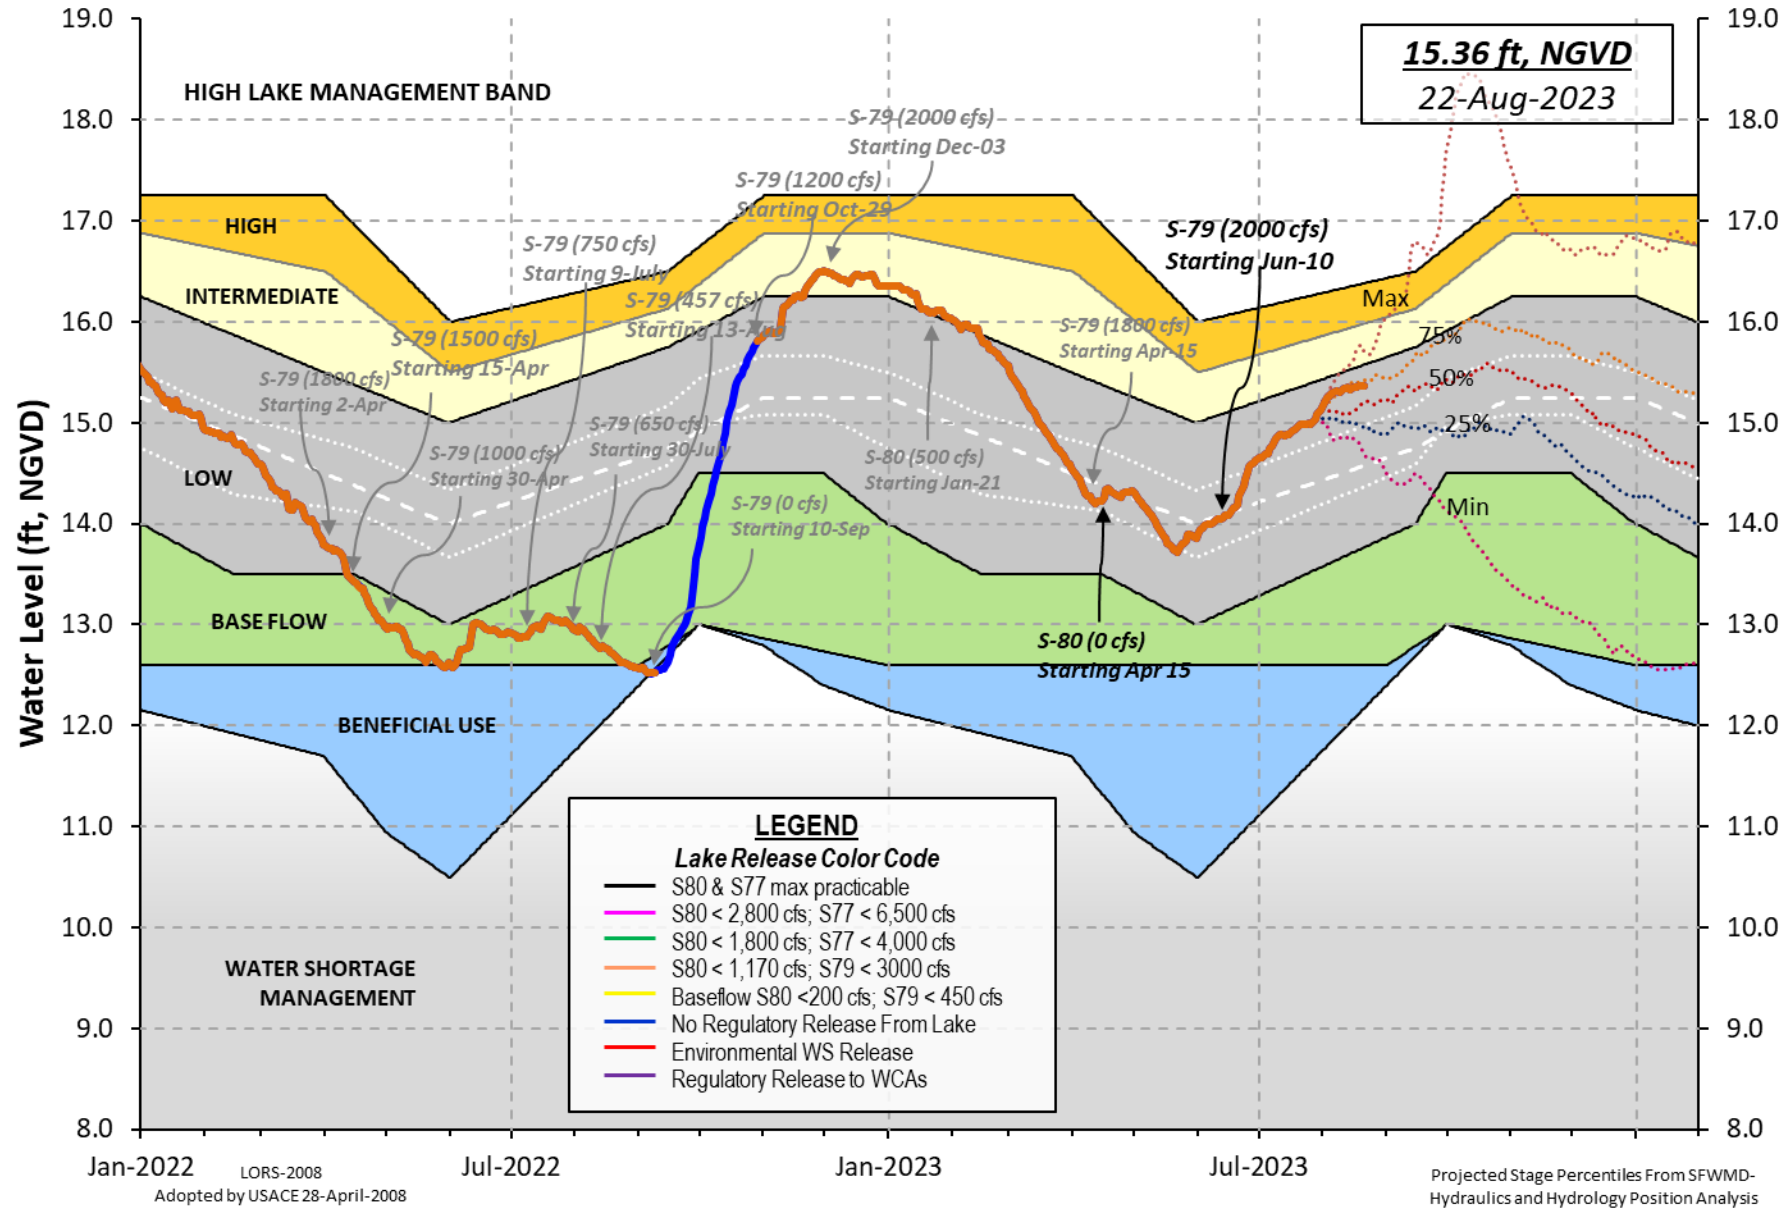

U. S. Army Corps of Engineers, Jacksonville District
 Lake Okeechobee and Vicinity Report
 ** Preliminary Data - Subject to Revision **

Data Ending 2400 hours 20 AUG 2023

Okeechobee Lake Regulation	Elevation (ft-NGVD)	Last Year (ft-NGVD)	2YRS Ago (ft-NGVD)
*Okeechobee Lake Elevation	15.36	12.70	14.44 (Official Elv)
Bottom of High Lake Mngmt=	16.38	Top of Water Short Mngmt=	12.15
Currently in Operational Management Band			
Simulated Average LORS2008 [1965-2000]	13.04		
Difference from Average LORS2008	2.32		
20AUG (1965-2007) Period of Record Average	14.05		
Difference from POR Average	1.31		

Today Lake Okeechobee elevation is determined from the 4 Int & 4 Edge stations

++Navigation Depth (Based on 2007 Channel Condition Survey) Route 1 ◆ 9.30'
 ++Navigation Depth (Based on 2008 Channel Condition Survey) Route 2 ◆ 7.50'
 Bridge Clearance = 49.54'

4 Interior and 4 Edge Okeechobee Lake Average (Avg-Daily values):

L001	L005	L006	LZ40	S4	S352	S308	S133
15.42	15.43	15.33	15.29	15.35	15.42	15.35	15.30

*Combination Okeechobee Avg-Daily Lake Average = 15.36
 (*See Note)

Okeechobee Inflows (cfs):

S65E	1026	S65EX1	0	Fisheating Cr	435
S154	46	S191	0	S135 Pumps	0
S84	399	S133 Pumps	63	S2 Pumps	0
S84X	170	S127 Pumps	103	S3 Pumps	0
S71	359	S129 Pumps	40	S4 Pumps	0
S72	549	S131 Pumps	22	C5	0
Total Inflows:	3212				

Okeechobee Outflows (cfs):

S135 Culverts	0	S354	0	S77	-NR-
S127 Culverts	0	S351	0	S308	362
S129 Culverts	0	S352	0		
S131 Culverts	0	L8 Canal Pt	2		
Total Outflows:	No Report Due To Missing S77 or S308 Discharge Data				

***S77 structure flow is being used to compute Total Outflow.
 ***S308 structure flow is being used to compute Total Outflow.

Okeechobee Pan Evaporation (inches):

S77	-NR-	S308	0.24
Average Pan Evap x 0.75 Pan Coefficient = -NR-" = -NR-'			

Lake Average Precipitation using NEXRAD: = -NR-" = -NR-'

Evaporation - Precipitation: = -NR-" = -NR-'
 Evaporation - Precipitation using Lake Area of 730 square miles

is equal to -NR-
 Lake Okeechobee (Change in Storage) Flow is 0 cfs or 0 AC-FT

	Headwater Elevation (ft-msl)	Tailwater Elevation (ft-msl)	Disch (cfs)	----- Gate Positions -----							
				#1 (ft)	#2 (ft)	#3 (ft)	#4 (ft)	#5 (ft)	#6 (ft)	#7 (ft)	#8 (ft)
(I) see note at bottom											
North East Shore											
S133 Pumps:	13.30	15.30	63	12	0	0	48	0	(cfs)		
S193:											
S191:	18.59	15.28	0	0.0	0.0	0.0					
S135 Pumps:	13.49	15.17	0	0	0	0	0		(cfs)		
S135 Culverts:			0	0.0	0.0						
North West Shore											
S65E:	20.88	15.24	1026	0.1	0.4	0.4	0.2	0.4	0.2		
S65EX1:	20.88	15.24	0								
S127 Pumps:	13.48	15.30	103	24	31	0	0	55	(cfs)		
S127 Culvert:			0	0.0							
S129 Pumps:	12.83	15.46	40	43	0	0			(cfs)		
S129 Culvert:			0	0.0							
S131 Pumps:	12.89	-NR-	22	0	0				(cfs)		
S131 Culvert:			0								
Fisheating Creek											
nr Palmdale		32.44	435								
nr Lakeport											
S282	15.62	15.56		0.0	0.0	0.1					
South Shore											
S4 Pumps:	10.95	-NR-	0	0	0	0			(cfs)		
S169:	15.44	-NR-	-NR-	-NR-	-NR-	-NR-					
S310:	15.43		-183								
S3 Pumps:	10.37	15.41	0	0	0	0			(cfs)		
S354:	15.41	10.37	0	0.0	0.0						
S2 Pumps:	10.33	15.44	0	0	0	0	0		(cfs)		
S351:	15.44	10.33	0	0.0	0.0	0.0					
S352:	15.39	10.55	0	0.0	0.0						
S271:	15.53	15.27		-NR-	0.0	0.0	0.0				
L8 Canal PT		14.97	2								

S351 and S352 Temporary Pumps/S354 Spillway

S351:	10.33	15.44	0	-NR-	-NR-	-NR-	-NR-	-NR-	-NR-		
S352:	10.55	15.39	0	-NR-	-NR-	-NR-	-NR-				
S354:	10.37	15.41	0	-NR-	-NR-	-NR-	-NR-				

Caloosahatchee River (S77, S78, S79)

S47B:	12.69	12.25		1.5	1.5						
S47D:	12.28	10.86	7	0.0							
S77:											
Spillway and Sector Preferred Flow:	15.41	10.73	0	0.0	0.0	0.0	0.0				
Flow Due to Lockages+:			-NR-								

S78:

Spillway and Sector Flow:
 10.73 2.73 1051 0.0 2.5 0.0 0.0
 Flow Due to Lockages+: 15

S79:

Spillway and Sector Flow:
 2.87 1.11 2506 0.0 0.0 2.0 2.0 2.0 1.5 0.0 0.0
 Flow Due to Lockages+: -NR-
 Percent of flow from S77 0%
 Chloride (ppm) -N

St. Lucie Canal (S308, S80)

S308:

Spillway and Sector Preferred Flow:
 15.34 13.96 358 0.0 0.0 0.0 0.0
 Flow Due to Lockages+: 4

S153: 18.60 13.75 47 0.0 0.0

S80:

Spillway and Sector Flow:
 14.08 0.82 0 0.0 0.0 0.0 0.0 0.0 0.0 0.0
 Flow Due to Lockages+: -NR-
 Percent of flow from S308 NA %

Steele Point Top Salinity (mg/ml) ****
 Steele Point Bottom Salinity (mg/ml) ****

Speedy Point Top Salinity (mg/ml) ****
 Speedy Point Bottom Salinity (mg/ml) ****

+ Flow Due to lockages is computed utilizing average daily headwater and tailwater along with total number of lockages for the day to calculate a volume which is then converted to an average discharge in cfs.

++ Preferred flow is determined from either the spillway discharge or the below flow meter daily

Daily Precipitation Totals	1-Day (inches)	3-Day (inches)	7-Day (inches)	----- Wind -----	
				Direction (Deg)	Speed (mph)
S133 Pump Station:	-NR-	0.00	0.00		
S193:	-NR-	0.00	0.00	-NR-	-NR-
Okeechobee Field Station:	-NR-	0.00	0.00		
S135 Pump Station:	-NR-	0.00	0.00		
S127 Pump Station:	-NR-	0.00	0.00		
S129 Pump Station:	-NR-	0.00	0.00		
S131 Pump Station:	-NR-	0.00	0.00		
S77:	-NR-	0.00	0.00	109	10
S78:	-NR-	0.00	0.00	55	3
S79:	-NR-	0.00	0.00	59	1
S4 Pump Station:	-NR-	0.00	0.00		
Clewiston Field Station:	-NR-	0.00	0.00		
S3 Pump Station:	-NR-	0.00	0.00		
S2 Pump Station:	-NR-	0.00	0.00		
S308:	-NR-	0.00	0.00	-NR-	-NR-
S80:	-NR-	0.00	0.00	171	3
Okeechobee Average (Sites S78, S79 and S80 not included)	-NR-	0.00	0.00		

Oke Nexrad Basin Avg	-NR-	0.00	0.00		

Okeechobee Lake Elevations 20 AUG 2023 15.36 Difference from 20AUG23
 20AUG23 -1 Day = 19 AUG 2023 15.36 0.00

20AUG23	-2 Days =	18 AUG 2023	15.36	0.00
20AUG23	-3 Days =	17 AUG 2023	15.35	-0.01
20AUG23	-4 Days =	16 AUG 2023	15.35	-0.01
20AUG23	-5 Days =	15 AUG 2023	15.34	-0.02
20AUG23	-6 Days =	14 AUG 2023	15.33	-0.03
20AUG23	-7 Days =	13 AUG 2023	15.35	-0.01
20AUG23	-30 Days =	21 JUL 2023	14.98	-0.38
20AUG23	-1 Year =	20 AUG 2022	12.70	-2.66
20AUG23	-2 Year =	20 AUG 2021	14.44	-0.92

Long Term Mean 30day Avearge ET for Lake Alfred (Inches) = -NR-

Lake Okeechobee Net Inflow (LONIN)

		Average Flow over the previous 14 days		Avg-Daily Flow
20AUG23	Today =	20 AUG 2023	1227 MON	359
20AUG23	-1 Day =	19 AUG 2023	1357 SUN	2
20AUG23	-2 Days =	18 AUG 2023	1666 SAT	2168
20AUG23	-3 Days =	17 AUG 2023	1834 FRI	0
20AUG23	-4 Days =	16 AUG 2023	2168 THU	2168
20AUG23	-5 Days =	15 AUG 2023	2805 WED	2310
20AUG23	-6 Days =	14 AUG 2023	3434 TUE	-4336
20AUG23	-7 Days =	13 AUG 2023	4071 MON	2552
20AUG23	-8 Days =	12 AUG 2023	4224 SUN	366
20AUG23	-9 Days =	11 AUG 2023	5152 SAT	7042
20AUG23	-10 Days =	10 AUG 2023	4984 FRI	2806
20AUG23	-11 Days =	09 AUG 2023	5118 THU	-1397
20AUG23	-12 Days =	08 AUG 2023	5105 WED	763
20AUG23	-13 Days =	07 AUG 2023	5443 TUE	2381

S65E

		Average Flow over previous 14 days		Avg-Daily Flow
20AUG23	Today=	20 AUG 2023	1275 MON	1160
20AUG23	-1 Day =	19 AUG 2023	1357 SUN	1363
20AUG23	-2 Days =	18 AUG 2023	1404 SAT	1454
20AUG23	-3 Days =	17 AUG 2023	1446 FRI	1000
20AUG23	-4 Days =	16 AUG 2023	1481 THU	912
20AUG23	-5 Days =	15 AUG 2023	1520 WED	1515
20AUG23	-6 Days =	14 AUG 2023	1541 TUE	1075
20AUG23	-7 Days =	13 AUG 2023	1563 MON	1152
20AUG23	-8 Days =	12 AUG 2023	1576 SUN	1169
20AUG23	-9 Days =	11 AUG 2023	1594 SAT	950
20AUG23	-10 Days =	10 AUG 2023	1623 FRI	1055
20AUG23	-11 Days =	09 AUG 2023	1628 THU	1479
20AUG23	-12 Days =	08 AUG 2023	1623 WED	1648
20AUG23	-13 Days =	07 AUG 2023	1616 TUE	1922

S65EX1

		Average Flow over previous 14 days		Avg-Daily Flow
20AUG23	Today=	20 AUG 2023	0 MON	0
20AUG23	-1 Day =	19 AUG 2023	0 SUN	0
20AUG23	-2 Days =	18 AUG 2023	0 SAT	0
20AUG23	-3 Days =	17 AUG 2023	0 FRI	0
20AUG23	-4 Days =	16 AUG 2023	0 THU	0
20AUG23	-5 Days =	15 AUG 2023	0 WED	0
20AUG23	-6 Days =	14 AUG 2023	0 TUE	0
20AUG23	-7 Days =	13 AUG 2023	0 MON	0
20AUG23	-8 Days =	12 AUG 2023	0 SUN	0
20AUG23	-9 Days =	11 AUG 2023	0 SAT	0
20AUG23	-10 Days =	10 AUG 2023	0 FRI	0
20AUG23	-11 Days =	09 AUG 2023	0 THU	0
20AUG23	-12 Days =	08 AUG 2023	0 WED	0
20AUG23	-13 Days =	07 AUG 2023	0 TUE	0

Lake Okeechobee Outlets Last 14 Days

DATE	S-77 Discharge (ALL DAY) (AC-FT)	Below S-77 Discharge (ALL-DAY) (AC-FT)	S-78 Discharge (ALL DAY) (AC-FT)	S-79 Discharge (ALL DAY) (AC-FT)
20 AUG 2023	-NR-	337	2110	-NR-
19 AUG 2023	16	229	1540	5214
18 AUG 2023	8	38	814	3666
17 AUG 2023	9	86	1174	2352
16 AUG 2023	8	327	1193	3118
15 AUG 2023	2	285	992	1887
14 AUG 2023	9	209	980	2915
13 AUG 2023	1451	762	2114	4078
12 AUG 2023	2638	726	2624	5694
11 AUG 2023	2168	1068	2491	5350
10 AUG 2023	1270	1297	2011	5716
09 AUG 2023	1535	1652	2252	4738
08 AUG 2023	1523	1805	2601	6236
07 AUG 2023	444	831	2590	7214

DATE	S-310 Discharge (ALL DAY) (AC-FT)	S-351 Discharge (ALL DAY) (AC-FT)	S-352 Discharge (ALL DAY) (AC-FT)	S-354 Discharge (ALL DAY) (AC-FT)	L8 Canal Pt Discharge (ALL DAY) (AC-FT)
20 AUG 2023	-363	0	0	0	3
19 AUG 2023	-256	0	0	0	9
18 AUG 2023	31	0	0	0	-3
17 AUG 2023	53	0	0	0	-13
16 AUG 2023	-87	0	0	0	-4
15 AUG 2023	-100	0	0	0	-5
14 AUG 2023	52	0	0	0	-15
13 AUG 2023	35	0	0	0	-1
12 AUG 2023	-105	0	0	0	1
11 AUG 2023	-103	0	0	0	5
10 AUG 2023	-61	0	0	0	-14
09 AUG 2023	18	0	0	0	0
08 AUG 2023	4	0	0	0	-0
07 AUG 2023	-2	0	0	0	4

DATE	S-308 Discharge (ALL DAY) (AC-FT)	Below S-308 Discharge (ALL-DAY) (AC-FT)	S-80 Discharge (ALL-DAY) (AC-FT)
20 AUG 2023	703	-NR-	-NR-
19 AUG 2023	11	-NR-	-NR-
18 AUG 2023	3	-NR-	70
17 AUG 2023	3	-NR-	31
16 AUG 2023	4	-NR-	12
15 AUG 2023	226	-NR-	31
14 AUG 2023	3	-NR-	35
13 AUG 2023	3	-NR-	19
12 AUG 2023	3	-NR-	19
11 AUG 2023	7	-NR-	35
10 AUG 2023	4	-NR-	35
09 AUG 2023	4	-NR-	27
08 AUG 2023	3	-NR-	15
07 AUG 2023	2	-NR-	19

*** NOTE: Discharge (ALL DAY) is computed using Spillway, Sector Gate and Lockages Discharges from 0015 hrs to 2400 hrs.


(I) - Flows preceded by "I" signify an instantaneous flow computed from the single value reported for the day

-
- * On 11 May 1999, Lake Okeechobee Elevation was switched from Instantaneous 2400 value to an average-daily lake average.
 - On 14 Mar 2001, due to the isolation of various gages within the standard 10 stations, the average of the interior 4 station gages was used as the Lake Okeechobee Elevation.
 - On 05 November 2010, Lake Okeechobee Elevation was switched to a 9 gage mix of interior and edge gages to obtain a more reliable representation of the lake level.
 - On 09 May 2011, Lake Okeechobee Elevation was switched to a 8 gage mix of interior and edge gages to obtain a more reliable representation of the lake level due to isolation of S135 from low lake levels.
 - Today Lake Okeechobee elevation is determined from the 4 Int & 4 Edge stations
- ++ For more information see the Jacksonville District Navigation website at <http://www.saj.usace.army.mil/>
- \$ For information regarding Lake Okeechobee Service Area water restrictions please refer to www.sfwmd.gov

Report Generated 21AUG2023 @ 08:39 ** Preliminary Data - Subject to Revision **

Lake Okeechobee

21AUG23 08:30:27

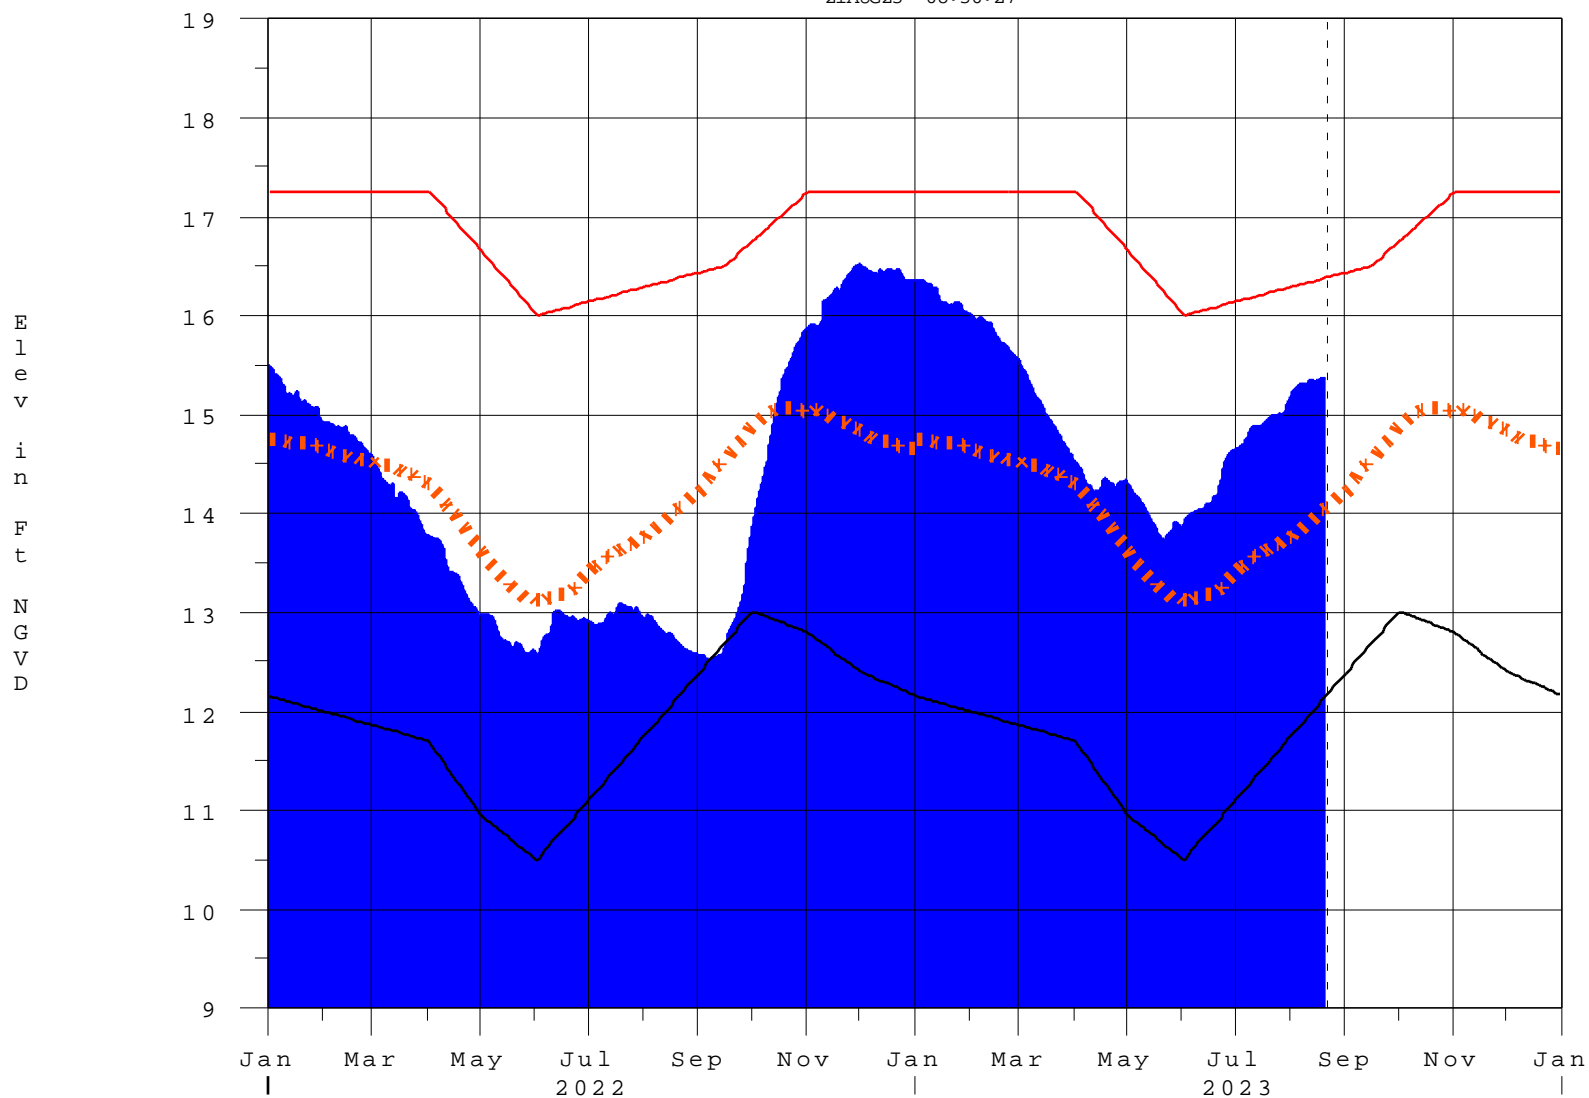

E
l
e
v

i
n

F
t

N
G
V
D

- High Lake Management
- Okeechobee Avg Elev
- Average Elev [1965-2007]
- Water Shortage Management

Classification Tables

Supplemental Tables used in conjunction with the LORS2008 Release

Guidance Flow Charts

- [Class Limits for Tributary Hydrologic Conditions](#)

Table K-2 in the Lake Okeechobee Water Control Plan

- [6-15 Day Precipitation Outlook Categories](#)

Table ?? in the Lake Okeechobee Water Control Plan

- [Classification of Lake Okeechobee Net Inflow for Seasonal Outlook](#)

Table K-3 in the Lake Okeechobee Water Control Plan

- [Classification of Lake Okeechobee Net Inflow for Multi-Seasonal Outlook](#)

Table K-4 in the Lake Okeechobee Water Control Plan

[Back to Lake Okeechobee Operations Main Page](#)

[Back to U.S. Army Corps of Engineers Lake Okeechobee Operations Homepage](#)

Tributary Hydrologic Classification*	Palmer Index Class Limits	2-wk Mean L.O. Net Inflow Class Limits
Very Wet	3.0 or greater	Greater \geq 6000 cfs
Wet	1.5 to 2.99	2500 - 5999 cfs
Near Normal	-1.49 to 1.49	500 - 2499 cfs
Dry	-2.99 to -1.5	-5000 – 500 cfs
Very Dry	-3.0 or less	Less than -5000 cfs

* use the wettest of the two indicators

Classification of Lake Okeechobee Net Inflow Seasonal Outlook*

Lake Net Inflow Prediction [million acre-feet]	Equivalent Depth** [feet]	Lake Okeechobee Net Inflow Seasonal Outlook
> 0.93	> 2.0	Very Wet
0.71 to 0.93	1.51 to 2.0	Wet
0.35 to 0.70	0.75 to 1.5	Normal
< 0.35	< 0.75	Dry

****Volume-depth conversion based on average lake surface area of 467,000 acres**

Classification of Lake Okeechobee Net Inflow Multi-Seasonal Outlook*

Lake Net Inflow Prediction [million acre-feet]	Equivalent Depth** [feet]	Lake Okeechobee Net Inflow Multi-Seasonal Outlook
> 2.0	> 4.3	Very Wet
1.18 to 2.0	2.51 to 4.3	Wet
0.5 to 1.17	1.1 to 2.5	Normal
< 0.5	< 1.1	Dry

**Volume-depth conversion based on average lake surface area of 467,000 acres

6-15 Day Precipitation Outlook Categories*

6-15 Day Precipitation Outlook Categories	WSE Decision Tree Categories
Above Normal	Wet to Very Wet
Normal	Normal
Below Normal	Dry

* Corresponds to Table 7-6 in the Lake Okeechobee Water Control Plan