

# Application of the Lake Okeechobee Regulation Schedule (LORS2008) on 10/16/2023 (ENSO Condition: El Niño)

## Lake Okeechobee Net Inflow Outlook:

The Lake Okeechobee Net Inflow Outlook has been computed using methods described in the LORS2008 Water Control Plan: Croley's method, the SFWMD empirical method, a sub-sampling of El Niño years and a sub-sampling of warm years of the Atlantic Multi-decadal Oscillation (AMO) in combination with El Niño ENSO years. The results for Croley's method and the SFWMD empirical method are based on the CPC Outlook.

Table of the Lake Okeechobee Net Inflow Outlooks in feet of equivalent depth. All methods are updated on a weekly basis with observed net inflow for the current month.

Season	Croley's Method*		SFWMD Empirical Method		Sub-sampling of El Niño ENSO Years**		Sub-sampling of AMO Warm + El Niño ENSO Years***	
	Value (ft)	<u>Condition</u>	Value (ft)	<u>Condition</u>	Value (ft)	<u>Condition</u>	Value (ft)	<u>Condition</u>
Current (Oct-Mar)	N/A	N/A	1.77	Wet	2.32	Very Wet	2.77	Very Wet
Multi Seasonal**** (Nov-Oct)	N/A	N/A	3.49	Wet	4.40	Very Wet	5.79	Very Wet

\*Croley's Method Not Produced for This Report

See Seasonal and Multi-Seasonal tables for the classification of Lake Okeechobee Outlooks.

The recommended methods and values for estimating the Lake Okeechobee Net Inflow Outlook are shaded and should be used in the LORS2008 Release Guidance Flow Charts.

\*\*Sub-sampling is a weighted average of ENSO conditions based on the IRI ENSO forecast published.

\*\*\*Sub-sampling based on combination of ENSO and AMO conditions. For this predominant ENSO categorization is used instead of weights.

\*\*\*\* LORS 2008 Water Control Plan calls for the forcing of a 12-month window to evaluate the multi-seasonal Lake Okeechobee Net Inflow Outlook which has been done this week as we are in a transitional period of seasons with above normal rainfall forecasted.

## **Tributary Hydrologic Conditions:**

**8490 cfs** 14-day running average for Lake Okeechobee Net Inflow through 10/16/2023. According to the classification in Tributary Hydrologic Conditions table, this condition is Very Wet.

**-1.93** for Palmer Drought Index on 10/14/2023.

According to the classification in Tributary Hydrologic Conditions table, this condition is Dry.

The wetter of the two conditions above is **Very Wet**.

## **LORS2008 Classification Tables:**

### **Lake Okeechobee Stage on 10/16/2023:**

Lake Okeechobee Stage: **16.34 feet**

Lake Okeechobee Management Zone/Band		Bottom Elevation (feet, NGVD)	Current Lake Stage
High Lake Management Band		16.98	
Operational Band	High sub-band	16.61	
	Intermediate sub-band	16.07	← 16.34 ft
	Low sub-band	14.50	
Base Flow sub-band		12.94	
Beneficial Use sub-band		12.91	
Water Shortage Management Band			

**Part C of LORS2008: Discharge to WCAs**

No Releases to WCAs

**Part D of LORS2008: Discharge to Tide\***

Up to 4000 cfs at S-77 and up to 1800 cfs at S-80.

\*- The 1-month (October) CPC precipitation outlook was used to assess the Up to 30-day Meteorological Forecast as Normal (CPC indicates equal chances of below normal, normal and above normal for south Florida for the month of October).

**LORS2008 Implementation on 10/16/2023 (ENSO Condition- El Niño):**

**Status for week ending 10/16/2023\*:**

**Water Supply Risk Evaluation**

Area	Indicator	Value	Color Coded Scoring Scheme
LOK	Projected LOK Stage for the next two months	Intermediate Sub-band	L
	Palmer Drought Index for LOK Tributary Conditions	-1.93 (Dry)	M
	CPC Precipitation Outlook	1 month: Equal Chances	L
		3 months: Above Normal	L
	LOK Seasonal Net Inflow Outlook	2.32 ft	L
	ENSO Forecast	Normal to Extremely Wet	L
	LOK Multi-Seasonal Net Inflow Outlook	2.41 ft	M
	ENSO Forecast	Normal	M
WCAs	WCA 1: 3 Station Average (Sites 1-7, 1-8T, and 1-9)	Above Line 1 (17.38 ft)	L
	WCA 2A: Site 2-17	Above Line 1 (13.66 ft)	L
	WCA-3A: 3 Station Average (Sites 63, 64, and 65)	Above Line 1 (11.38 ft)	L
LEC	Service Area 1	Year-Round Irrigation Rule in effect	L
	Service Area 2	Year-Round Irrigation Rule in effect	L
	Service Area 3	Year-Round Irrigation Rule in effect	L


Note: The water supply risk classification based on the Palmer index, as well as the LOK seasonal and multi-seasonal net inflow outlooks use slightly different classification intervals than those used by the 2008-LORS.

---

\*- S-80 flow data for 10/15 is not available from USACE Daily Reports and was assumed to be 0. L8 Canal Pt flow data for 10/11 & 10/12 is not available from USACE Daily Reports and was substituted with alternative data sources from USGS. Water Supply Risk Evaluation LOK Multi-Seasonal Net Inflow Outlook is based on 7-month window. LORS2008 release guidance is using a 12-month window for evaluation.



# Lake Okeechobee SFWMM October 2023 Position Analysis

Percentiles PA

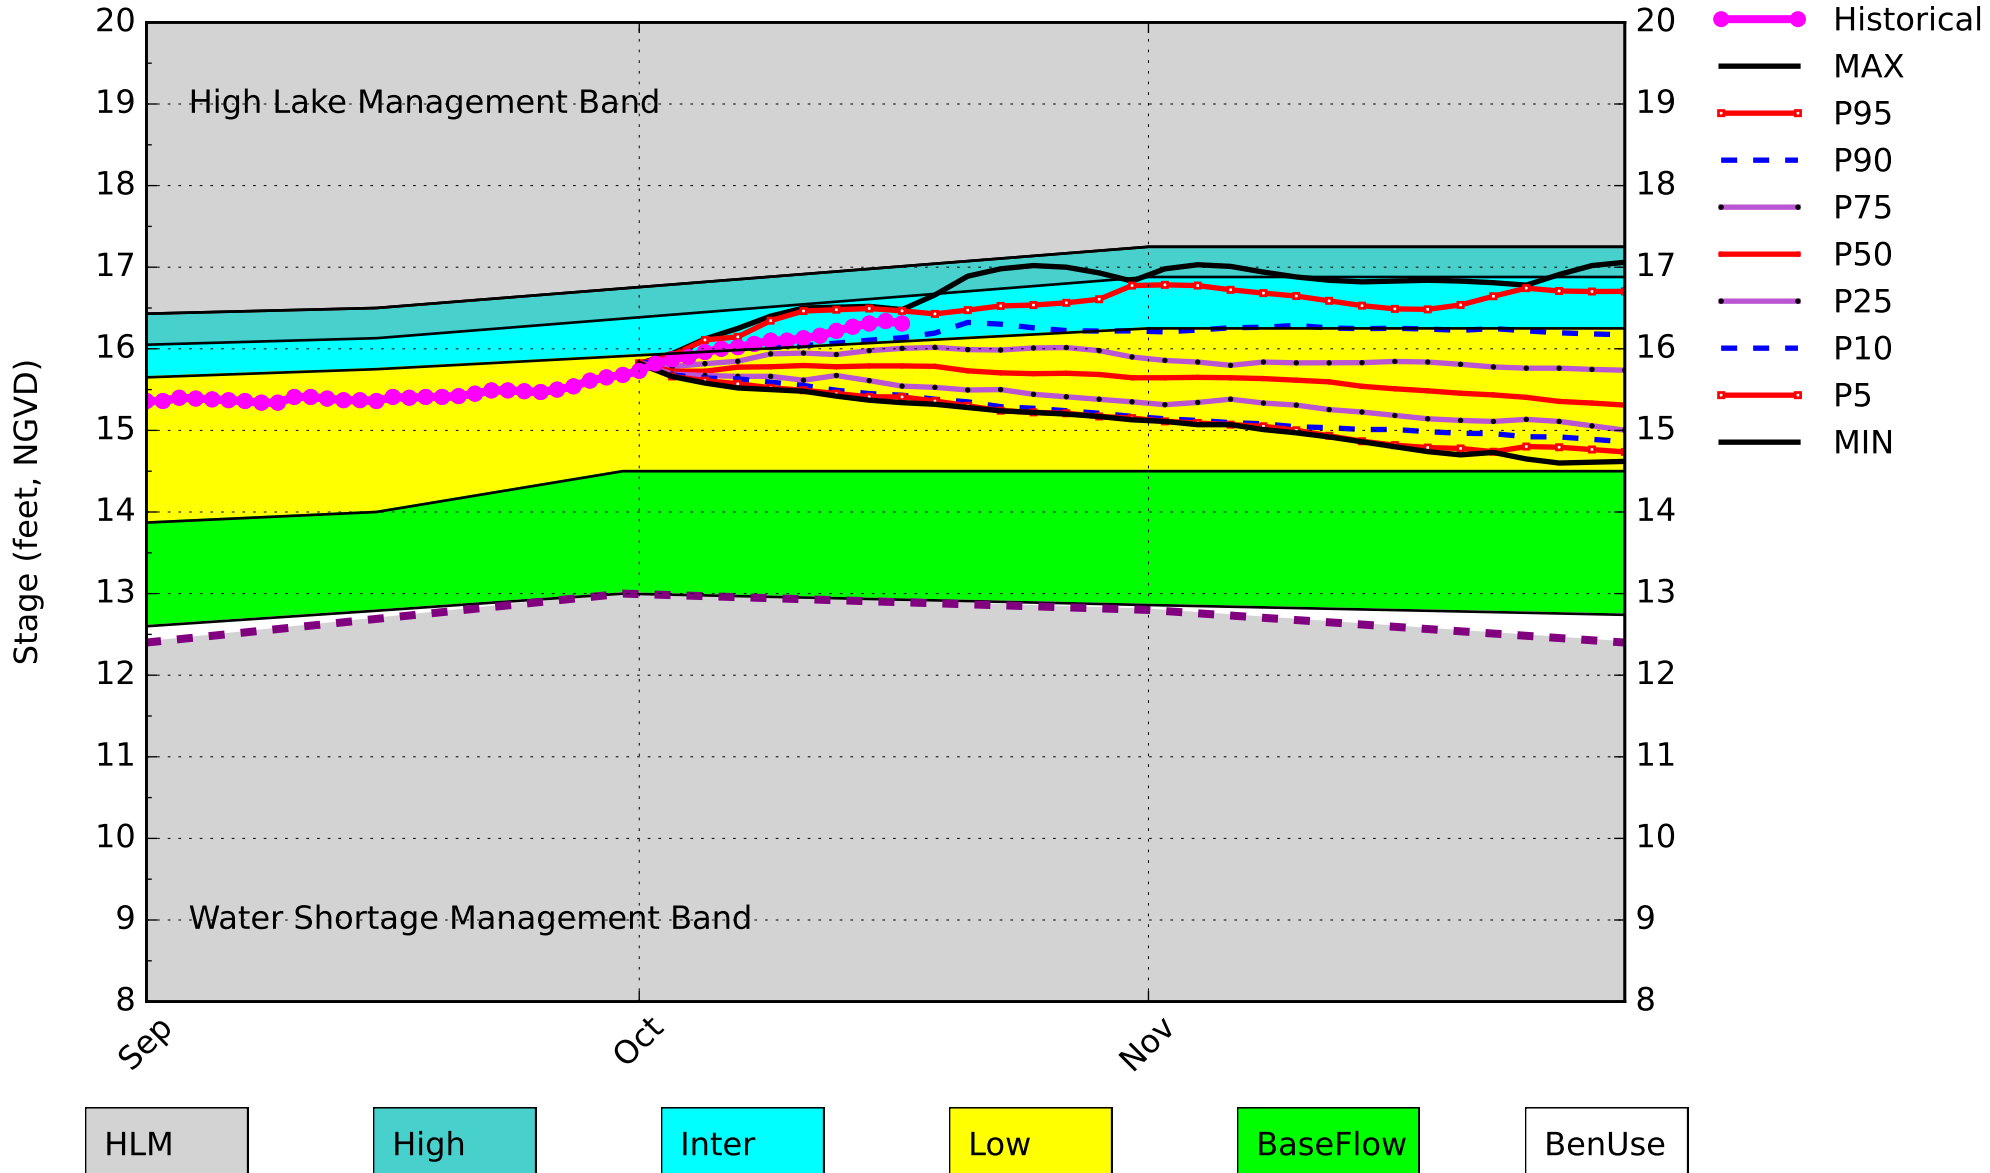

(See assumptions on the Position Analysis Results website)

Tributary Basin Condition Indicators as of October 15 2023

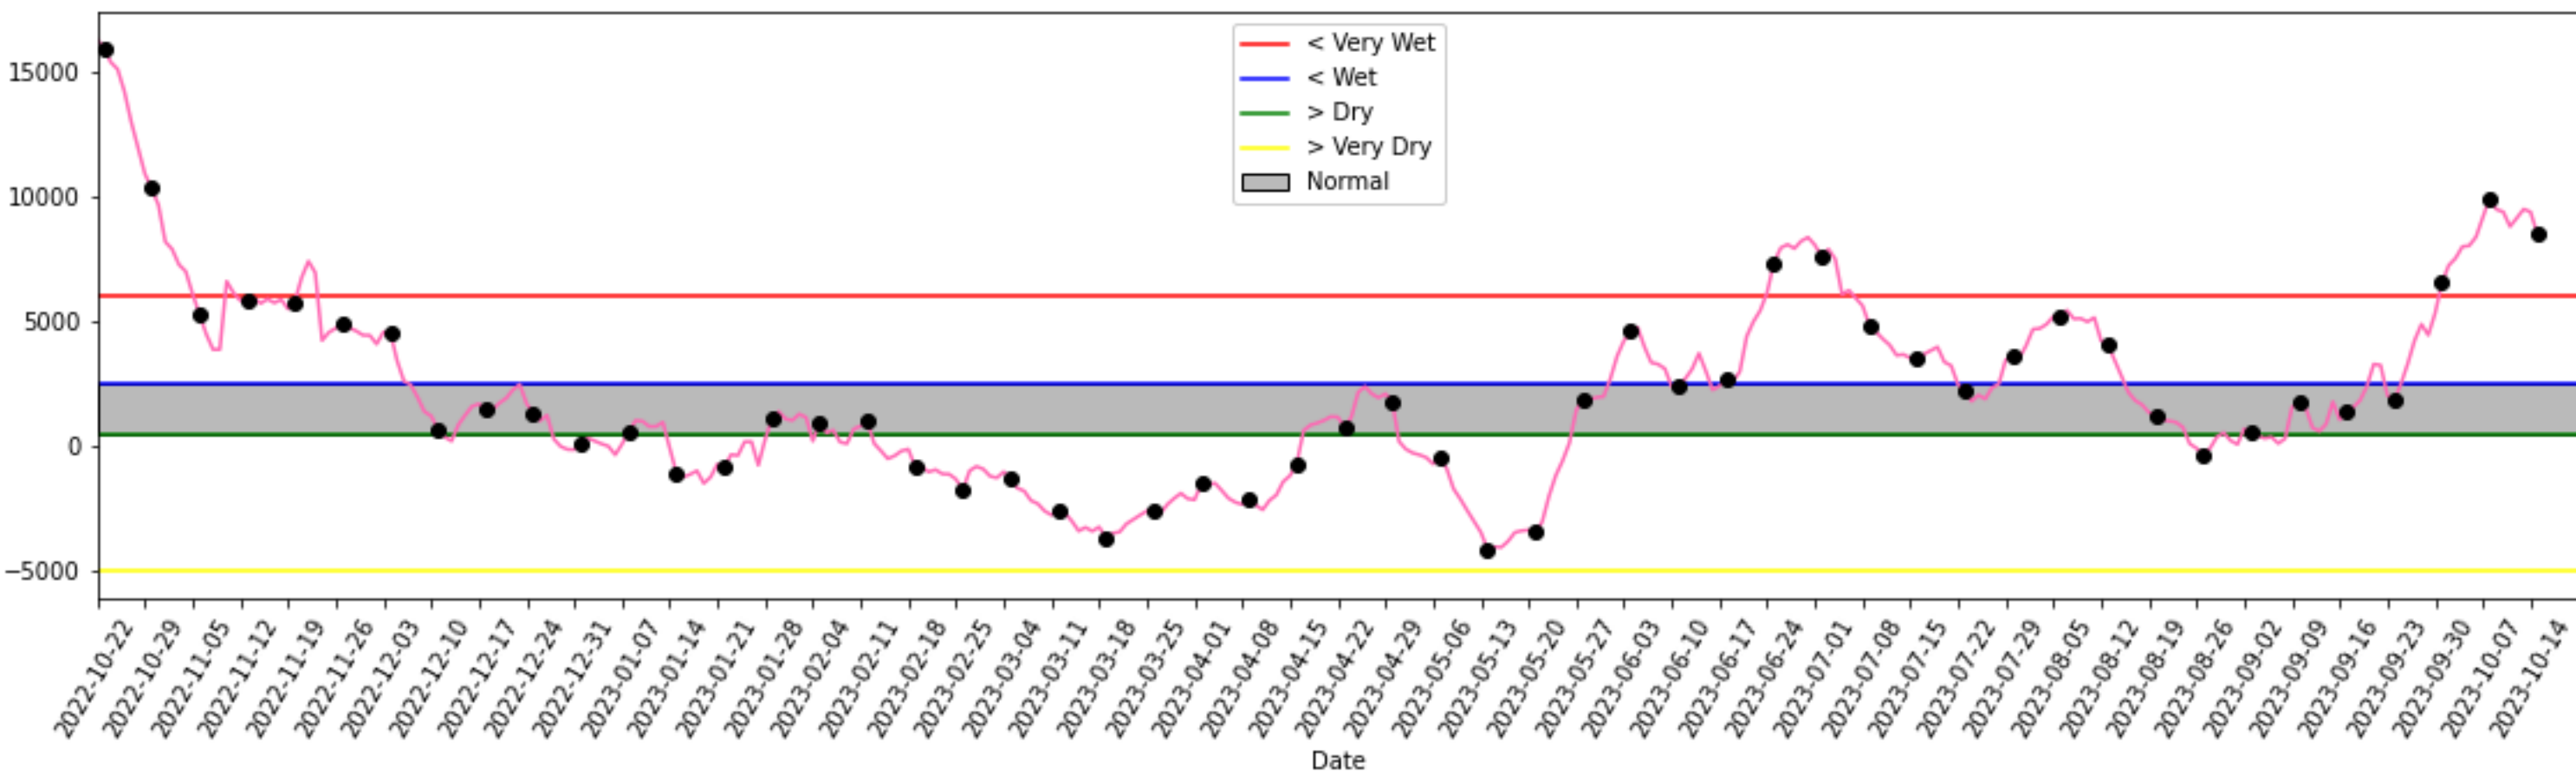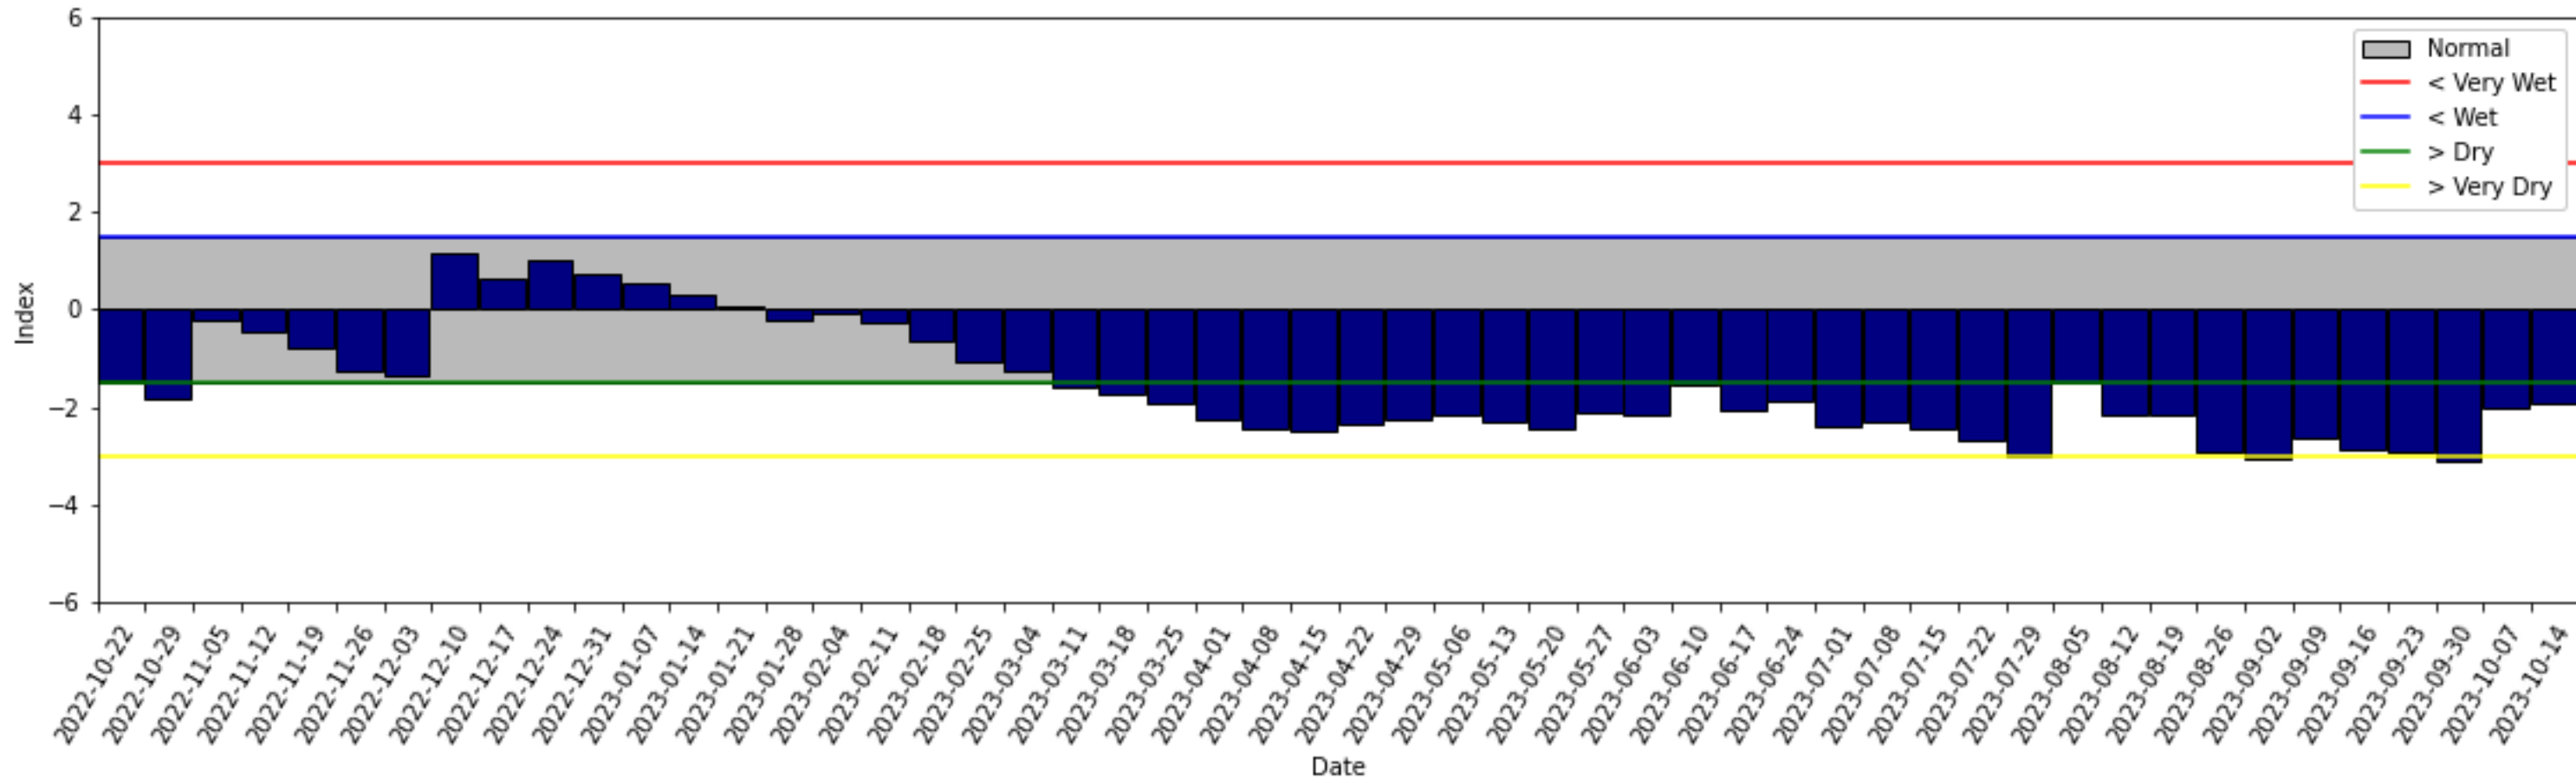

# 2008 LORS

## Part C: Establish Allowable Lake Okeechobee Releases to the Water Conservation Areas

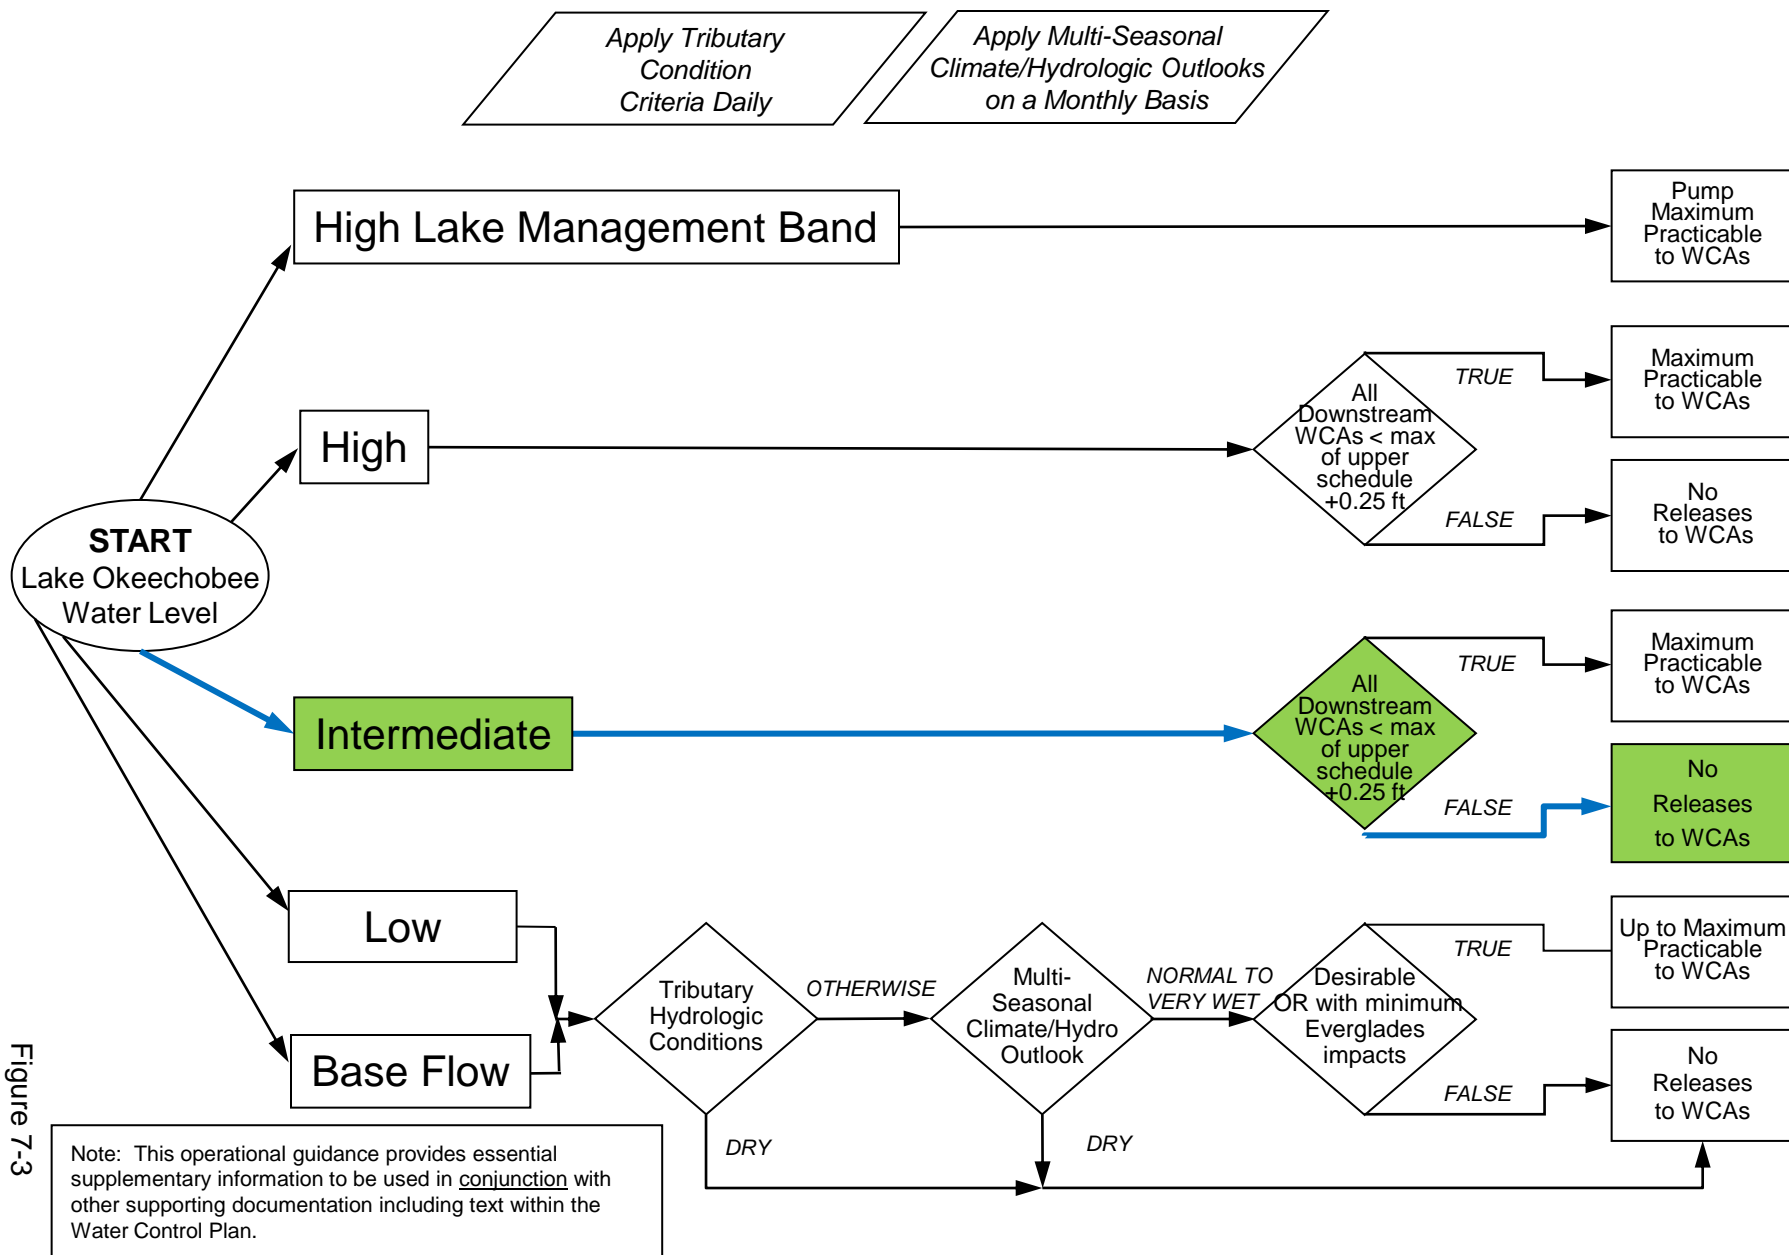


Figure 7-3

# 2008 LORS

## Part D: Establish Allowable Lake Okeechobee Releases to Tide (Estuaries)

Note: This operational guidance provides essential supplementary information to be used in conjunction with other supporting documentation including text within the Water Control Plan.

When conducting Base Flow releases, flows can be distributed East and West up to 650 cfs as needed to minimize impacts or provide benefits through S-80 and S-79

Apply Meteorological Forecasts on a Weekly Basis; apply Seasonal and Multi-Seasonal Climate/Hydrologic Outlooks on a Monthly Basis


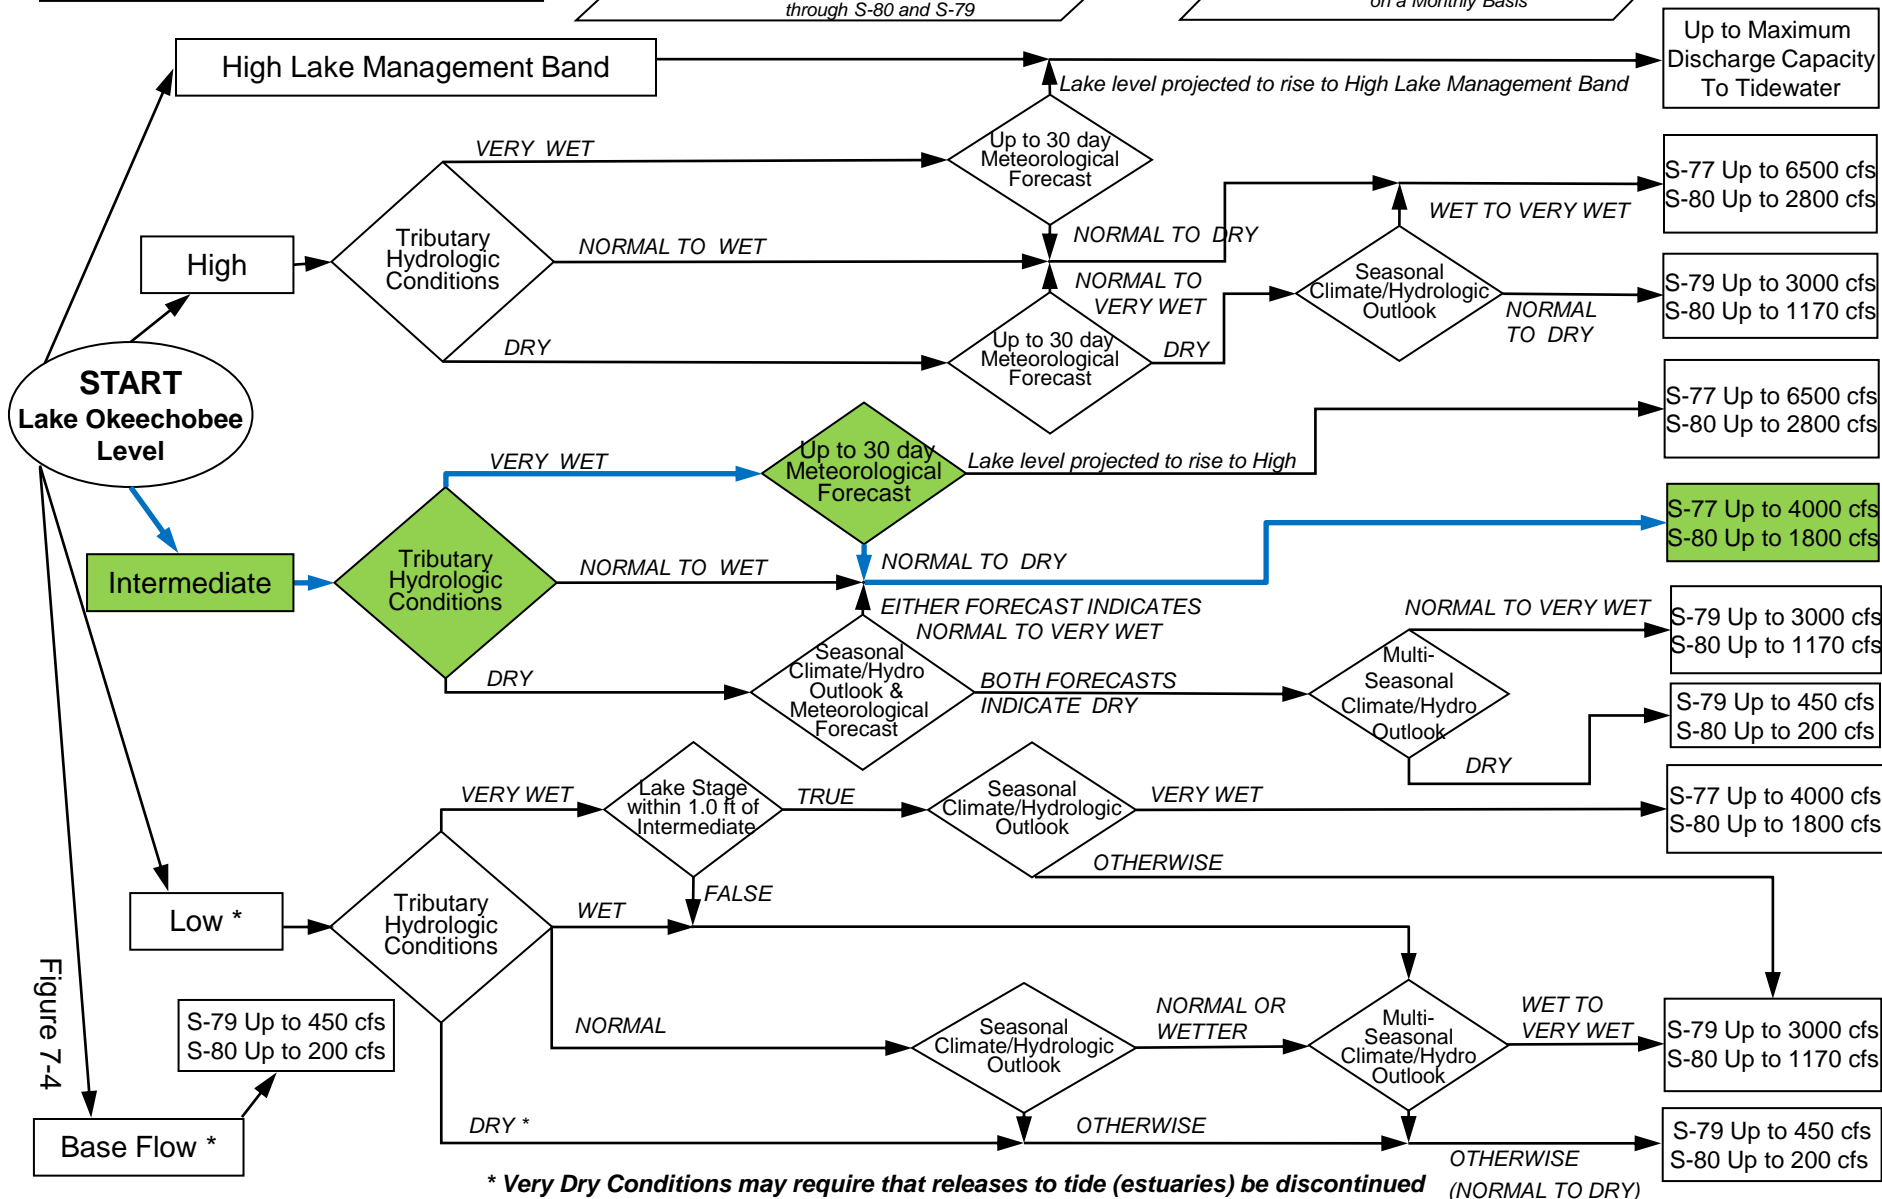


Figure 7-4



# Lake Okeechobee Water Level History and Projected Stages

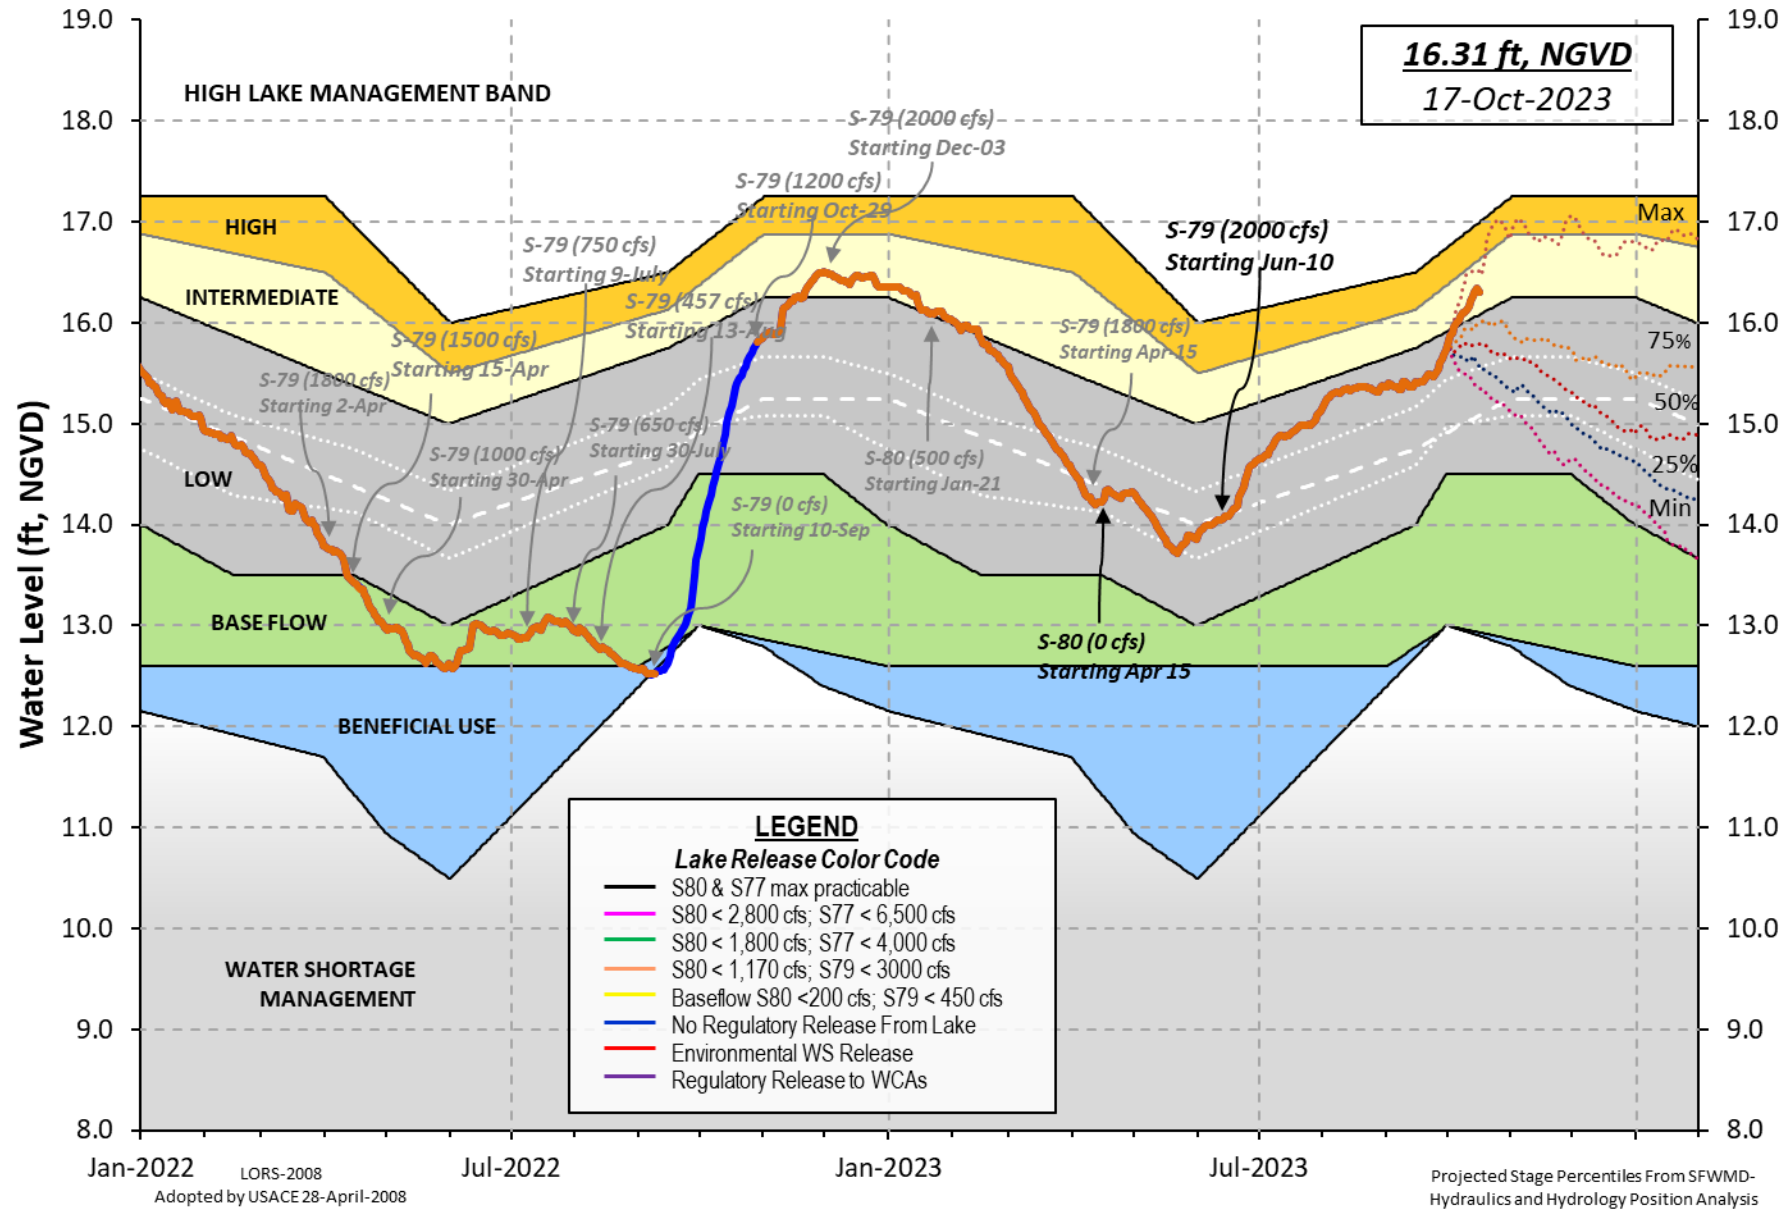

U. S. Army Corps of Engineers, Jacksonville District  
 Lake Okeechobee and Vicinity Report  
 \*\* Preliminary Data - Subject to Revision \*\*

Data Ending 2400 hours 15 OCT 2023

---

Okeechobee Lake Regulation	Elevation (ft-NGVD)	Last Year (ft-NGVD)	2YRS Ago (ft-NGVD)
*Okeechobee Lake Elevation	16.34	15.11	15.88 (Official Elv)
Bottom of High Lake Mngmt=	16.98	Top of Water Short Mngmt=	12.91
Currently in Operational Management Band			

Simulated Average LORS2008 [1965-2000]	13.97
Difference from Average LORS2008	2.37

15OCT (1965-2007) Period of Record Average	15.04
Difference from POR Average	1.30

Today Lake Okeechobee elevation is determined from the 4 Int & 4 Edge stations

++Navigation Depth (Based on 2007 Channel Condition Survey) Route 1  $\blacklozenge$  10.28'  
 ++Navigation Depth (Based on 2008 Channel Condition Survey) Route 2  $\blacklozenge$  8.48'  
 Bridge Clearance = 49.62'

---

4 Interior and 4 Edge Okeechobee Lake Average (Avg-Daily values):

L001	L005	L006	LZ40	S4	S352	S308	S133
16.36	16.20	16.38	16.34	16.21	16.60	16.49	16.24

\*Combination Okeechobee Avg-Daily Lake Average = 16.34  
 (\*See Note)

---

Okeechobee Inflows (cfs):

S65E	4109	S65EX1	0	Fisheating Cr	706
S154	67	S191	97	S135 Pumps	206
S84	296	S133 Pumps	0	S2 Pumps	0
S84X	77	S127 Pumps	0	S3 Pumps	0
S71	317	S129 Pumps	60	S4 Pumps	0
S72	384	S131 Pumps	0	C5	0
Total Inflows:	6318				

Okeechobee Outflows (cfs):

S135 Culverts	0	S354	0	S77	339
S127 Culverts	0	S351	0	S308	5
S129 Culverts	0	S352	0		
S131 Culverts	0	L8 Canal Pt	98		
Total Outflows:	441				

\*\*\*\*S77 below flow meter is being used to compute Total Outflow.  
 \*\*\*\*S308 structure flow is being used to compute Total Outflow.

Okeechobee Pan Evaporation (inches):

S77	0.24	S308	0.33
Average Pan Evap x 0.75 Pan Coefficient = 0.21" = 0.02'			

Lake Average Precipitation using NEXRAD: = -NR-" = -NR-'

Evaporation - Precipitation: = -NR-" = -NR-'  
 Evaporation - Precipitation using Lake Area of 730 square miles

is equal to -NR-  
 Lake Okeechobee (Change in Storage) Flow is 6806 cfs or 13500 AC-FT

	Headwater Elevation (ft-msl)	Tailwater Elevation (ft-msl)	Disch (cfs)	----- Gate Positions -----							
				#1 (ft)	#2 (ft)	#3 (ft)	#4 (ft)	#5 (ft)	#6 (ft)	#7 (ft)	#8 (ft)
(I) see note at bottom											
<b>North East Shore</b>											
S133 Pumps:	13.56	16.23	0	0	0	0	0	0	0	0	(cfs)
S193:											
S191:	18.52	16.23	97	0.0	0.5	0.0					
S135 Pumps:	13.45	16.29	206	49	49	55	55				(cfs)
S135 Culverts:			0	0.0	0.0						
<b>North West Shore</b>											
S65E:	21.04	16.14	4109	1.6	1.6	2.3	2.3	2.3	1.9		
S65EX1:	21.04	16.14	0								
S127 Pumps:	13.57	16.15	0	0	0	0	0	0			(cfs)
S127 Culvert:			0	0.0							
S129 Pumps:	12.89	16.12	60	0	54	6					(cfs)
S129 Culvert:			0	0.0							
S131 Pumps:	13.11	-NR-	0	0	0						(cfs)
S131 Culvert:			0								
<b>Fisheating Creek</b>											
nr Palmdale		32.63	706								
nr Lakeport											
S282	16.02	16.07		0.0	0.0	0.1					
<b>South Shore</b>											
S4 Pumps:	11.76	-NR-	0	-NR-	-NR-	-NR-					(cfs)
S169:	14.60	-NR-	-NR-	-NR-	-NR-	-NR-					
S310:			-NR-								
S3 Pumps:	10.36	16.43	0	0	0	0					(cfs)
S354:	16.43	10.36	0	0.0	0.0						
S2 Pumps:	9.93	16.55	0	0	0	0	0				(cfs)
S351:	16.55	9.93	0	0.0	0.0	0.0					
S352:	16.61	10.63	0	0.0	0.0						
S271:	16.76	14.51	0	0.0	-NR-	0.0	0.0				
L8 Canal PT		14.19	98								

S351 and S352 Temporary Pumps/S354 Spillway

S351:	9.93	16.55	0	-NR-	-NR-	-NR-	-NR-	-NR-	-NR-		
S352:	10.63	16.61	0	-NR-	-NR-	-NR-	-NR-				
S354:	10.36	16.43	0	-NR-	-NR-	-NR-	-NR-				

Caloosahatchee River (S77, S78, S79)

S47B:	12.70	12.33		2.0	2.0						
S47D:	12.30	10.84	38	0.0							
S77:											
Spillway and Sector Preferred Flow:	15.81	10.93	334	0.0	0.0	0.0	0.0				
Flow Due to Lockages+:			5								

S78:

Spillway and Sector Flow:  
 10.75 2.99 857 0.0 0.0 2.5 0.0  
 Flow Due to Lockages+: -NR-

S79:

Spillway and Sector Flow:  
 3.12 1.31 2172 0.0 0.0 2.0 2.0 3.0 2.0 0.0 0.0  
 Flow Due to Lockages+: 6  
 Percent of flow from S77 15%  
 Chloride (ppm) 0

St. Lucie Canal (S308, S80)

S308:

Spillway and Sector Preferred Flow:  
 16.48 13.88 0 0.0 0.0 0.0 0.0  
 Flow Due to Lockages+: 5

S153: 18.95 13.69 73 0.0 0.0

S80:

Spillway and Sector Flow:  
 13.97 2.50 0 0.0 0.0 0.0 0.0 0.0 0.0 0.0  
 Flow Due to Lockages+: -NR-  
 Percent of flow from S308 NA %

Steele Point Top Salinity (mg/ml) \*\*\*\*

Steele Point Bottom Salinity (mg/ml) \*\*\*\*

Speedy Point Top Salinity (mg/ml) \*\*\*\*

Speedy Point Bottom Salinity (mg/ml) \*\*\*\*

+ Flow Due to lockages is computed utilizing average daily headwater and tailwater along with total number of lockages for the day to calculate a volume which is then converted to an average discharge in cfs.

++ Preferred flow is determined from either the spillway discharge or the below flow meter daily

Daily Precipitation Totals	1-Day (inches)	3-Day (inches)	7-Day (inches)	----- Wind -----	
				Direction (Deg)	Speed (mph)
S133 Pump Station:	-NR-	0.00	0.00		
S193:	-NR-	0.00	0.00	-NR-	-NR-
Okeechobee Field Station:	-NR-	0.00	0.00		
S135 Pump Station:	-NR-	0.00	0.00		
S127 Pump Station:	-NR-	0.00	0.00		
S129 Pump Station:	-NR-	0.00	0.00		
S131 Pump Station:	-NR-	0.00	0.00		
S77:	0.00	0.87	1.25	311	2
S78:	0.00	0.00	0.00	300	2
S79:	3.09	3.35	5.05	299	2
S4 Pump Station:	-NR-	0.00	0.00		
Clewiston Field Station:	-NR-	0.00	0.00		
S3 Pump Station:	-NR-	0.00	0.00		
S2 Pump Station:	-NR-	0.00	0.00		
S308:	0.00	0.00	0.00	311	22
S80:	4.41	4.51	4.67	302	6
Okeechobee Average (Sites S78, S79 and S80 not included)	0.00	0.07	0.10		
-----					
Oke Nexrad Basin Avg	-NR-	0.00	0.00		
-----					

Okeechobee Lake Elevations 15 OCT 2023 16.34 Difference from 15OCT23  
 15OCT23 -1 Day = 14 OCT 2023 16.31 -0.03

15OCT23	-2 Days =	13 OCT 2023	16.27	-0.07
15OCT23	-3 Days =	12 OCT 2023	16.22	-0.12
15OCT23	-4 Days =	11 OCT 2023	16.16	-0.18
15OCT23	-5 Days =	10 OCT 2023	16.13	-0.21
15OCT23	-6 Days =	09 OCT 2023	16.10	-0.24
15OCT23	-7 Days =	08 OCT 2023	16.10	-0.24
15OCT23	-30 Days =	15 SEP 2023	15.41	-0.93
15OCT23	-1 Year =	15 OCT 2022	15.11	-1.23
15OCT23	-2 Year =	15 OCT 2021	15.88	-0.46

Long Term Mean 30day Avearge ET for Lake Alfred (Inches) = -NR-

Lake Okeechobee Net Inflow (LONIN)

		Average Flow over the previous 14 days		Avg-Daily Flow
15OCT23	Today =	15 OCT 2023	8195 MON	7140
15OCT23	-1 Day =	14 OCT 2023	9226 SUN	9359
15OCT23	-2 Days =	13 OCT 2023	9352 SAT	11344
15OCT23	-3 Days =	12 OCT 2023	8952 FRI	-NR-
15OCT23	-4 Days =	11 OCT 2023	8930 THU	-NR-
15OCT23	-5 Days =	10 OCT 2023	9376 WED	7321
15OCT23	-6 Days =	09 OCT 2023	9476 TUE	231
15OCT23	-7 Days =	08 OCT 2023	9936 MON	9217
15OCT23	-8 Days =	07 OCT 2023	9142 SUN	9221
15OCT23	-9 Days =	06 OCT 2023	8372 SAT	4894
15OCT23	-10 Days =	05 OCT 2023	8023 FRI	9231
15OCT23	-11 Days =	04 OCT 2023	7988 THU	13035
15OCT23	-12 Days =	03 OCT 2023	7522 WED	6507
15OCT23	-13 Days =	02 OCT 2023	7239 TUE	10840

S65E

		Average Flow over previous 14 days		Avg-Daily Flow
15OCT23	Today=	15 OCT 2023	4190 MON	4291
15OCT23	-1 Day =	14 OCT 2023	4100 SUN	4725
15OCT23	-2 Days =	13 OCT 2023	3929 SAT	4986
15OCT23	-3 Days =	12 OCT 2023	3719 FRI	4962
15OCT23	-4 Days =	11 OCT 2023	3520 THU	4941
15OCT23	-5 Days =	10 OCT 2023	3275 WED	4956
15OCT23	-6 Days =	09 OCT 2023	3011 TUE	4684
15OCT23	-7 Days =	08 OCT 2023	2764 MON	4360
15OCT23	-8 Days =	07 OCT 2023	2539 SUN	3912
15OCT23	-9 Days =	06 OCT 2023	2339 SAT	3660
15OCT23	-10 Days =	05 OCT 2023	2153 FRI	3533
15OCT23	-11 Days =	04 OCT 2023	1984 THU	3344
15OCT23	-12 Days =	03 OCT 2023	1792 WED	3275
15OCT23	-13 Days =	02 OCT 2023	1602 TUE	3037

S65EX1

		Average Flow over previous 14 days		Avg-Daily Flow
15OCT23	Today=	15 OCT 2023	0 MON	0
15OCT23	-1 Day =	14 OCT 2023	0 SUN	0
15OCT23	-2 Days =	13 OCT 2023	0 SAT	0
15OCT23	-3 Days =	12 OCT 2023	0 FRI	0
15OCT23	-4 Days =	11 OCT 2023	0 THU	0
15OCT23	-5 Days =	10 OCT 2023	0 WED	0
15OCT23	-6 Days =	09 OCT 2023	0 TUE	0
15OCT23	-7 Days =	08 OCT 2023	0 MON	0
15OCT23	-8 Days =	07 OCT 2023	0 SUN	0
15OCT23	-9 Days =	06 OCT 2023	0 SAT	0
15OCT23	-10 Days =	05 OCT 2023	0 FRI	0
15OCT23	-11 Days =	04 OCT 2023	0 THU	0
15OCT23	-12 Days =	03 OCT 2023	0 WED	0
15OCT23	-13 Days =	02 OCT 2023	0 TUE	0

## Lake Okeechobee Outlets Last 14 Days

DATE	S-77 Discharge (ALL DAY) (AC-FT)	Below S-77 Discharge (ALL-DAY) (AC-FT)	S-78 Discharge (ALL DAY) (AC-FT)	S-79 Discharge (ALL DAY) (AC-FT)
15 OCT 2023	334	662	-NR-	4319
14 OCT 2023	248	564	1748	4193
13 OCT 2023	3	461	1729	5427
12 OCT 2023	5	839	1671	3563
11 OCT 2023	-NR-	266	1717	4735
10 OCT 2023	-NR-	1021	1811	4332
09 OCT 2023	-NR-	458	1884	3908
08 OCT 2023	-NR-	275	1842	5641
07 OCT 2023	-NR-	285	1281	3910
06 OCT 2023	626	855	3371	7643
05 OCT 2023	1147	1236	3624	10141
04 OCT 2023	8	412	4908	13327
03 OCT 2023	1	397	4552	13952
02 OCT 2023	6	824	8180	20083

DATE	S-310 Discharge (ALL DAY) (AC-FT)	S-351 Discharge (ALL DAY) (AC-FT)	S-352 Discharge (ALL DAY) (AC-FT)	S-354 Discharge (ALL DAY) (AC-FT)	L8 Canal Pt Discharge (ALL DAY) (AC-FT)
15 OCT 2023	-NR-	0	0	0	194
14 OCT 2023	9	0	0	0	202
13 OCT 2023	-NR-	0	0	0	199
12 OCT 2023	-NR-	0	0	0	-NR-
11 OCT 2023	9	0	0	0	-NR-
10 OCT 2023	7	0	0	0	209
09 OCT 2023	-3	0	0	0	215
08 OCT 2023	-0	0	0	0	208
07 OCT 2023	-4	0	0	0	199
06 OCT 2023	4	0	0	0	200
05 OCT 2023	4	0	0	0	211
04 OCT 2023	9	0	0	0	219
03 OCT 2023	-NR-	0	0	0	228
02 OCT 2023	8	0	0	0	228

DATE	S-308 Discharge (ALL DAY) (AC-FT)	Below S-308 Discharge (ALL-DAY) (AC-FT)	S-80 Discharge (ALL-DAY) (AC-FT)
15 OCT 2023	9	-NR-	-NR-
14 OCT 2023	9	-NR-	10
13 OCT 2023	6	-NR-	32
12 OCT 2023	2	-NR-	4
11 OCT 2023	7	-NR-	24
10 OCT 2023	5	-NR-	24
09 OCT 2023	4	-NR-	42
08 OCT 2023	9	-NR-	42
07 OCT 2023	5	-NR-	28
06 OCT 2023	4	-NR-	28
05 OCT 2023	7	-NR-	40
04 OCT 2023	4	-NR-	27
03 OCT 2023	3	-NR-	17
02 OCT 2023	3	-NR-	24

\*\*\* NOTE: Discharge (ALL DAY) is computed using Spillway, Sector Gate and Lockages Discharges from 0015 hrs to 2400 hrs.

(I) - Flows preceded by "I" signify an instantaneous flow computed from the single value reported for the day


- 
- \* On 11 May 1999, Lake Okeechobee Elevation was switched from Instantaneous 2400 value to an average-daily lake average.
  - On 14 Mar 2001, due to the isolation of various gages within the standard 10 stations, the average of the interior 4 station gages was used as the Lake Okeechobee Elevation.
  - On 05 November 2010, Lake Okeechobee Elevation was switched to a 9 gage mix of interior and edge gages to obtain a more reliable representation of the lake level.
  - On 09 May 2011, Lake Okeechobee Elevation was switched to a 8 gage mix of interior and edge gages to obtain a more reliable representation of the lake level due to isolation of S135 from low lake levels.
  - Today Lake Okeechobee elevation is determined from the 4 Int & 4 Edge stations
- ++ For more information see the Jacksonville District Navigation website at <http://www.saj.usace.army.mil/>
- \$ For information regarding Lake Okeechobee Service Area water restrictions please refer to [www.sfwmd.gov](http://www.sfwmd.gov)

---

Report Generated 16OCT2023 @ 14:15 \*\* Preliminary Data - Subject to Revision \*\*

# Lake Okeechobee

16OCT23 14:17:20

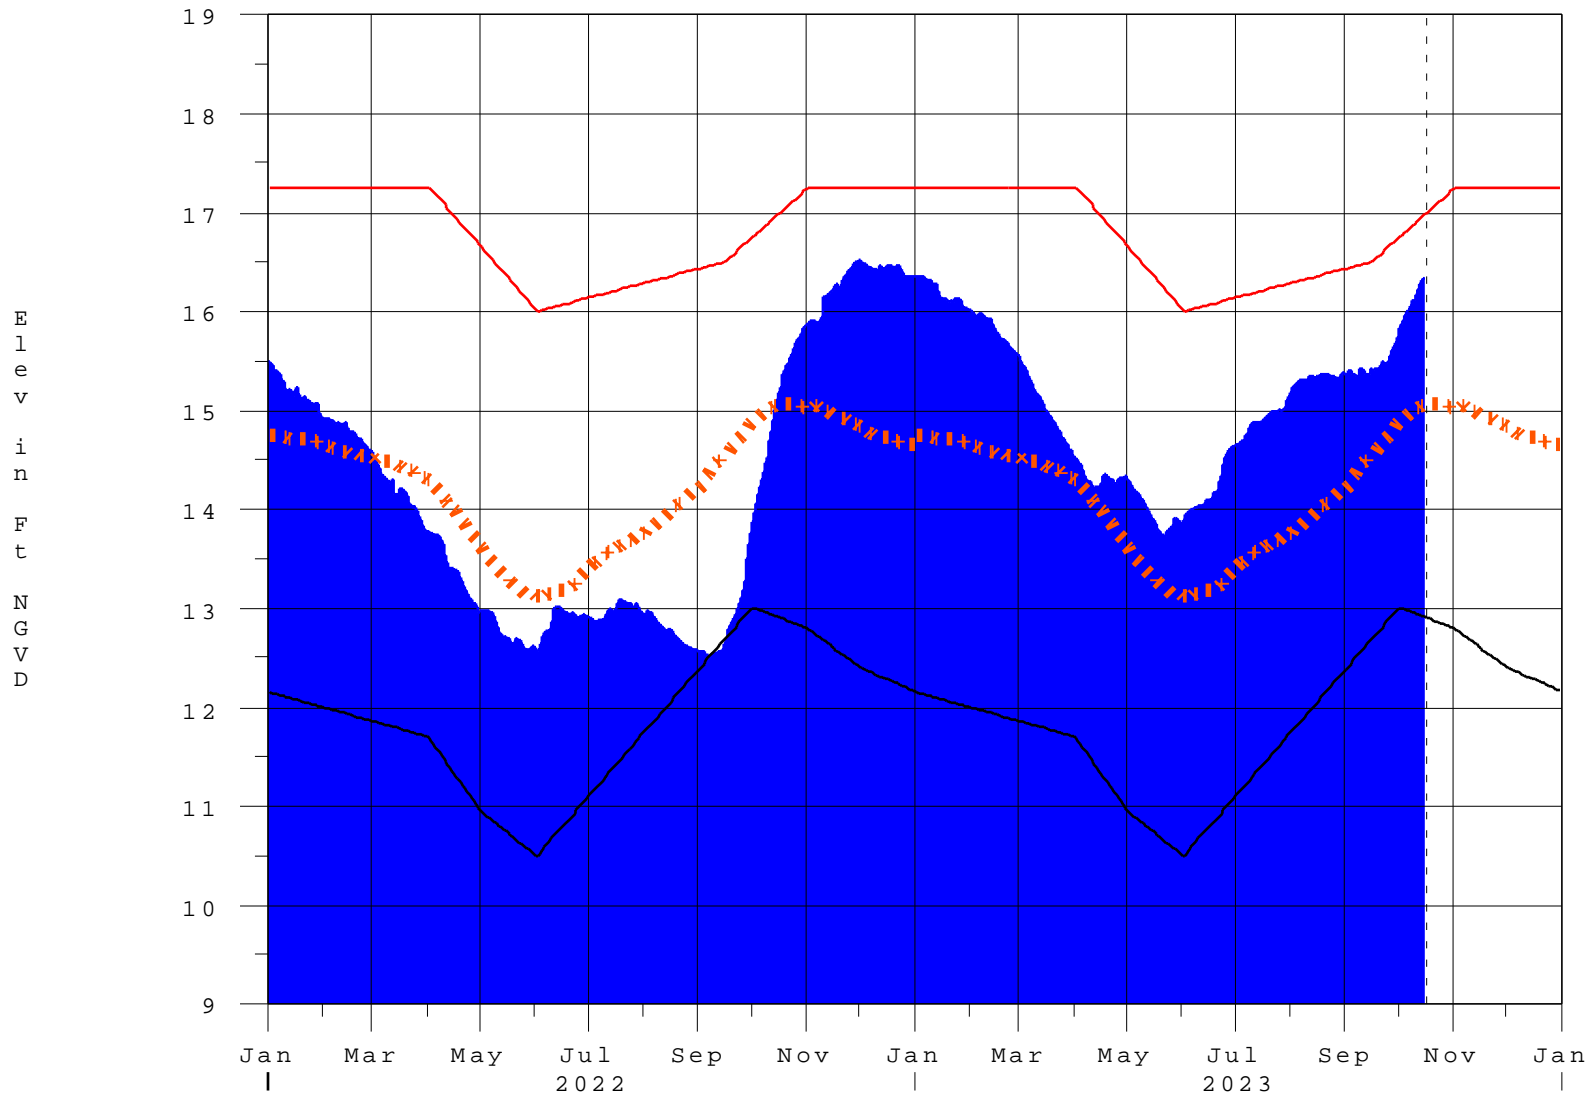

- High Lake Management
- Okeechobee Avg Elev
- Average Elev [1965-2007]
- Water Shortage Management



# Classification Tables

---

Supplemental Tables used in conjunction with the LORS2008 Release

Guidance Flow Charts

- [Class Limits for Tributary Hydrologic Conditions](#)

Table K-2 in the Lake Okeechobee Water Control Plan

- [6-15 Day Precipitation Outlook Categories](#)

Table ?? in the Lake Okeechobee Water Control Plan

- [Classification of Lake Okeechobee Net Inflow for Seasonal Outlook](#)

Table K-3 in the Lake Okeechobee Water Control Plan

- [Classification of Lake Okeechobee Net Inflow for Multi-Seasonal Outlook](#)

Table K-4 in the Lake Okeechobee Water Control Plan

---

[Back to Lake Okeechobee Operations Main Page](#)

[Back to U.S. Army Corps of Engineers Lake Okeechobee Operations Homepage](#)

Tributary Hydrologic Classification*	Palmer Index Class Limits	2-wk Mean L.O. Net Inflow Class Limits
Very Wet	3.0 or greater	Greater $\geq$ 6000 cfs
Wet	1.5 to 2.99	2500 - 5999 cfs
Near Normal	-1.49 to 1.49	500 - 2499 cfs
Dry	-2.99 to -1.5	-5000 – 500 cfs
Very Dry	-3.0 or less	Less than -5000 cfs

\* use the wettest of the two indicators

**Classification of Lake Okeechobee Net Inflow Seasonal Outlook\***

<b>Lake Net Inflow Prediction</b> <b>[million acre-feet]</b>	<b>Equivalent Depth**</b> <b>[feet]</b>	<b>Lake Okeechobee Net Inflow Seasonal Outlook</b>
<p>&gt; 0.93</p>	<p>&gt; 2.0</p>	<p>Very Wet</p>
<p>0.71 to 0.93</p>	<p>1.51 to 2.0</p>	<p>Wet</p>
<p>0.35 to 0.70</p>	<p>0.75 to 1.5</p>	<p>Normal</p>
<p>&lt; 0.35</p>	<p>&lt; 0.75</p>	<p>Dry</p>

**\*\*Volume-depth conversion based on average lake surface area of 467,000 acres**

Classification of Lake Okeechobee Net Inflow Multi-Seasonal Outlook\*

<b>Lake Net Inflow Prediction</b> <b>[million acre-feet]</b>	<b>Equivalent Depth**</b> <b>[feet]</b>	<b>Lake Okeechobee</b> <b>Net Inflow</b> <b>Multi-Seasonal Outlook</b>
<p>&gt; 2.0</p>	<p>&gt; 4.3</p>	<p>Very Wet</p>
<p>1.18 to 2.0</p>	<p>2.51 to 4.3</p>	<p>Wet</p>
<p>0.5 to 1.17</p>	<p>1.1 to 2.5</p>	<p>Normal</p>
<p>&lt; 0.5</p>	<p>&lt; 1.1</p>	<p>Dry</p>

\*\*Volume-depth conversion based on average lake surface area of 467,000 acres

## **6-15 Day Precipitation Outlook Categories\***

<b>6-15 Day Precipitation Outlook Categories</b>	<b>WSE Decision Tree Categories</b>
Above Normal	Wet to Very Wet
Normal	Normal
Below Normal	Dry

**\* Corresponds to Table 7-6 in the Lake Okeechobee Water Control Plan**