

Application of the Lake Okeechobee Regulation Schedule (LORS2008) on 11/13/2023 (ENSO Condition: El Niño)

Lake Okeechobee Net Inflow Outlook:

The Lake Okeechobee Net Inflow Outlook has been computed using methods described in the LORS2008 Water Control Plan: Croley's method, the SFWMD empirical method, a sub-sampling of El Niño years and a sub-sampling of warm years of the Atlantic Multi-decadal Oscillation (AMO) in combination with El Niño ENSO years. The results for Croley's method and the SFWMD empirical method are based on the CPC Outlook.

Table of the Lake Okeechobee Net Inflow Outlooks in feet of equivalent depth. All methods are updated on a weekly basis with observed net inflow for the current month.

Season	Croley's Method*		SFWMD Empirical Method		Sub-sampling of El Niño ENSO Years**		Sub-sampling of AMO Warm + El Niño ENSO Years***	
	Value (ft)	<u>Condition</u>	Value (ft)	<u>Condition</u>	Value (ft)	<u>Condition</u>	Value (ft)	<u>Condition</u>
Current (Nov-Apr)	N/A	N/A	1.00	Normal	1.58	Wet	1.74	Wet
Multi Seasonal (Nov-Oct)	N/A	N/A	3.44	Wet	4.34	Very Wet	5.68	Very Wet

*Croley's Method Not Produced for This Report

See Seasonal and Multi-Seasonal tables for the classification of Lake Okeechobee Outlooks.

The recommended methods and values for estimating the Lake Okeechobee Net Inflow Outlook are shaded and should be used in the LORS2008 Release Guidance Flow Charts.

**Sub-sampling is a weighted average of ENSO conditions based on the IRI ENSO forecast published.

***Sub-sampling based on combination of ENSO and AMO conditions. For this predominant ENSO categorization is used instead of weights.

Tributary Hydrologic Conditions:

-753 cfs 14-day running average for Lake Okeechobee Net Inflow through 11/13/2023. According to the classification in Tributary Hydrologic Conditions table, this condition is Dry.

-2.18 for Palmer Drought Index on 11/11/2023. According to the classification in Tributary Hydrologic Conditions table, this condition is Dry.

The wetter of the two conditions above is **Dry**.

LORS2008 Classification Tables:

Lake Okeechobee Stage on 11/13/2023:

Lake Okeechobee Stage: **15.97 feet**

Lake Okeechobee Management Zone/Band		Bottom Elevation (feet, NGVD)	Current Lake Stage
High Lake Management Band		17.25	
Operational Band	High sub-band	16.88	
	Intermediate sub-band	16.25	
	Low sub-band	14.50	← 15.97 ft
Base Flow sub-band		12.82	
Beneficial Use sub-band		12.64	
Water Shortage Management Band			

Part C of LORS2008: Discharge to WCAs

No Releases to WCAs

Part D of LORS2008: Discharge to Tide

Up to 450 cfs at S-79 and up to 200 cfs at S-80.

Lake Okeechobee Releases to the Caloosahatchee Estuary for LORS 2008 Baseflow & for Environmental Water Supply

Guidance for Lake Okeechobee Releases to the Caloosahatchee Estuary indicates no S77 release to the Caloosahatchee Estuary unless the Governing Board recommends otherwise.

LORS2008 Implementation on 11/13/2023 (ENSO Condition- El Niño):

Status for week ending 11/13/2023*:

Water Supply Risk Evaluation


Area	Indicator	Value	Color Coded Scoring Scheme
LOK	Projected LOK Stage for the next two months	Low Sub-band	M
	Palmer Drought Index for LOK Tributary Conditions	-2.18 (Extremely Dry)	H
	CPC Precipitation Outlook	1 month: Above Normal	L
		3 months: Above Normal	L
	LOK Seasonal Net Inflow Outlook	1.58 ft	L
	ENSO Forecast	Normal to Extremely Wet	
	LOK Multi-Seasonal Net Inflow Outlook	4.34 ft	L
	ENSO Forecast	Wet	
WCAs	WCA 1: 3 Station Average (Sites 1-7, 1-8T, and 1-9)	Above Line 1 (16.99 ft)	L
	WCA 2A: Site 2-17	Above Line 1 (13.02 ft)	L
	WCA-3A: 3 Station Average (Sites 63, 64, and 65)	Above Line 1 (10.65 ft)	L
LEC	Service Area 1	Year-Round Irrigation Rule in effect	L
	Service Area 2	Year-Round Irrigation Rule in effect	L
	Service Area 3	Year-Round Irrigation Rule in effect	L

Note: The water supply risk classification based on the Palmer index, as well as the LOK seasonal and multi-seasonal net inflow outlooks use slightly different classification intervals than those used by the 2008-LORS.

*- L8 @ Canal Point flow data for 10/30-11/2 is not available from USACE Daily Reports and was assumed to be 0. S80 flow data for 11/8-11/12 is not available from USACE Daily Reports and was assumed to be 0.



Lake Okeechobee SFWMM November 2023 Position Analysis

Percentiles PA

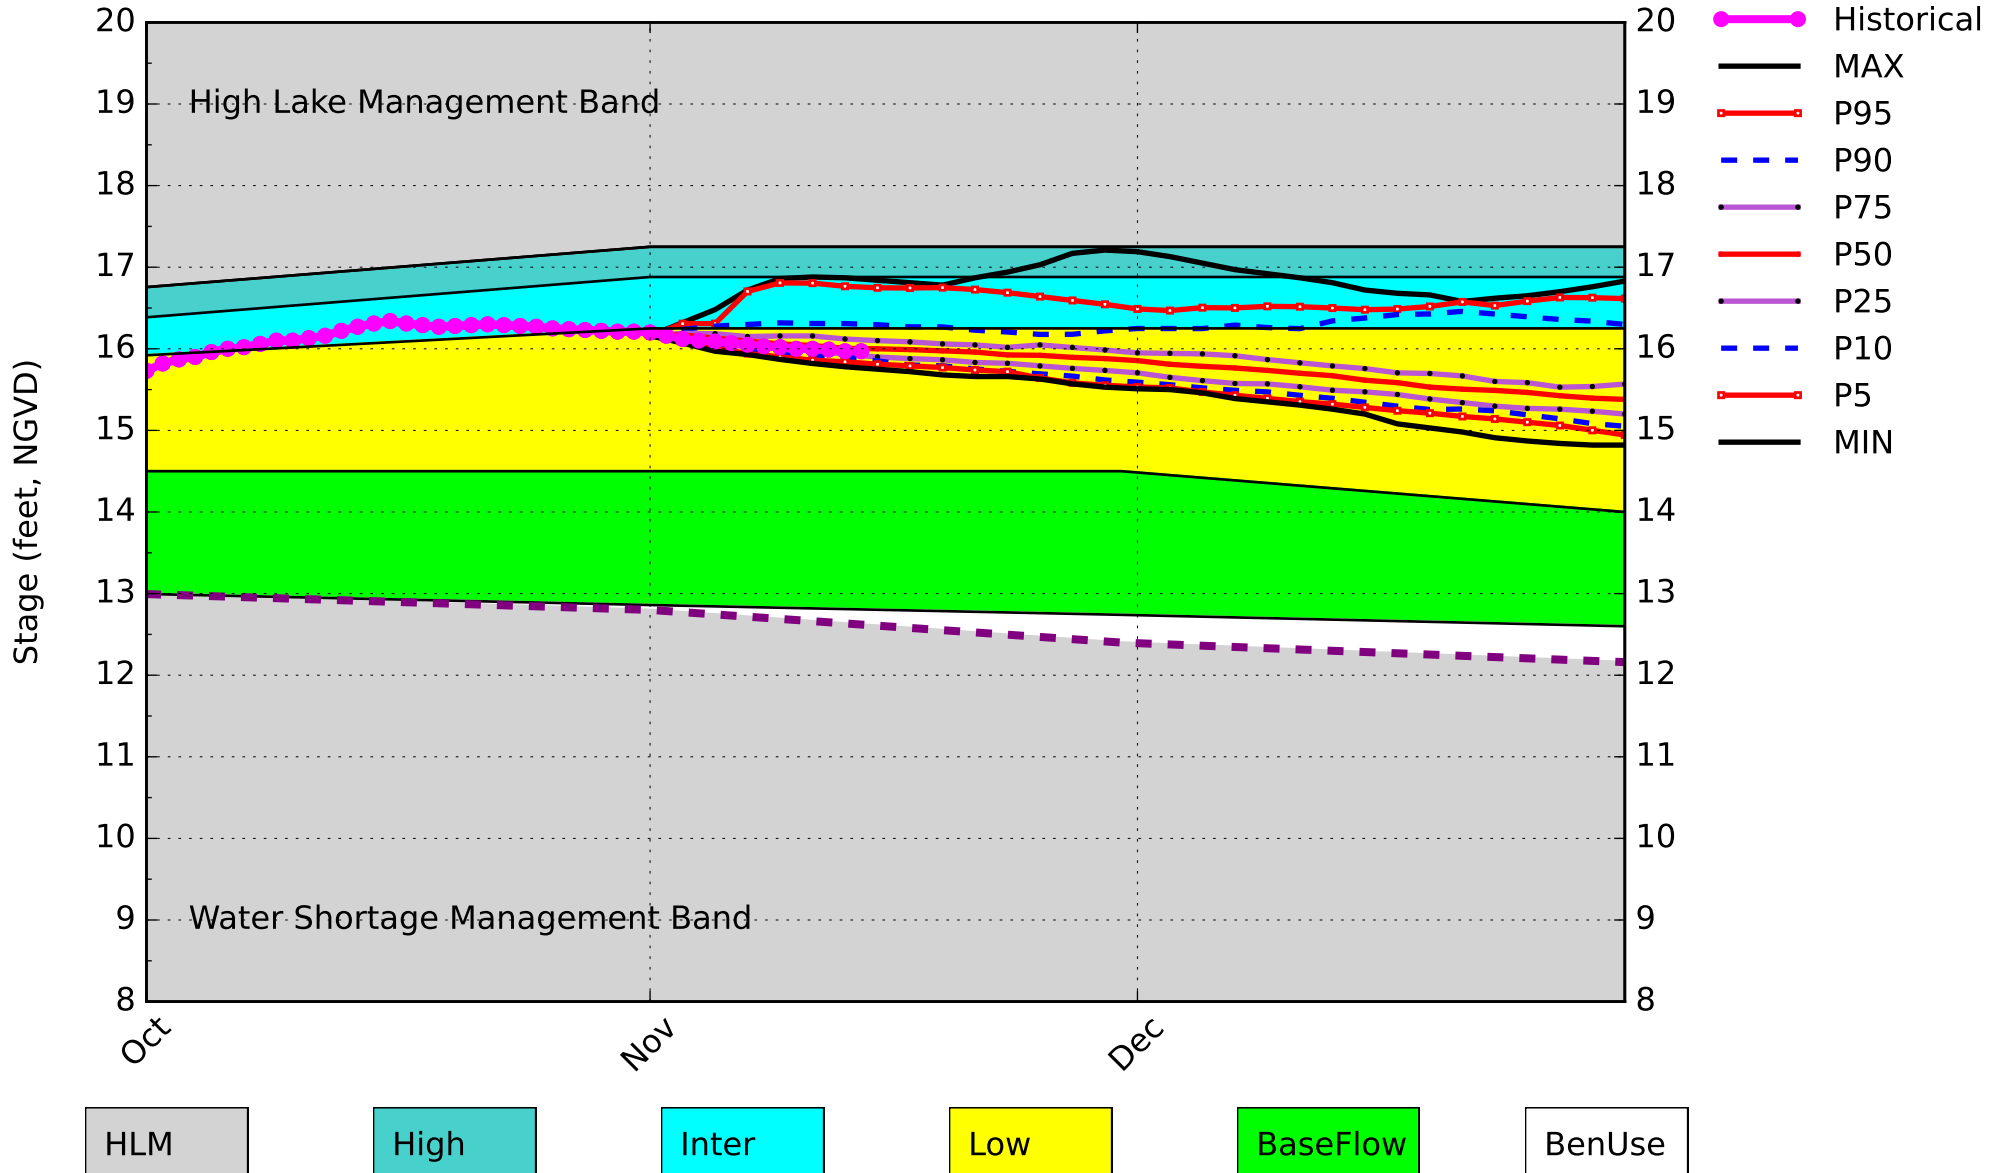

(See assumptions on the Position Analysis Results website)

Tributary Basin Condition Indicators as of November 12 2023

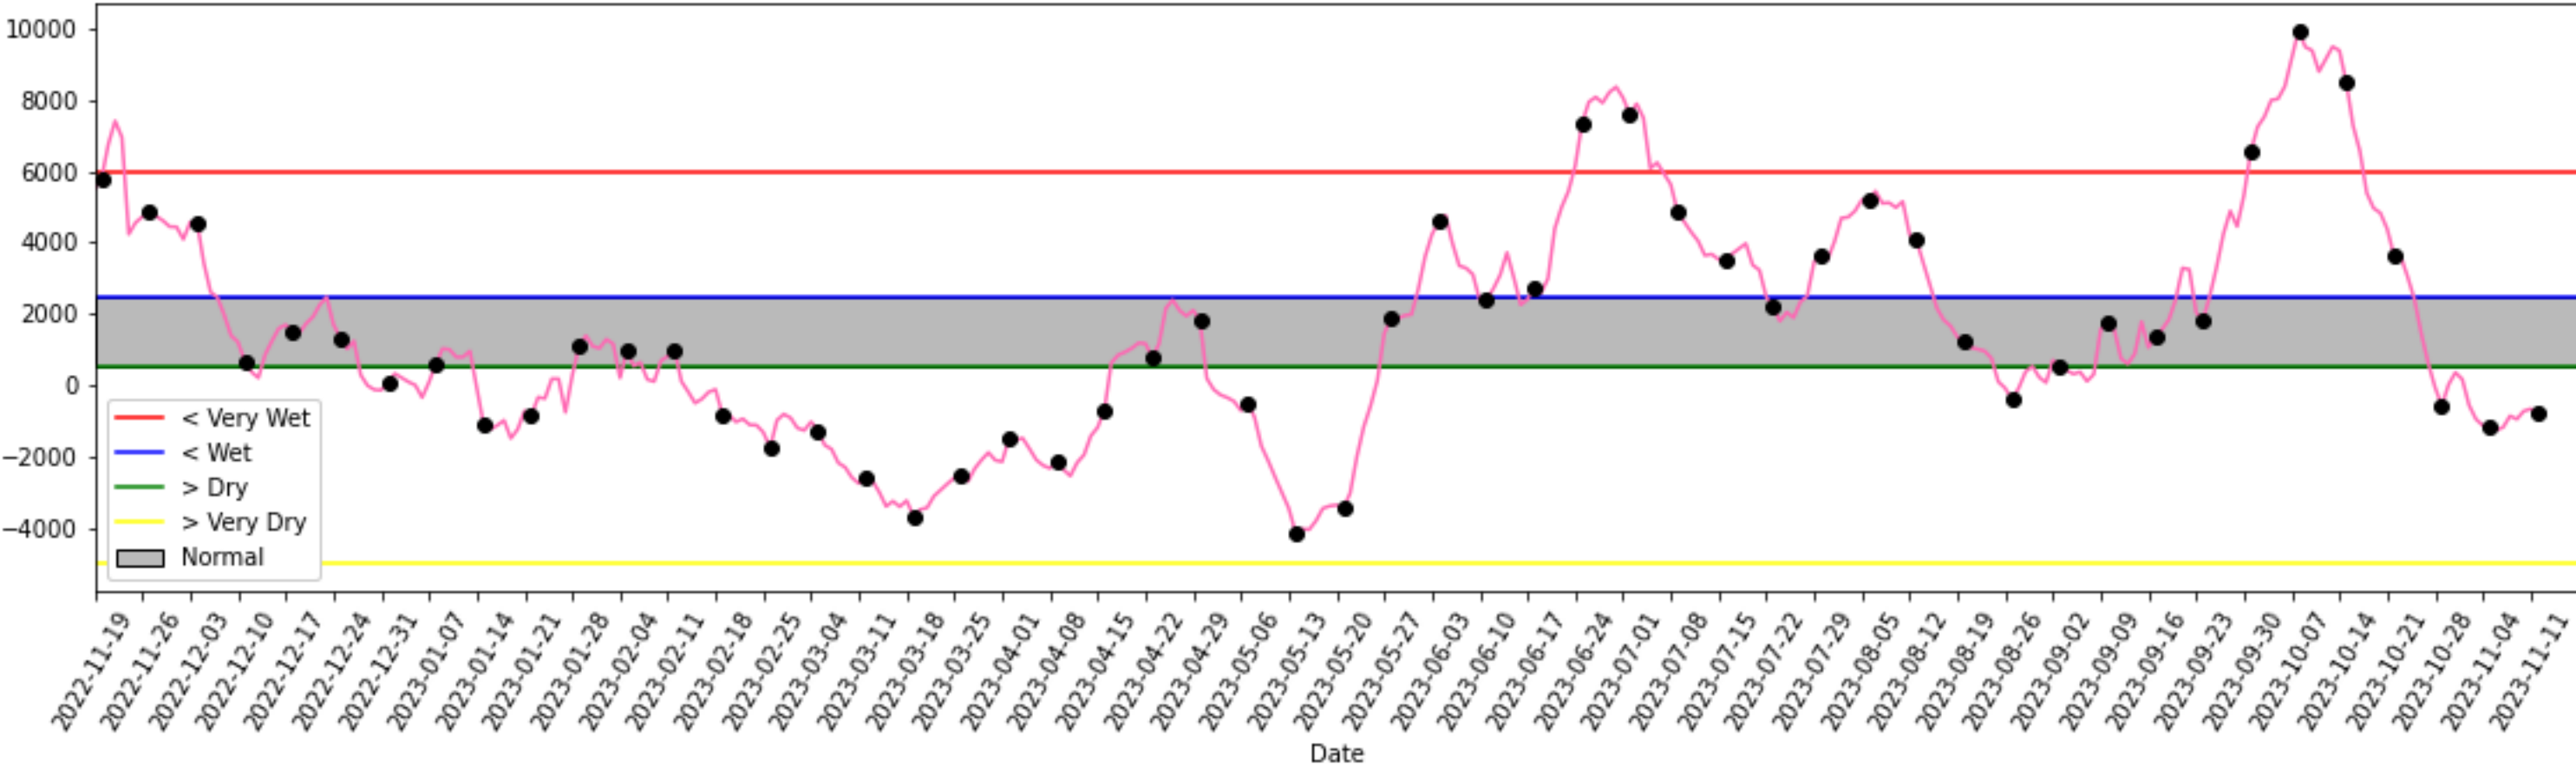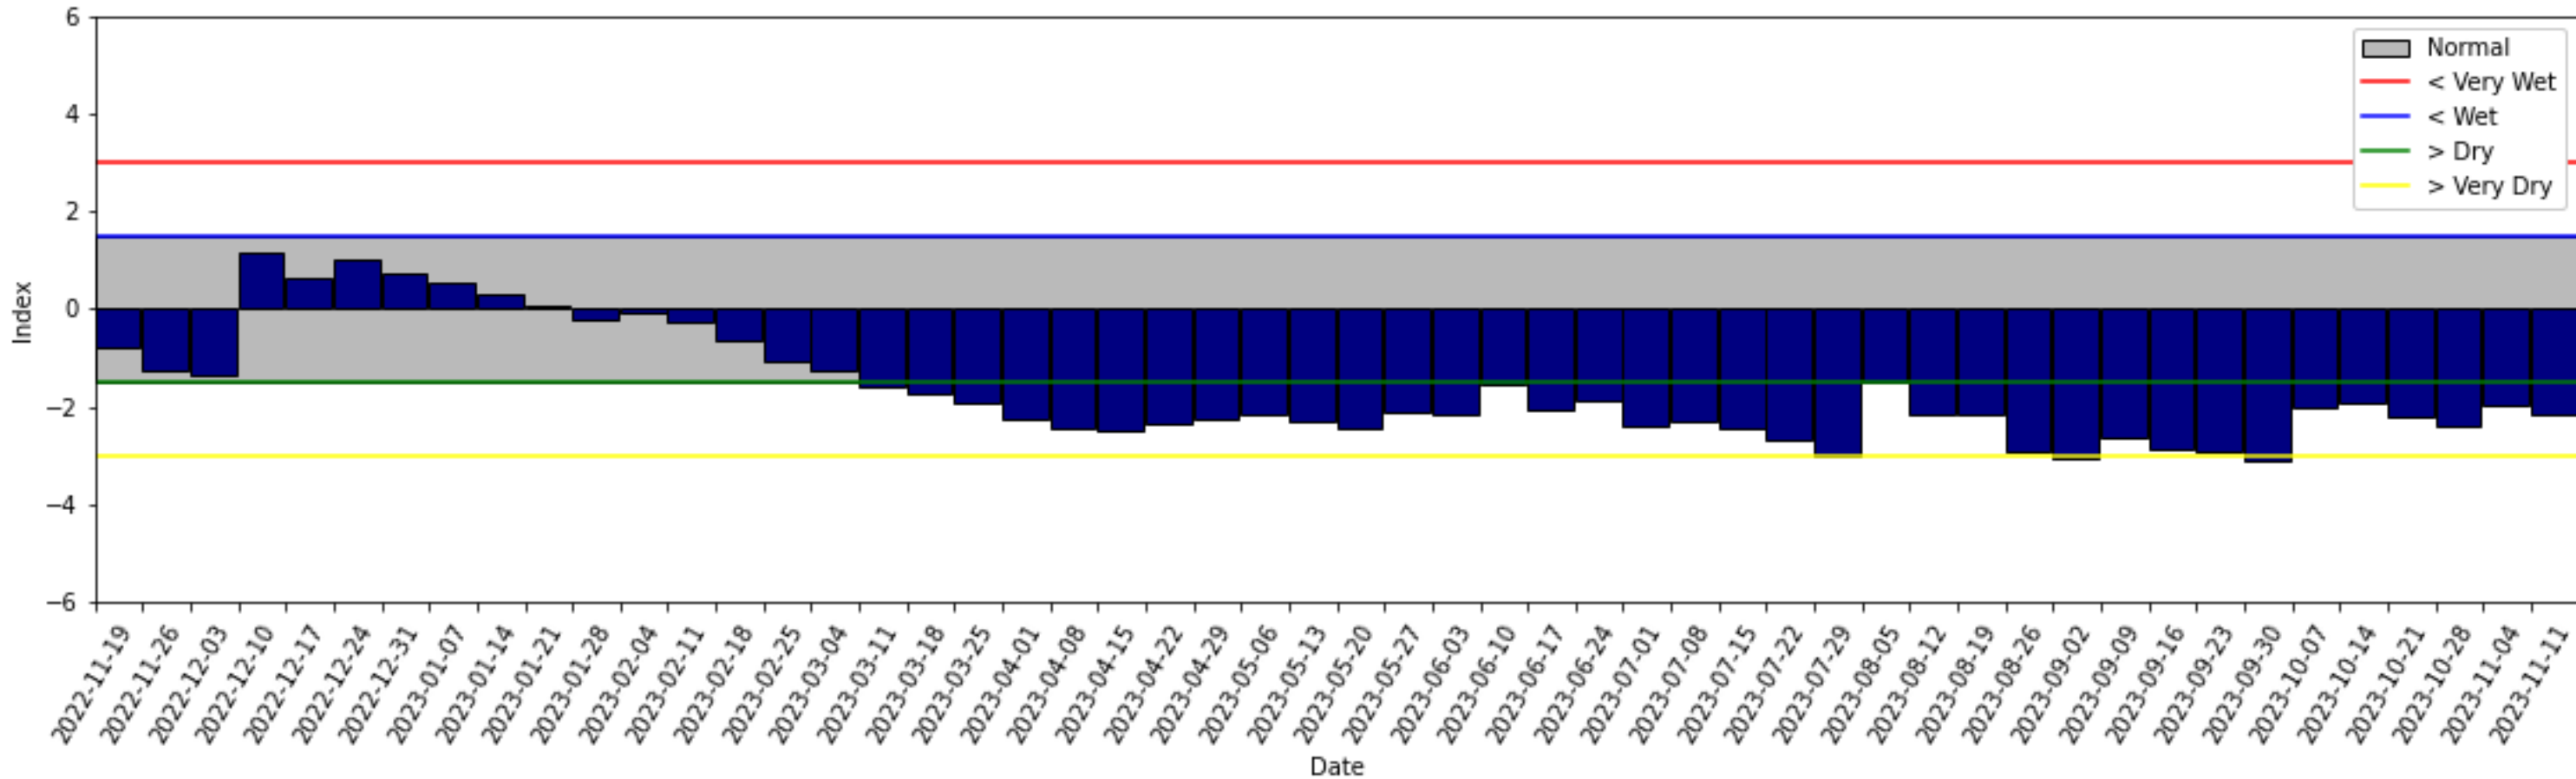

2008 LORS

Part C: Establish Allowable Lake Okeechobee Releases to the Water Conservation Areas

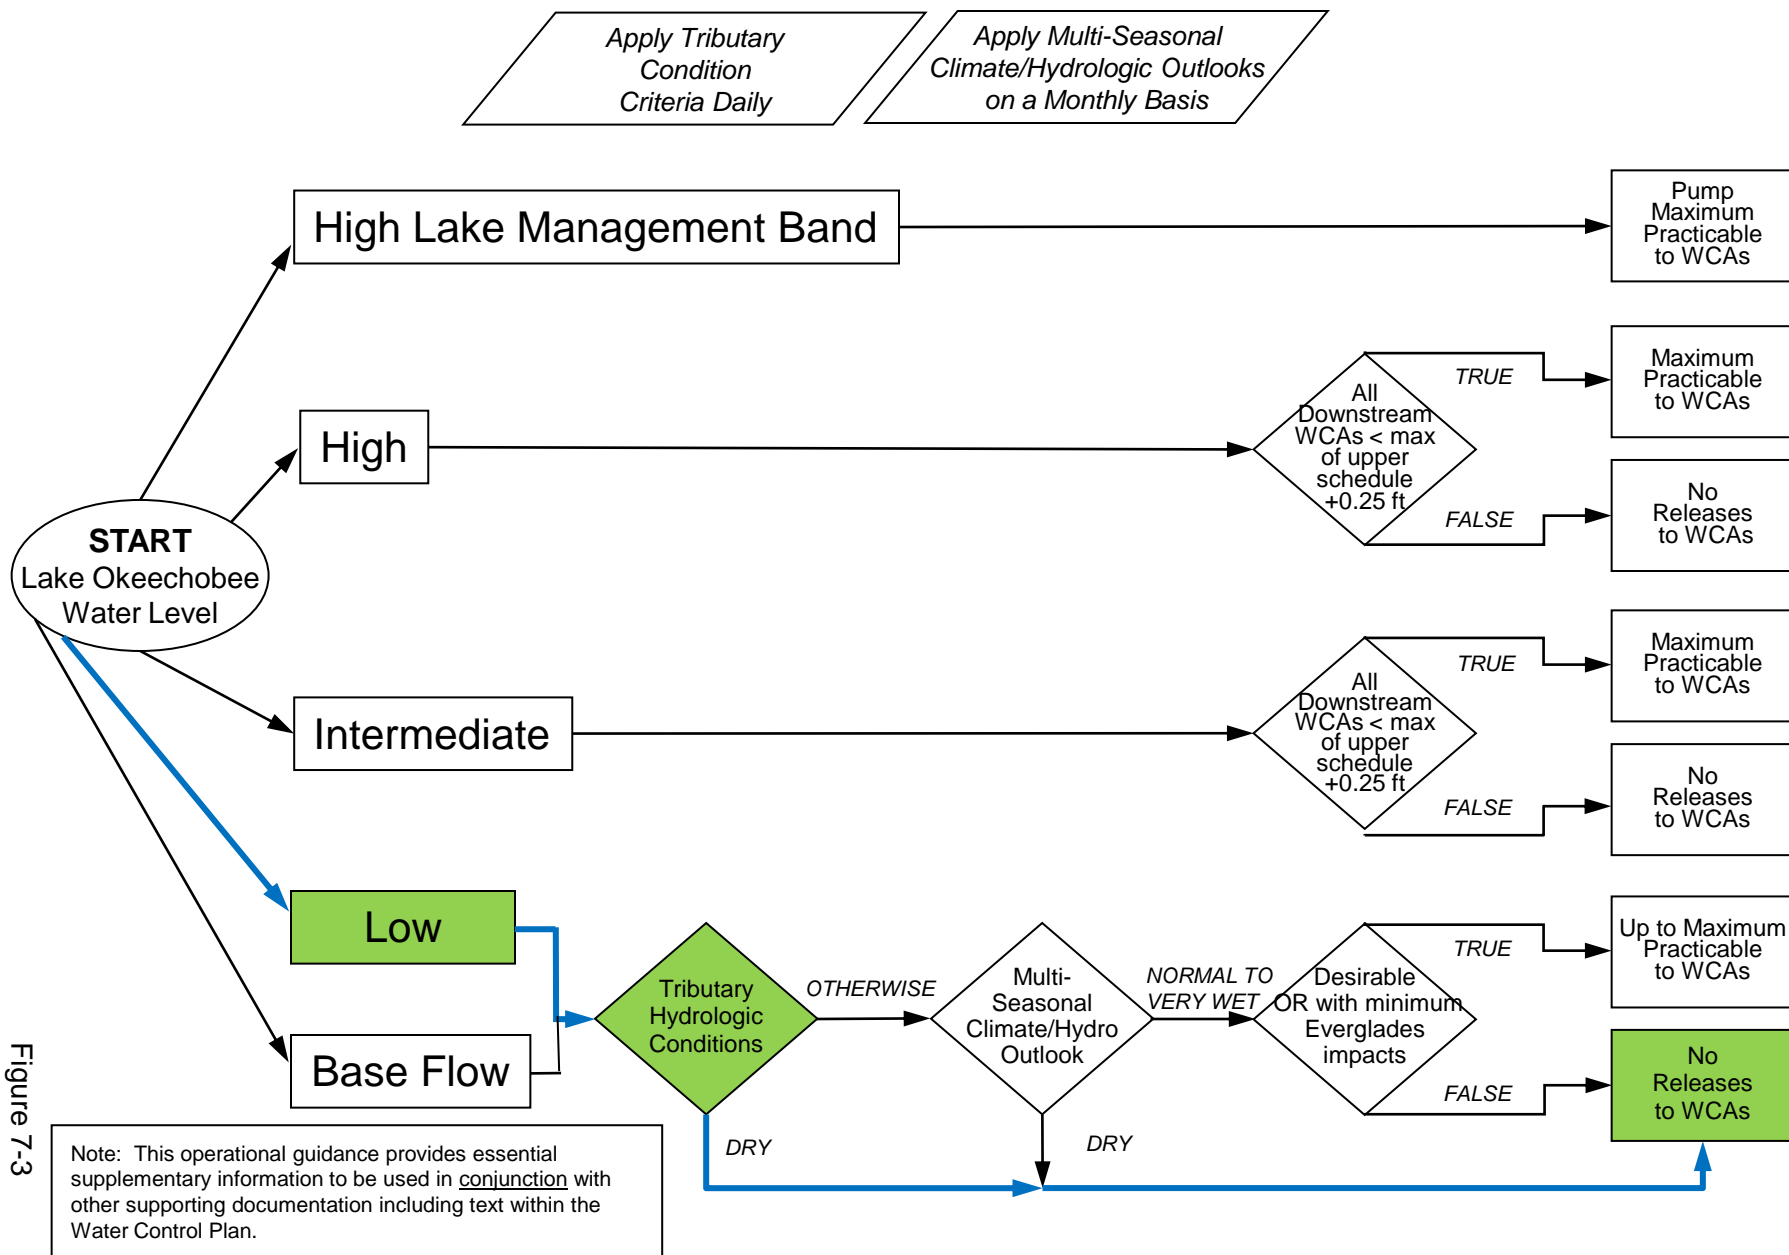


Figure 7-3

2008 LORS

Part D: Establish Allowable Lake Okeechobee Releases to Tide (Estuaries)

Note: This operational guidance provides essential supplementary information to be used in conjunction with other supporting documentation including text within the Water Control Plan.

When conducting Base Flow releases, flows can be distributed East and West up to 650 cfs as needed to minimize impacts or provide benefits through S-80 and S-79

Apply Meteorological Forecasts on a Weekly Basis; apply Seasonal and Multi-Seasonal Climate/Hydrologic Outlooks on a Monthly Basis


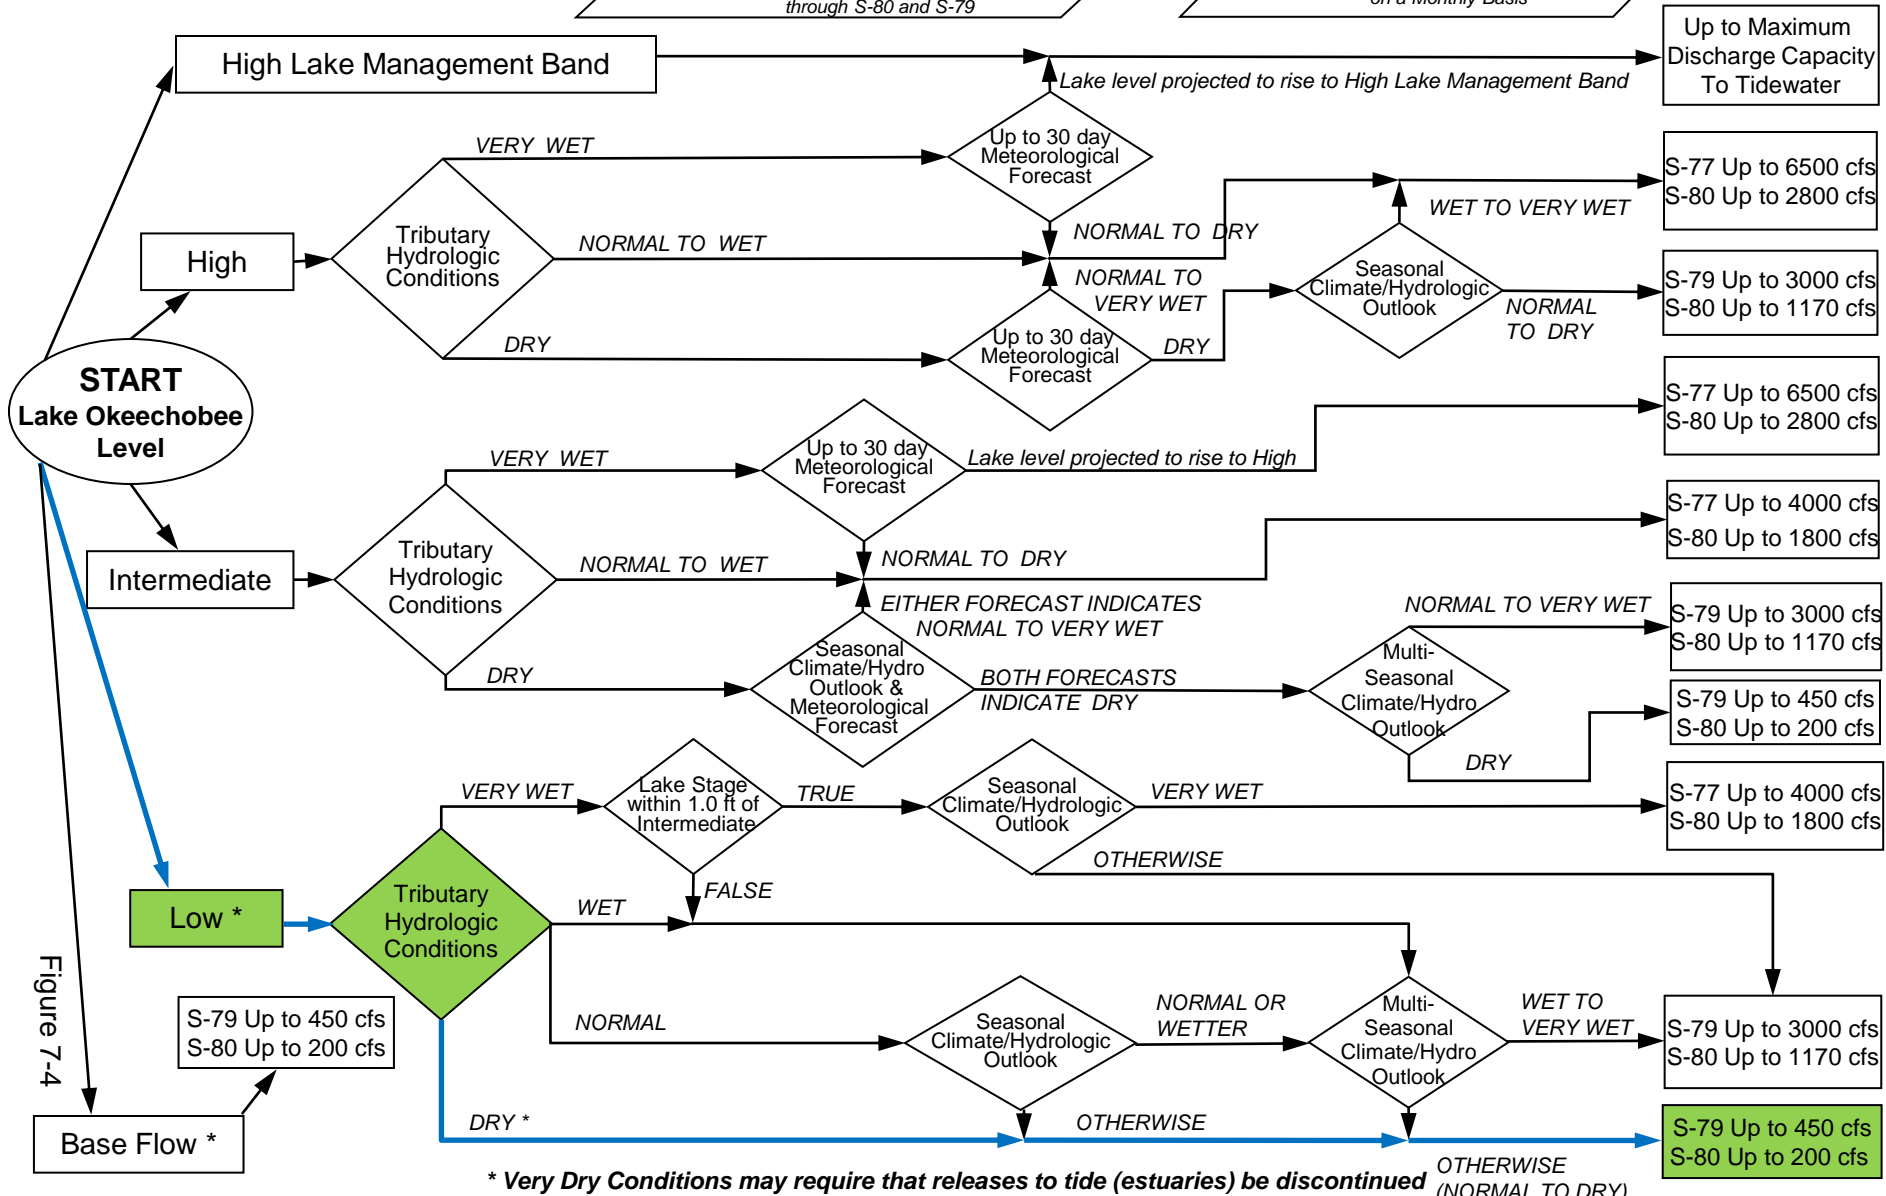


Figure 7-4

Flowchart to Guide Recommendations for Lake Okeechobee Releases to the Caloosahatchee Estuary for 2008 LORS Baseflow & for Environmental Water Supply (revised 9-Aug-2012)

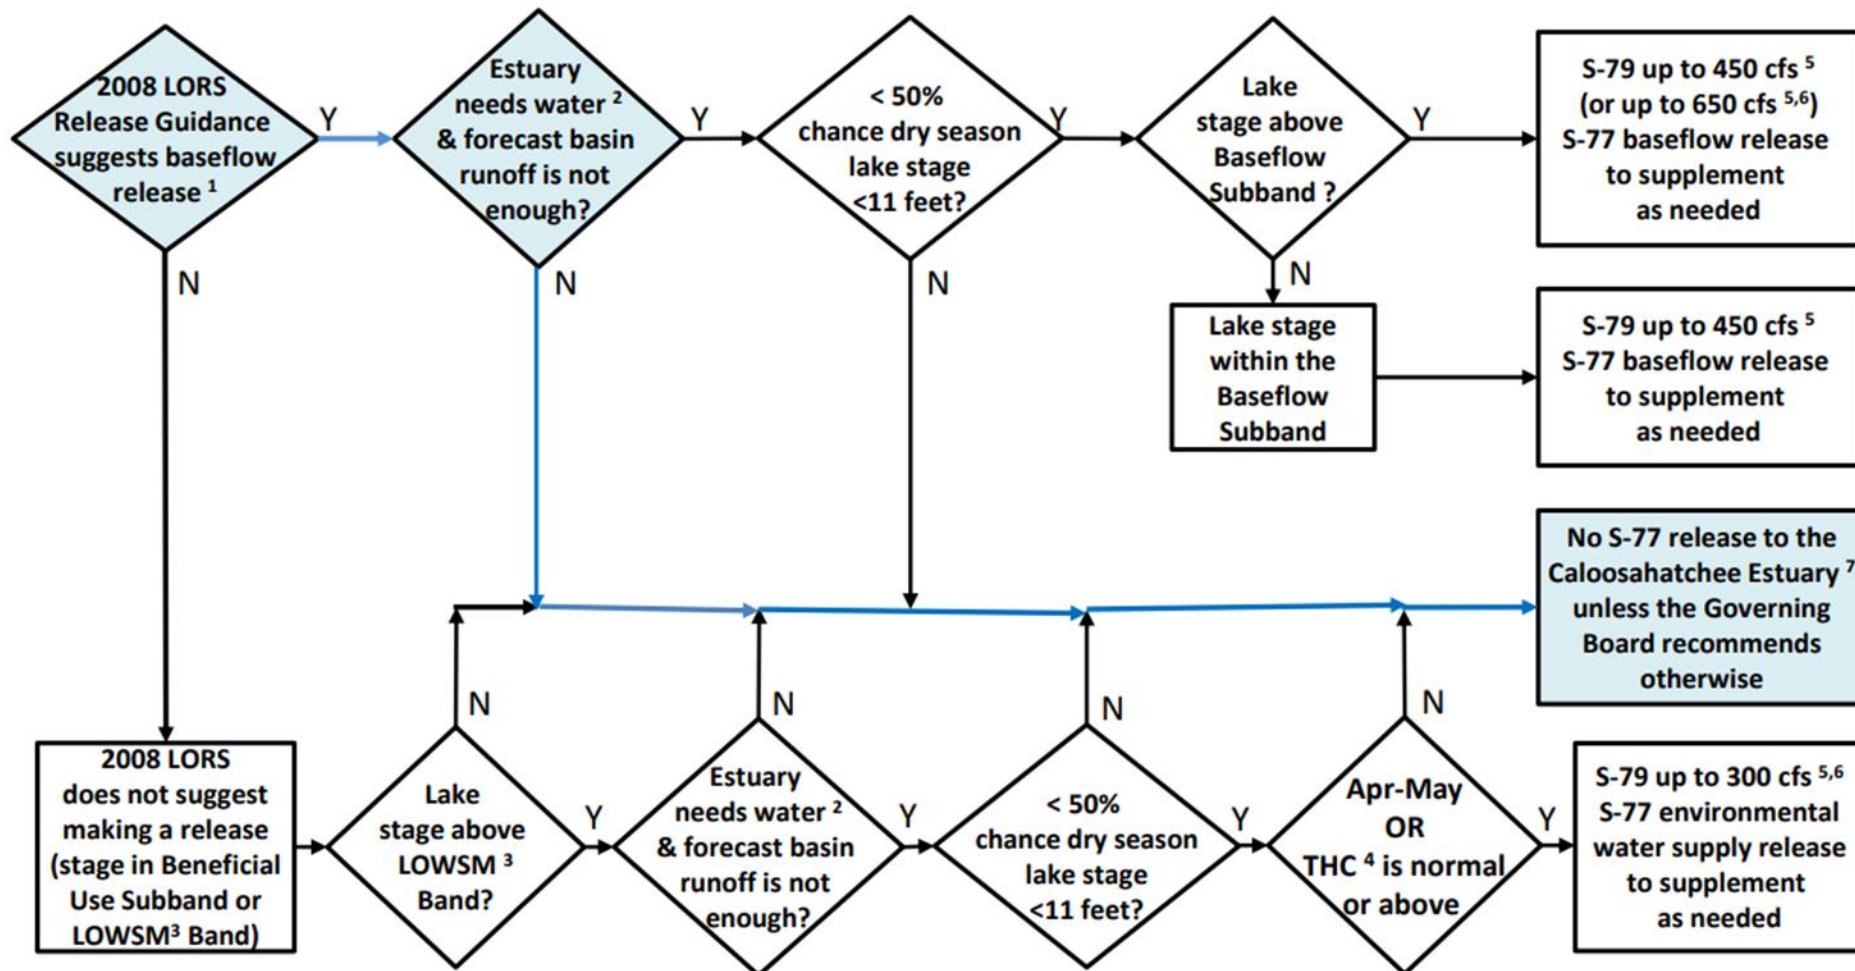

¹The 2008 LORS Release Guidance (Part D) can suggest baseflow releases in the Intermediate, Low, or Baseflow Subbands.

²Estuary “needs” water when the 30-day moving average salinity at I-75 bridge is projected to exceed 5 practical salinity units (psu) within 2 weeks.

³LOWSM = Lake Okeechobee Water Shortage Management.


⁴Tributary Hydrologic Condition (THC) is based on classification of Lake Okeechobee Net Inflow and Palmer Index.

⁵Can release less than the “up to” limit if lower release is sufficient to reach or sustain desired estuary salinity; cfs = cubic feet per second.

⁶After reviewing conditions in Water Conservation Areas (WCAs), Stormwater Treatment Areas (STAs), ENP, St. Lucie Estuary and Lake Okeechobee.

⁷Should this condition be reached, the Governing Board will be briefed at their next regularly scheduled meeting as part of the State of the Water Resources agenda item.

Lake Okeechobee Water Level History and Projected Stages

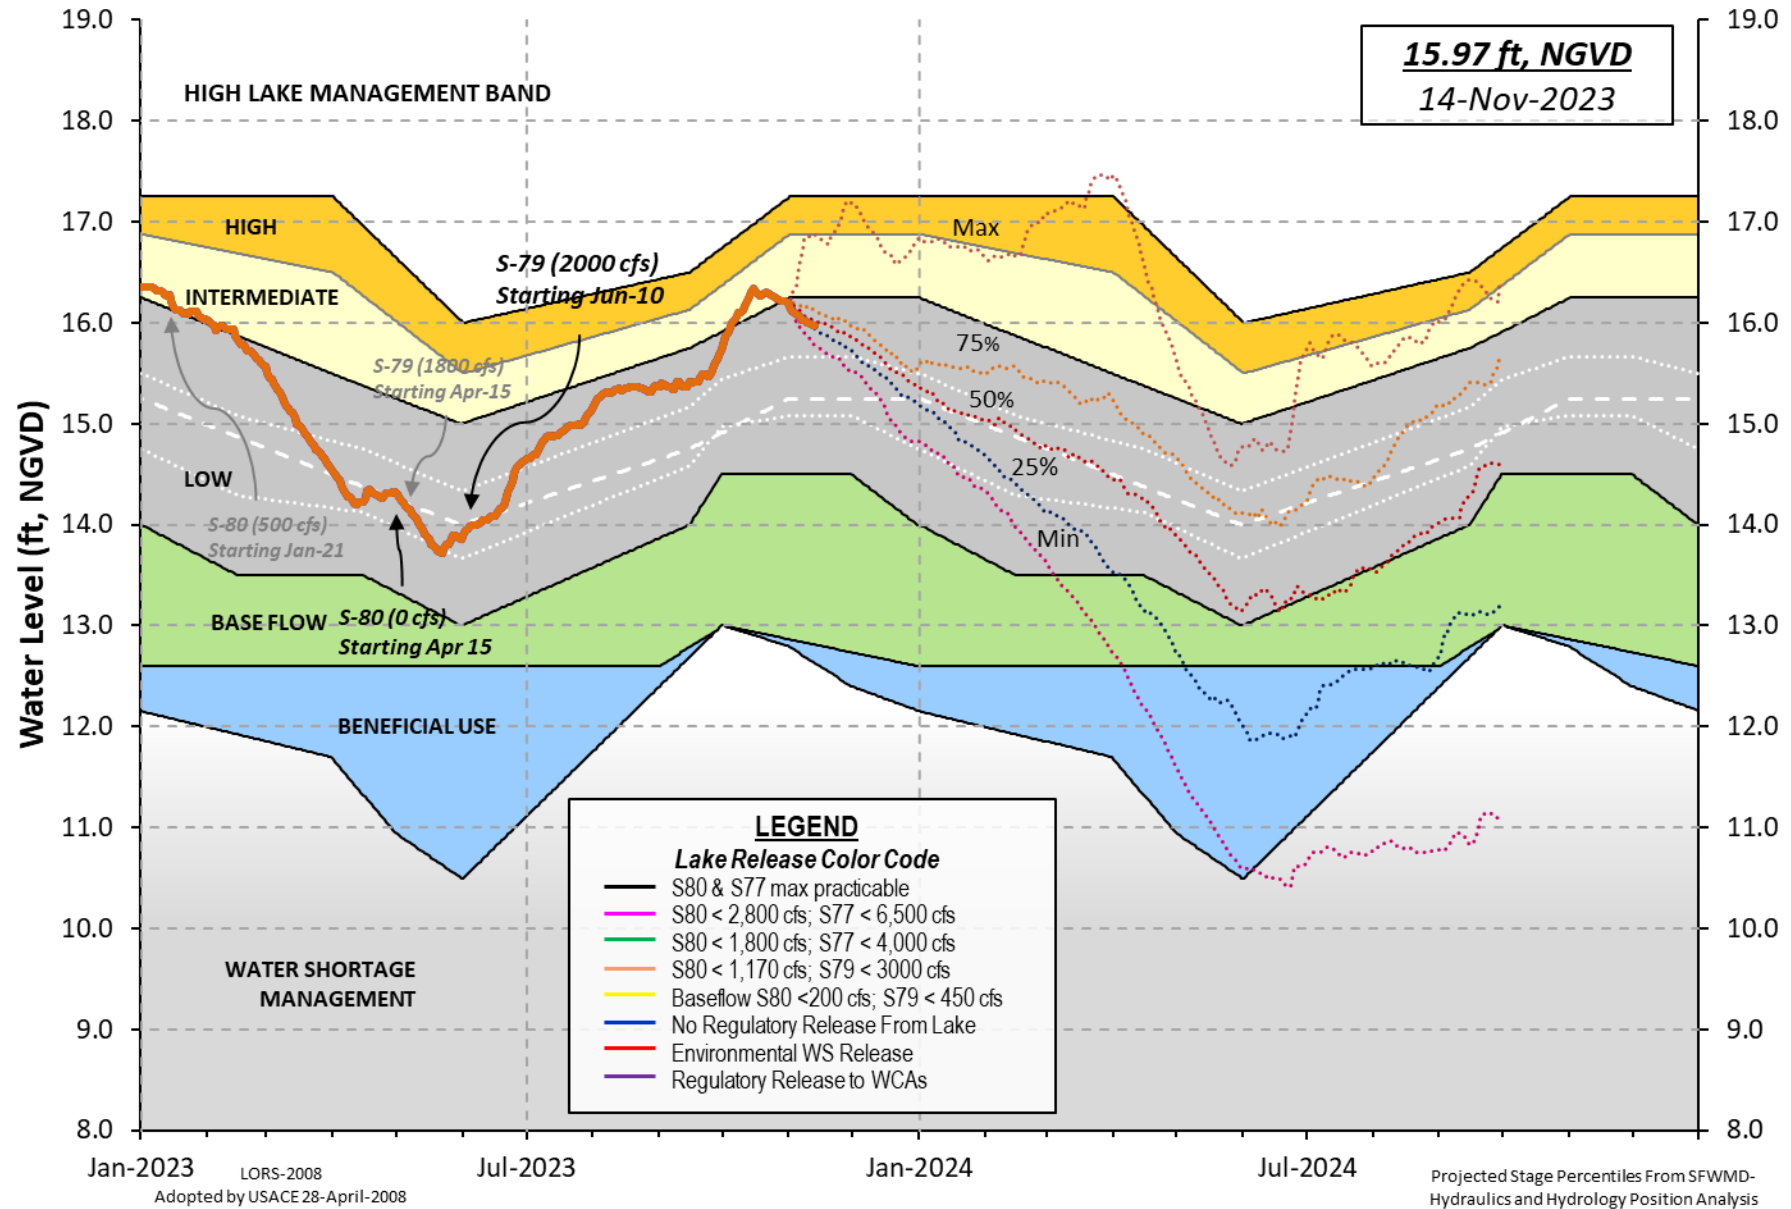

U. S. Army Corps of Engineers, Jacksonville District
 Lake Okeechobee and Vicinity Report
 ** Preliminary Data - Subject to Revision **

Data Ending 2400 hours 12 NOV 2023

Okeechobee Lake Regulation Elevation Last Year 2YRS Ago
 (ft-NGVD) (ft-NGVD) (ft-NGVD)
 *Okeechobee Lake Elevation 15.97 16.16 16.02 (Official Elv)
 Bottom of High Lake Mngmt= 17.25 Top of Water Short Mngmt= 12.64
 Currently in Operational Management Band

Simulated Average LORS2008 [1965-2000] 13.91
 Difference from Average LORS2008 2.06

12NOV (1965-2007) Period of Record Average 14.99
 Difference from POR Average 0.98

Today Lake Okeechobee elevation is determined from the 4 Int & 4 Edge stations

++Navigation Depth (Based on 2007 Channel Condition Survey) Route 1 9.91'
 ++Navigation Depth (Based on 2008 Channel Condition Survey) Route 2 8.11'
 Bridge Clearance = 49.69'

4 Interior and 4 Edge Okeechobee Lake Average (Avg-Daily values):

L001	L005	L006	LZ40	S4	S352	S308	S133
15.97	16.02	15.99	15.95	15.95	16.07	16.00	15.85

*Combination Okeechobee Avg-Daily Lake Average = 15.97
 (*See Note)

Okeechobee Inflows (cfs):

S65E	0	S65EX1	1488	Fisheating Cr	43
S154	0	S191	0	S135 Pumps	0
S84	0	S133 Pumps	0	S2 Pumps	0
S84X	0	S127 Pumps	0	S3 Pumps	0
S71	121	S129 Pumps	0	S4 Pumps	0
S72	0	S131 Pumps	0	C5	0
Total Inflows:	1652				

Okeechobee Outflows (cfs):

S135 Culverts	0	S354	276	S77	1540
S127 Culverts	0	S351	585	S308	207
S129 Culverts	0	S352	314		
S131 Culverts	0	L8 Canal Pt	97		
Total Outflows:	3018				

****S77 below flow meter is being used to compute Total Outflow.
 ****S308 structure flow is being used to compute Total Outflow.

Okeechobee Pan Evaporation (inches):

S77 0.26 S308 0.13
 Average Pan Evap x 0.75 Pan Coefficient = 0.15" = 0.01'

Lake Average Precipitation using NEXRAD: = -NR-" = -NR-'

Evaporation - Precipitation: = -NR-" = -NR-'
 Evaporation - Precipitation using Lake Area of 730 square miles

is equal to -NR-
 Lake Okeechobee (Change in Storage) Flow is -4336 cfs or -8600 AC-FT

	Headwater Elevation (ft-msl)	Tailwater Elevation (ft-msl)	Disch (cfs)	----- Gate Positions -----							
				#1 (ft)	#2 (ft)	#3 (ft)	#4 (ft)	#5 (ft)	#6 (ft)	#7 (ft)	#8 (ft)
(I) see note at bottom											
North East Shore											
S133 Pumps:	13.67	15.73	0	0	0	0	0	0	0	0	(cfs)
S193:											
S191:	18.92	15.75	0	0.0	0.0	0.0					
S135 Pumps:	13.22	15.78	0	0	0	0	0				(cfs)
S135 Culverts:			0	0.0	0.0						
North West Shore											
S65E:	21.09	15.40	0	-0.0	-0.0	0.0	0.0	0.0	0.0	-0.0	
S65EX1:	21.09	15.40	1488								
S127 Pumps:	13.45	15.82	0	0	0	0	0	0	0		(cfs)
S127 Culvert:			0	0.0							
S129 Pumps:	13.01	15.92	0	0	0	0					(cfs)
S129 Culvert:			0	0.0							
S131 Pumps:	13.07	13.24	0	0	0						(cfs)
S131 Culvert:			0								
Fisheating Creek											
nr Palmdale		29.50	43								
nr Lakeport											
S282	15.93	15.78		0.0	0.0	0.1					
South Shore											
S4 Pumps:	12.08	-NR-	0	0	0	0					(cfs)
S169:	15.52	-NR-	-NR-	-NR-	-NR-	-NR-					
S310:	16.05		8								
S3 Pumps:	10.85	16.20	0	0	0	0					(cfs)
S354:	16.20	10.85	276	0.2	0.5						
S2 Pumps:	10.78	16.30	0	0	0	0	0				(cfs)
S351:	16.30	10.78	585	0.3	0.3	0.2					
S352:	16.11	10.97	314	0.1	0.6						
S271:	16.35	14.68		0.0	-NR-	0.0	0.0				
L8 Canal PT		14.39	97								

S351 and S352 Temporary Pumps/S354 Spillway

S351:	10.78	16.30	585	-NR-	-NR-	-NR-	-NR-	-NR-	-NR-		
S352:	10.97	16.11	314	-NR-	-NR-	-NR-	-NR-				
S354:	10.85	16.20	276	-NR-	-NR-	-NR-	-NR-				

Caloosahatchee River (S77, S78, S79)

S47B:	13.37	12.33		1.0	1.0						
S47D:	12.47	10.96	0	0.0							
S77:											
Spillway and Sector Preferred Flow:											
	15.87	10.82	1531	0.0	3.0	3.0	0.0				
Flow Due to Lockages+:											
			9								

S78:

Spillway and Sector Flow:
 10.86 2.78 1301 0.0 2.5 2.5 0.0
 Flow Due to Lockages+: 21

S79:
 Spillway and Sector Flow:
 3.00 1.96 1478 0.0 1.0 1.0 2.0 2.0 2.0 1.0 0.0
 Flow Due to Lockages+: 6
 Percent of flow from S77 104%
 Chloride (ppm) 0

St. Lucie Canal (S308, S80)

S308:
 Spillway and Sector Preferred Flow:
 16.04 13.81 202 0.0 0.0 0.0 0.0
 Flow Due to Lockages+: 5

S153: 19.08 13.55 0 0.0 0.0

S80:
 Spillway and Sector Flow:
 13.86 1.75 0 0.0 0.0 0.0 0.0 0.0 0.0 0.0
 Flow Due to Lockages+: -NR-
 Percent of flow from S308 NA %

Steele Point Top Salinity (mg/ml) ****
 Steele Point Bottom Salinity (mg/ml) ****

Speedy Point Top Salinity (mg/ml) ****
 Speedy Point Bottom Salinity (mg/ml) ****

+ Flow Due to lockages is computed utilizing average daily headwater and tailwater along with total number of lockages for the day to calculate a volume which is then converted to an average discharge in cfs.
 ++ Preferred flow is determined from either the spillway discharge or the below flow meter daily

Daily Precipitation Totals	1-Day (inches)	3-Day (inches)	7-Day (inches)	----- Wind -----	
				Direction (Deg)	Speed (mph)
S133 Pump Station:	-NR-	0.00	0.00		
S193:	-NR-	0.00	0.00	-NR-	-NR-
Okeechobee Field Station:	-NR-	0.00	0.00		
S135 Pump Station:	-NR-	0.00	0.00		
S127 Pump Station:	-NR-	0.00	0.00		
S129 Pump Station:	-NR-	0.00	0.00		
S131 Pump Station:	-NR-	0.00	0.00		
S77:	0.00	0.00	0.00	37	9
S78:	0.00	0.00	0.00	54	3
S79:	0.00	0.34	0.34	124	2
S4 Pump Station:	-NR-	0.00	0.00		
Clewiston Field Station:	-NR-	0.00	0.00		
S3 Pump Station:	-NR-	0.00	0.00		
S2 Pump Station:	-NR-	0.00	0.00		
S308:	0.00	0.00	0.00	353	5
S80:	0.46	0.46	0.46	355	8
Okeechobee Average (Sites S78, S79 and S80 not included)	0.00	0.00	0.00		

Oke Nexrad Basin Avg	-NR-	0.00	0.00		

Okeechobee Lake Elevations 12 NOV 2023 15.97 Difference from 12NOV23
 12NOV23 -1 Day = 11 NOV 2023 15.99 0.02

12NOV23	-2 Days =	10 NOV 2023	16.00	0.03
12NOV23	-3 Days =	09 NOV 2023	16.00	0.03
12NOV23	-4 Days =	08 NOV 2023	16.02	0.05
12NOV23	-5 Days =	07 NOV 2023	16.03	0.06
12NOV23	-6 Days =	06 NOV 2023	16.05	0.08
12NOV23	-7 Days =	05 NOV 2023	16.07	0.10
12NOV23	-30 Days =	13 OCT 2023	16.27	0.30
12NOV23	-1 Year =	12 NOV 2022	16.16	0.19
12NOV23	-2 Year =	12 NOV 2021	16.02	0.05

Long Term Mean 30day Avearge ET for Lake Alfred (Inches) = -NR-

Lake Okeechobee Net Inflow (LONIN)

		Average Flow over the previous 14 days		Avg-Daily Flow
12NOV23	Today =	12 NOV 2023	-94 MON	-1386
12NOV23	-1 Day =	11 NOV 2023	30 SUN	749
12NOV23	-2 Days =	10 NOV 2023	-58 SAT	3044
12NOV23	-3 Days =	09 NOV 2023	-370 FRI	-1074
12NOV23	-4 Days =	08 NOV 2023	-244 THU	2508
12NOV23	-5 Days =	07 NOV 2023	-688 WED	566
12NOV23	-6 Days =	06 NOV 2023	-803 TUE	-1559
12NOV23	-7 Days =	05 NOV 2023	-672 MON	-1787
12NOV23	-8 Days =	04 NOV 2023	-614 SUN	498
12NOV23	-9 Days =	03 NOV 2023	-365 SAT	-2496
12NOV23	-10 Days =	02 NOV 2023	183 FRI	-NR-
12NOV23	-11 Days =	01 NOV 2023	462 THU	-NR-
12NOV23	-12 Days =	31 OCT 2023	147 WED	-NR-
12NOV23	-13 Days =	30 OCT 2023	-132 TUE	-NR-

S65E

		Average Flow over previous 14 days		Avg-Daily Flow
12NOV23	Today=	12 NOV 2023	659 MON	0
12NOV23	-1 Day =	11 NOV 2023	797 SUN	0
12NOV23	-2 Days =	10 NOV 2023	940 SAT	0
12NOV23	-3 Days =	09 NOV 2023	1084 FRI	0
12NOV23	-4 Days =	08 NOV 2023	1229 THU	0
12NOV23	-5 Days =	07 NOV 2023	1371 WED	0
12NOV23	-6 Days =	06 NOV 2023	1541 TUE	0
12NOV23	-7 Days =	05 NOV 2023	1720 MON	0
12NOV23	-8 Days =	04 NOV 2023	1898 SUN	276
12NOV23	-9 Days =	03 NOV 2023	2086 SAT	1725
12NOV23	-10 Days =	02 NOV 2023	2178 FRI	1771
12NOV23	-11 Days =	01 NOV 2023	2280 THU	1804
12NOV23	-12 Days =	31 OCT 2023	2402 WED	1815
12NOV23	-13 Days =	30 OCT 2023	2536 TUE	1835

S65EX1

		Average Flow over previous 14 days		Avg-Daily Flow
12NOV23	Today=	12 NOV 2023	996 MON	1488
12NOV23	-1 Day =	11 NOV 2023	890 SUN	1579
12NOV23	-2 Days =	10 NOV 2023	777 SAT	1516
12NOV23	-3 Days =	09 NOV 2023	668 FRI	1487
12NOV23	-4 Days =	08 NOV 2023	562 THU	1642
12NOV23	-5 Days =	07 NOV 2023	445 WED	1658
12NOV23	-6 Days =	06 NOV 2023	326 TUE	1667
12NOV23	-7 Days =	05 NOV 2023	207 MON	1640
12NOV23	-8 Days =	04 NOV 2023	90 SUN	1264
12NOV23	-9 Days =	03 NOV 2023	0 SAT	0
12NOV23	-10 Days =	02 NOV 2023	0 FRI	0
12NOV23	-11 Days =	01 NOV 2023	0 THU	0
12NOV23	-12 Days =	31 OCT 2023	0 WED	0
12NOV23	-13 Days =	30 OCT 2023	0 TUE	0

Lake Okeechobee Outlets Last 14 Days

DATE	S-77 Discharge (ALL DAY) (AC-FT)	Below S-77 Discharge (ALL-DAY) (AC-FT)	S-78 Discharge (ALL DAY) (AC-FT)	S-79 Discharge (ALL DAY) (AC-FT)
12 NOV 2023	2822	3036	2646	2967
11 NOV 2023	1943	2244	1793	2240
10 NOV 2023	1935	2016	1770	2599
09 NOV 2023	2364	2490	1960	3035
08 NOV 2023	3591	3919	2880	3870
07 NOV 2023	4550	4772	3877	4560
06 NOV 2023	3124	3197	2640	4023
05 NOV 2023	2292	2368	2054	2853
04 NOV 2023	2275	2336	2061	2847
03 NOV 2023	2244	1279	1790	2148
02 NOV 2023	1699	1544	1078	1321
01 NOV 2023	3429	3478	2622	4413
31 OCT 2023	4361	3698	3601	4912
30 OCT 2023	2898	3128	2606	4133

DATE	S-310 Discharge (ALL DAY) (AC-FT)	S-351 Discharge (ALL DAY) (AC-FT)	S-352 Discharge (ALL DAY) (AC-FT)	S-354 Discharge (ALL DAY) (AC-FT)	L8 Canal Pt Discharge (ALL DAY) (AC-FT)
12 NOV 2023	15	1159	622	548	192
11 NOV 2023	11	2000	672	776	190
10 NOV 2023	6	2247	692	809	192
09 NOV 2023	15	2461	676	843	153
08 NOV 2023	9	2720	818	1539	151
07 NOV 2023	10	2413	1186	1584	166
06 NOV 2023	14	1481	550	497	182
05 NOV 2023	8	1693	469	414	179
04 NOV 2023	11	1702	589	425	186
03 NOV 2023	15	1636	506	429	198
02 NOV 2023	14	1816	460	437	-NR-
01 NOV 2023	2	2095	584	88	-NR-
31 OCT 2023	18	1918	707	515	-NR-
30 OCT 2023	12	770	70	153	-NR-

DATE	S-308 Discharge (ALL DAY) (AC-FT)	Below S-308 Discharge (ALL-DAY) (AC-FT)	S-80 Discharge (ALL-DAY) (AC-FT)
12 NOV 2023	394	-NR-	-NR-
11 NOV 2023	22	-NR-	-NR-
10 NOV 2023	7	-NR-	-NR-
09 NOV 2023	14	-NR-	-NR-
08 NOV 2023	432	-NR-	-NR-
07 NOV 2023	10	-NR-	40
06 NOV 2023	10	-NR-	49
05 NOV 2023	382	-NR-	32
04 NOV 2023	244	-NR-	49
03 NOV 2023	11	-NR-	65
02 NOV 2023	7	-NR-	19
01 NOV 2023	6	-NR-	20
31 OCT 2023	11	-NR-	41
30 OCT 2023	9	-NR-	31

*** NOTE: Discharge (ALL DAY) is computed using Spillway, Sector Gate and Lockages Discharges from 0015 hrs to 2400 hrs.


(I) - Flows preceded by "I" signify an instantaneous flow computed from the single value reported for the day

-
- * On 11 May 1999, Lake Okeechobee Elevation was switched from Instantaneous 2400 value to an average-daily lake average.
 - On 14 Mar 2001, due to the isolation of various gages within the standard 10 stations, the average of the interior 4 station gages was used as the Lake Okeechobee Elevation.
 - On 05 November 2010, Lake Okeechobee Elevation was switched to a 9 gage mix of interior and edge gages to obtain a more reliable representation of the lake level.
 - On 09 May 2011, Lake Okeechobee Elevation was switched to a 8 gage mix of interior and edge gages to obtain a more reliable representation of the lake level due to isolation of S135 from low lake levels.
 - Today Lake Okeechobee elevation is determined from the 4 Int & 4 Edge stations
- ++ For more information see the Jacksonville District Navigation website at <http://www.saj.usace.army.mil/>
- \$ For information regarding Lake Okeechobee Service Area water restrictions please refer to www.sfwmd.gov

Report Generated 13NOV2023 @ 13:15 ** Preliminary Data - Subject to Revision **

Lake Okeechobee

13NOV23 13:01:15

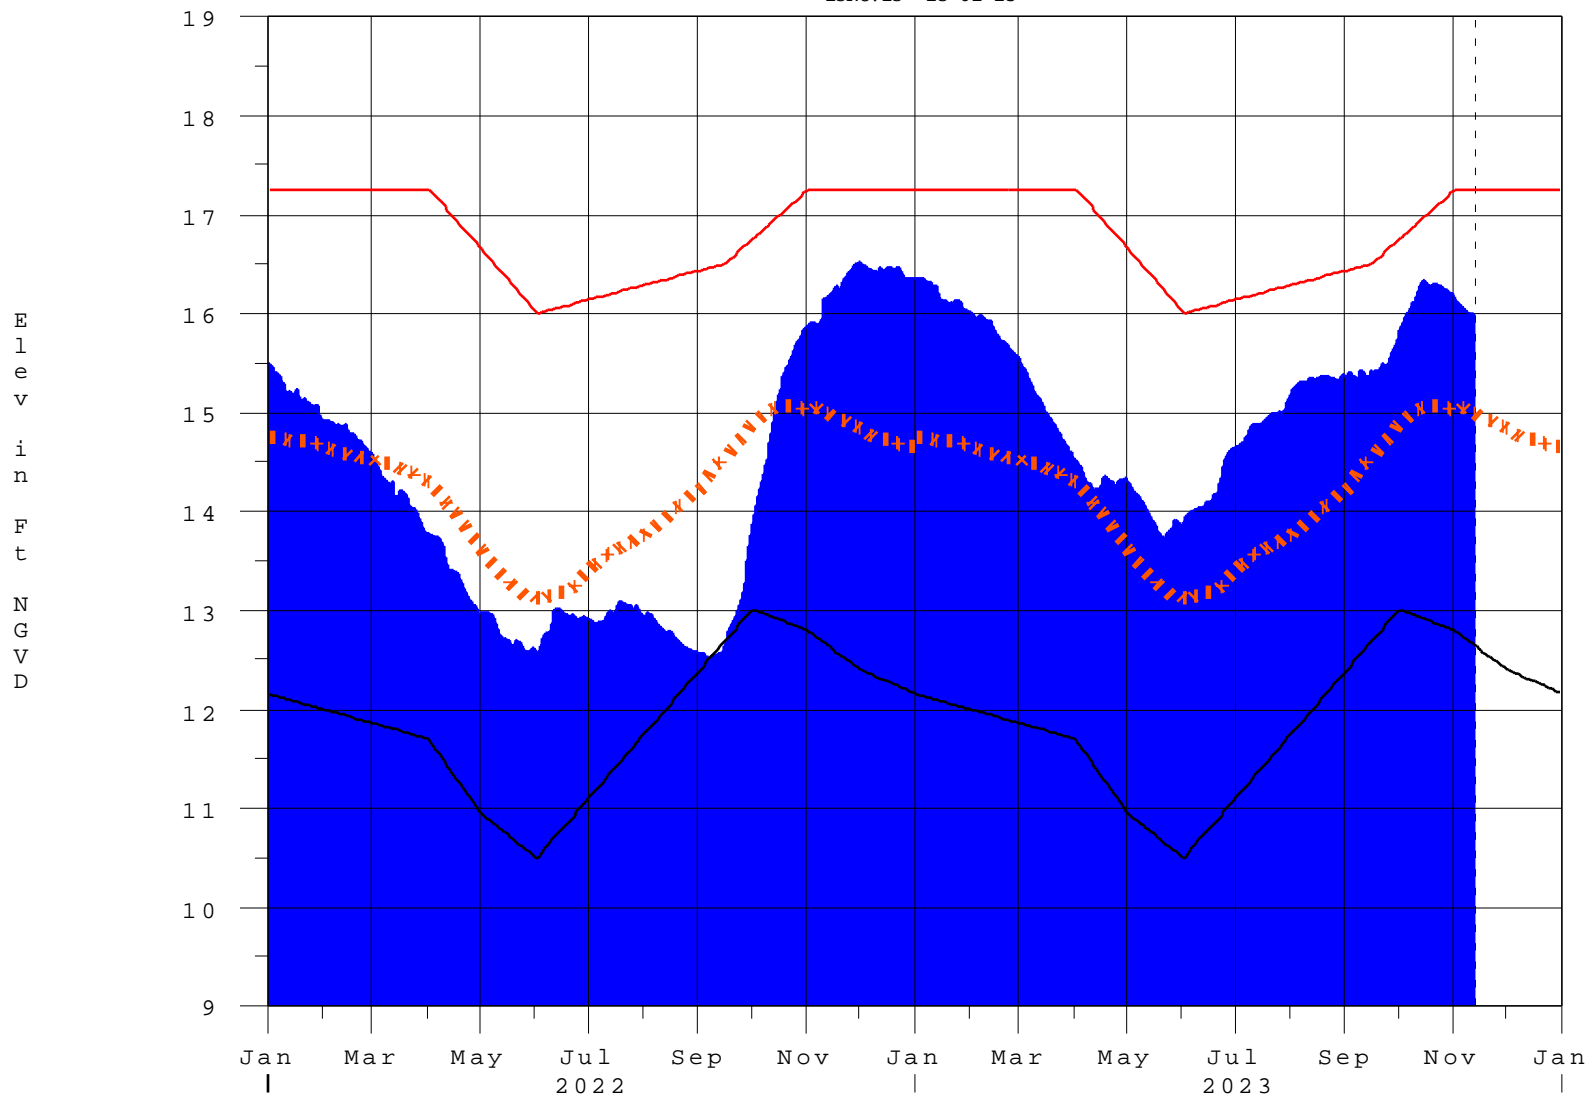

- High Lake Management
- Okeechobee Avg Elev
- Average Elev [1965-2007]
- Water Shortage Management

Classification Tables

Supplemental Tables used in conjunction with the LORS2008 Release

Guidance Flow Charts

- [Class Limits for Tributary Hydrologic Conditions](#)

Table K-2 in the Lake Okeechobee Water Control Plan

- [6-15 Day Precipitation Outlook Categories](#)

Table ?? in the Lake Okeechobee Water Control Plan

- [Classification of Lake Okeechobee Net Inflow for Seasonal Outlook](#)

Table K-3 in the Lake Okeechobee Water Control Plan

- [Classification of Lake Okeechobee Net Inflow for Multi-Seasonal Outlook](#)

Table K-4 in the Lake Okeechobee Water Control Plan

[Back to Lake Okeechobee Operations Main Page](#)

[Back to U.S. Army Corps of Engineers Lake Okeechobee Operations Homepage](#)

Tributary Hydrologic Classification*	Palmer Index Class Limits	2-wk Mean L.O. Net Inflow Class Limits
Very Wet	3.0 or greater	Greater \geq 6000 cfs
Wet	1.5 to 2.99	2500 - 5999 cfs
Near Normal	-1.49 to 1.49	500 - 2499 cfs
Dry	-2.99 to -1.5	-5000 – 500 cfs
Very Dry	-3.0 or less	Less than -5000 cfs

* use the wettest of the two indicators

Classification of Lake Okeechobee Net Inflow Seasonal Outlook*

Lake Net Inflow Prediction [million acre-feet]	Equivalent Depth** [feet]	Lake Okeechobee Net Inflow Seasonal Outlook
> 0.93	> 2.0	Very Wet
0.71 to 0.93	1.51 to 2.0	Wet
0.35 to 0.70	0.75 to 1.5	Normal
< 0.35	< 0.75	Dry

****Volume-depth conversion based on average lake surface area of 467,000 acres**

Classification of Lake Okeechobee Net Inflow Multi-Seasonal Outlook*

Lake Net Inflow Prediction [million acre-feet]	Equivalent Depth** [feet]	Lake Okeechobee Net Inflow Multi-Seasonal Outlook
> 2.0	> 4.3	Very Wet
1.18 to 2.0	2.51 to 4.3	Wet
0.5 to 1.17	1.1 to 2.5	Normal
< 0.5	< 1.1	Dry

**Volume-depth conversion based on average lake surface area of 467,000 acres

6-15 Day Precipitation Outlook Categories*

6-15 Day Precipitation Outlook Categories	WSE Decision Tree Categories
Above Normal	Wet to Very Wet
Normal	Normal
Below Normal	Dry

* Corresponds to Table 7-6 in the Lake Okeechobee Water Control Plan