

MEMORANDUM

TO: Jason Engle, Chief, Engineering Division (USACE)
FROM: John Mitnik, Chief District Engineer (SFWMD)
DATE: October 23, 2025
SUBJECT: System Operational Position Statement October 21, 2025 to October 27, 2025

This Position Statement is to provide operational input for the one-week period from October 21, 2025 to October 27, 2025 based on system conditions and data observed during the previous Monday to Sunday 7-day period.

Current climate conditions: District October rainfall to date is above normal (121% normal). The rainfall forecast (issued October 22) calls for below normal rainfall for the coming 7-day period and the following one.

Climate and weather forecasts: The most recent CPC precipitation outlook for Nov 2025 is slightly increased chances (33-40%) of below Normal rainfall for the Kissimmee River and north, and equal chances of below, normal and above normal rainfall (EC) for the remainder of the District. La Niña conditions are present and favored to persist through December 2025 - February 2026, with a transition to ENSO-neutral likely in January-March 2026. The 3-month windows from Nov 2025 – Jan 2026 to Jan 2026 – Mar 2026 indicate equal chances of below, normal and above normal rainfall (EC) for the Lake Okeechobee and south, and slightly increased chances (33-40%) of below Normal rainfall for the remainder of the District. The 3-month window of Feb 2026 – Apr 2026 shows equal chances of below, normal and above normal rainfall (EC) for areas north of the EAA, increased chances (40-50%) of below Normal rainfall for the Kissimmee River and north and slightly increased chances (33-40%) of below Normal rainfall for the remainder of the District. The 3-month window Mar 2026 – May 2026 shows equal chances of below, normal and above normal rainfall (EC) for the entire District. The 3-month windows from Apr 2026 – Jun 2026 and May 2026 – Jul 2026 indicate increased chances (40-50%) of above Normal rainfall for the state of Florida. The 3-month window from Jun 2026 – Aug 2026 shows outlook of slightly increased chances (33-40%) of above Normal rainfall for the state of Florida. The outlooks for the 3-month windows from Jul 2026 – Sep 2026 to Nov 2026 – Jan 2027 signal equal chances of below, normal and above normal rainfall (EC) for south Florida.

Hydrologic and tropical outlooks: Current climatological conditions are Normal. Current hydrological conditions are Normal. The lake stage is projected to remain in Zone D3 for the next 2 months.



Water-supply conditions: The Lake Okeechobee seasonal net inflow outlook is Dry and at Moderate risk for water supply. The multi-seasonal net inflow outlook is Dry and at High risk for water supply.

Estuary conditions: For the 7-day period, October 13 to October 19, 2025, total inflow to the Caloosahatchee Estuary averaged approximately 1,100 cfs with no flow coming from Lake Okeechobee through S-77. The mean salinities were in the optimal range (0-10) for tape grass in the upper estuary. Salinities were in the optimal range (10-25) for adult eastern oysters at Shell Point and Cape Coral, and in the upper stressed range (>25) at Sanibel. Total discharge to the St. Lucie Estuary was about 1,750 cfs with no flow coming from Lake Okeechobee and the C-44 Basin, about 200 cfs coming from the C-23 Basin, about 350 cfs coming from the C-24 Basin, about 250 cfs coming from Ten Mile Creek, and about 900 cfs coming from the Tidal Basin. The average salinity in the middle estuary was within the lower stress range (<5) for adult eastern oysters.

Lake Okeechobee stage and ecological conditions:

On October 19 the daily average Lake Okeechobee stage was 12.60 feet NAVD88 (13.91 feet NGVD29), which placed it within the lower portion of Zone D (Zone D3 of the PA25 simulation) of the Lake Okeechobee System Operating Manual (LOSOM). Lake stage increased by 0.07 feet over the preceding 7-day period. La Niña conditions are present and favored to persist in the next couple of months. The District will continue to monitor conditions in the estuaries, as well as the systemwide conditions. With the initiation of the dry season, Normal Lake Operations continue pursuant to the considerations in LOSOM as informed by PA25. To maintain favorable salinity levels in the estuaries and continue to conserve water, it is recommended that flow targets for the Caloosahatchee Estuary should rely on basin flows to ensure the delivery of the Minimum Flow and Level, but use Lake Okeechobee flows from S-77 to ensure S-79 flows remain above a targeted steady release of 350 cfs; flow targets for the St. Lucie Estuary and Lake Worth Lagoon should remain at 0 cfs consistent with Normal Operations within Zone D. The District will continue to monitor salinity conditions in the estuaries and water supply conditions within the Lake Okeechobee Service Area. The USACE typically implements the releases to the estuaries over a 7-day period starting on Saturday and ending on Friday.

Forecast Modeling Based on PA25 Simulation

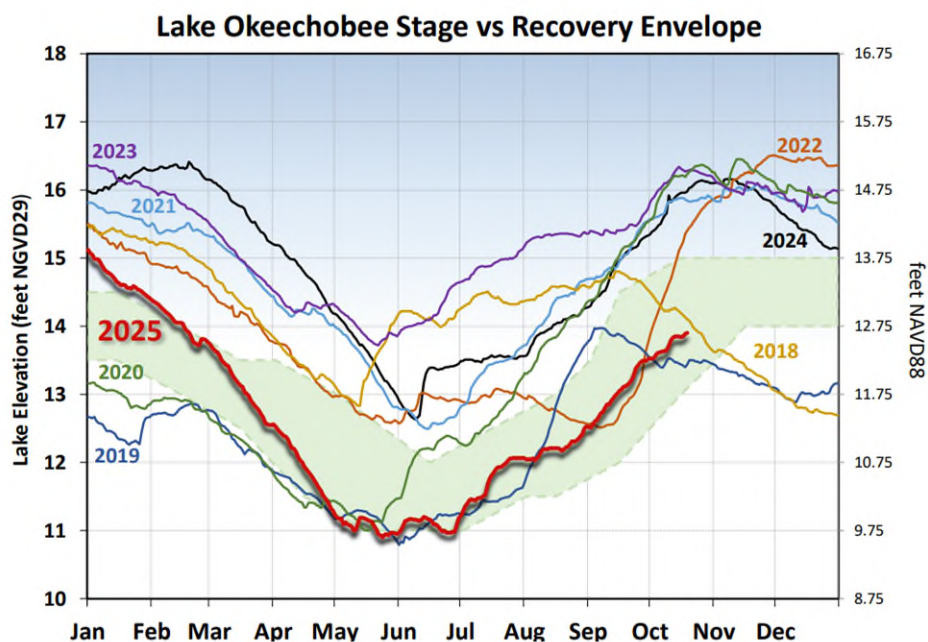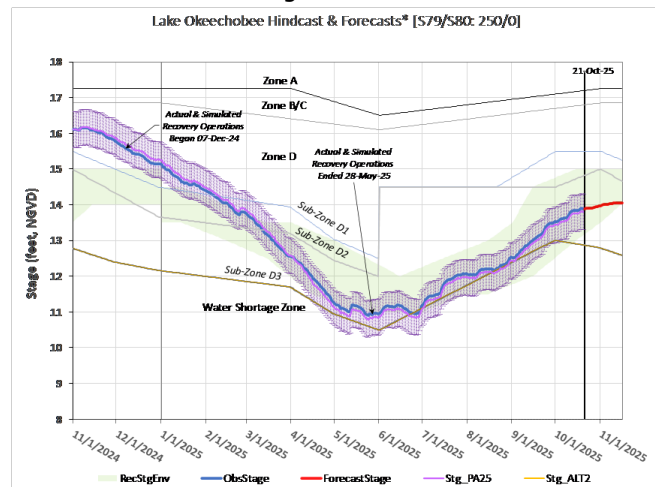

The current and seven prior years' annual stage hydrographs for Lake Okeechobee in comparison to the recovery envelope (light green). A shift from the normal ecological envelope to the recovery envelope occurred because the 30-day minimum lake stage (elevations exposed for at least 30 days, nonconsecutively) in the June 1 – July 31, 2023 window was >11.75 feet NAVD88 (13 feet NGVD29).

Navigation and recreation conditions: Currently, there are no planned deviation or declared water shortage impacting navigation or lockages.

STOF water supply conditions: Current Lake Okeechobee stage is sufficiently high that water supply deliveries to the Seminole Tribe of Florida (STOF) Brighton Reservation, if needed, will not be impacted. When Lake Okeechobee stage recedes below 8.75 feet NAVD88 (10 feet NGVD29) and 6.75 feet NAVD88 (8 feet NGVD29), water supply delivery is not achievable via Pump Station G-207 on the Harney Pond Canal and Pump Station G-208 on the Indian Prairie Canal, respectively, as the respective canals become disconnected from Lake Okeechobee.





Algal Bloom conditions: The Fish and Wildlife Research Institute reported on October 17, 2025, that *Karenia brevis*, the Florida red tide dinoflagellate, was not observed in any samples collected within the District region over the past week. In the most recent non-obscured satellite image from October 19, 2025, NOAA's Harmful Algal Bloom Monitoring System suggests low to moderate cyanobacteria potential in the northern and western nearshore areas of the lake.


STA conditions: In STA-1E, Central Flow-way is offline for construction activities. An operational restriction is in place in the Western Flow-way for post-construction vegetation grow-in. Online treatment cells are at or above target stage. In STA-1W, Eastern Flow-way is online with restrictions for G-253 structure replacements. Treatment cells are near target stage. Vegetation in the Western and Eastern flow-ways is highly stressed. The 365-day PLRs for the Eastern and Northern Flow-ways are below 1.0 g/m²/yr. The 365-day PLR for the Western Flow-way is high (≥ 1.0 g/m²/yr). In STA-2, operational restriction is in place in Flow-way 3 for post-drawdown vegetation grow-in and in Flow-ways 2 and 4 for vegetation management activities. Treatment cells are at or above target stage. The 365-day PLRs for all flow-ways are below 1.0 g/m²/yr. In STA-3/4, An operational restriction is in place in the Eastern Flow-way for vegetation management activities. Treatment cells are above target stage, vegetation in the Central flow-ways is highly stressed, and the 365-day PLRs for the Eastern, Central and Western Flow-ways are below 1.0 g/m²/yr. For the current operational period, USACE is not requesting flows south from Lake Okeechobee towards the WCAs. The District will continue to work with the USACE to manage Lake Okeechobee levels in an effort to curtail harmful discharges over this year. To help with this objective the District will move as much water south through the Stormwater Treatment Areas as possible under the current permits as regional conditions allow.

WCA conditions: On October 19 the daily average stage in WCA-1 was at 15.55 feet NAVD88 (17.15 feet NGVD29), in Zone A2 and 0.35 feet below regulation schedule. The daily average stage in WCA-2A was at 12.66 feet NAVD88 (14.17 feet NGVD29), in Zone A and 1.48 feet above regulation schedule. The daily average stage in WCA-3A was at 8.18 feet NAVD88 (9.70 feet NGVD29), in Zone B and 0.72 feet below regulation schedule. Over the 7-day period, October 13 to October 19, 2025, no regulatory releases were sent from Lake Okeechobee south to the STAs. No Lake regulatory releases reached the Lake Worth Lagoon through the C-51 canal during this period.

ENP conditions: Releases from WCA-3A to the ENP continue through the S-12D and S333 structures. Hydrologic connectivity continues to strengthen in all three major sloughs within ENP. The SFWDAT model output illustrates a continued steady increase in depths within WCA-1. The southern two-thirds of WCA-2A are very deep for this time of year. The entire WCA-2A basin remains well above the average depth for this time of year, with a majority of that basin in the 90th percentile. Dry conditions persist in Northeastern WCA-3A along the L-38W canal. Depths show slight increases across WCA-3A but remain relatively low in southern and northeastern WCA-3A North. Stages decreased in Taylor Slough last week and remain above the recent average. Salinity decreased on average in Florida Bay compared to last week and remains above the estimated historical average and is within the WY2001-2016 Interquartile Range (IQR) for all three regions, though is nearing the 75th percentile in the central region. The Tamiami Trail Flow Formula (TTFF) recommends 918 cfs of daily target releases from WCA-3A to ENP. The District recommends continuing with the current operations for the releases from WCA-3A in accordance with the Combined Operating Plan.

October 2025 Conditional Position Analysis (CPA) results for Lake Okeechobee, WCA-1, WCA-2A and WCA-3A under LOSOM Recovery Operations.

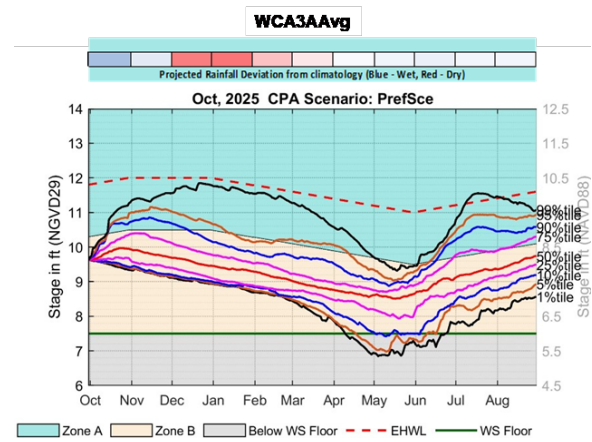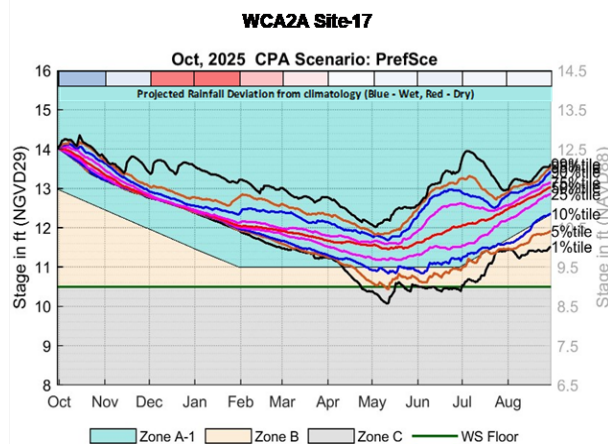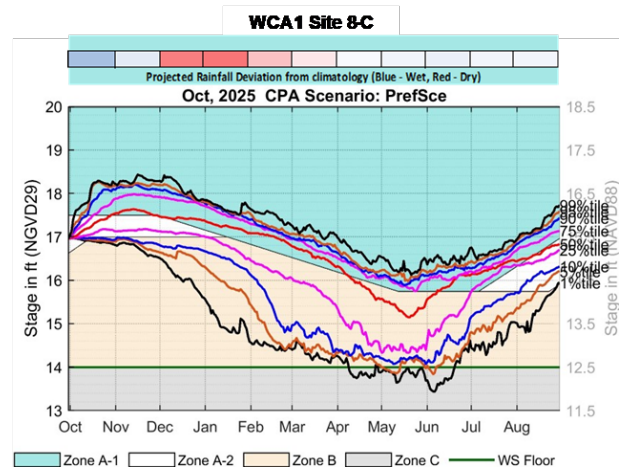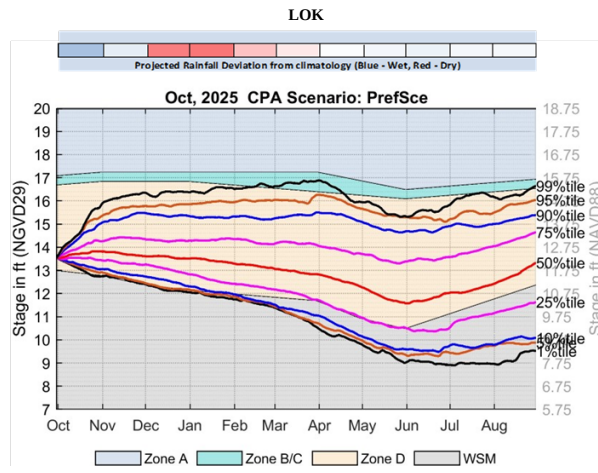

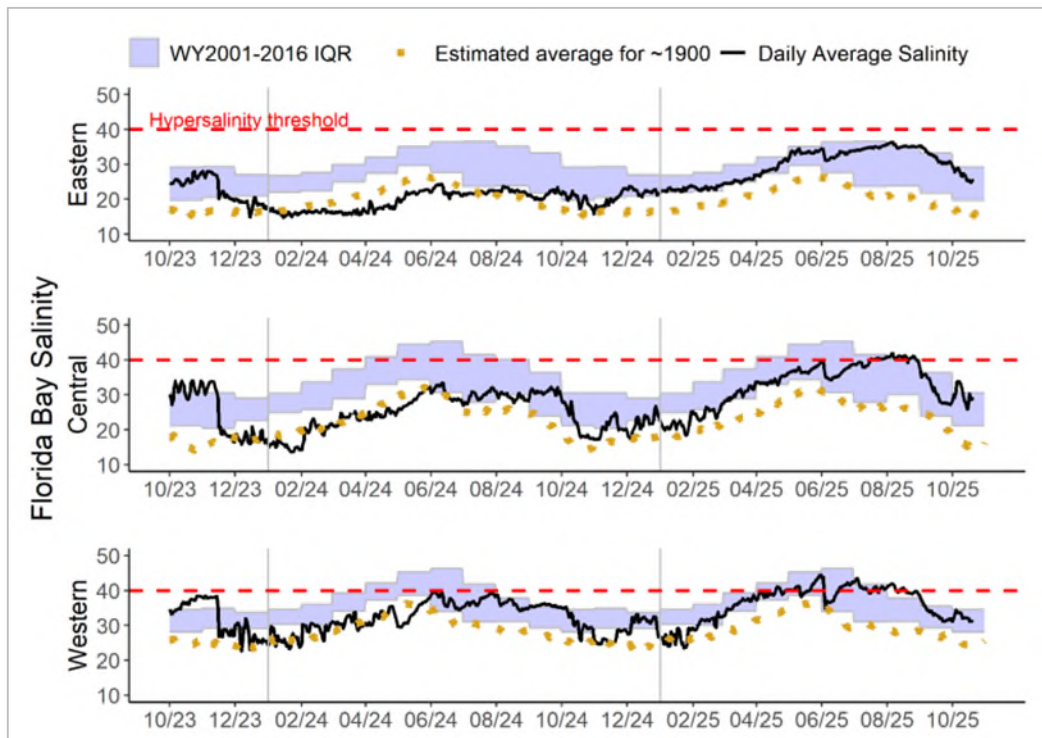

Eastern (top panel), Central (middle panel) and Western (bottom panel) Florida Bay daily average salinities with WY2001-2016 interquartile (25-75 percentile) ranges (IQR) and estimated historical daily average salinities. The hyper salinity threshold indicates the level at which salinities start to become harmful to seagrass.