

# Application of the Lake Okeechobee Regulation Schedule (LORS2008) on 2/22/2016 (El Nino Condition)

## Lake Okeechobee Net Inflow Outlook:

The Lake Okeechobee Net Inflow Outlook has been computed using 4 methods: Croley's method<sup>1</sup>, the SFWMD empirical method<sup>2</sup>, a sub-sampling of El Nino years<sup>3</sup> and a sub-sampling of warm years of the Atlantic Multi-decadal Oscillation (AMO) in combination with El Nino ENSO years<sup>4</sup>. The results for Croley's method and the SFWMD empirical method are based on the [CPC Outlook](#).

Table of the Lake Okeechobee Net Inflow Outlooks in feet of equivalent depth. All methods are updated on a weekly basis with observed net inflow for the current month.

Season	Croley's Method <sup>1*</sup>		SFWMD Empirical Method <sup>2</sup>		Sub-sampling of El Nino ENSO Years <sup>3</sup>		Sub-sampling of AMO Warm + El Nino ENSO Years <sup>4</sup>	
	Value (ft)	<a href="#">Condition</a>	Value (ft)	<a href="#">Condition</a>	Value (ft)	<a href="#">Condition</a>	Value (ft)	<a href="#">Condition</a>
Current (Feb-Jul)	N/A	N/A	2.01	Very Wet	2.19	Very Wet	3.07	Very Wet
Multi Seasonal (Feb-Oct)	N/A	N/A	3.65	Wet	4.04	Wet	5.79	Very Wet

**\*Croley's Method Not Produced For This Report**

See [Seasonal](#) and [Multi-Seasonal](#) tables for the classification of Lake Okeechobee Outlooks.

The recommended methods and values for estimating the Lake Okeechobee Net Inflow Outlook are shaded and should be used in the LORS2008 Release Guidance Flow Charts.

## [Tributary Hydrologic Conditions Graph:](#)

**6043 cfs** 14-day running average for Lake Okeechobee Net Inflow through 2/22/2016. According to the classification in [Tributary Hydrologic Conditions](#) table, this condition is Very Wet.

**1.45** for Palmer Index on 2/21/2016.

According to the classification in [Tributary Hydrologic Conditions](#) table, this condition is Normal.

The wetter of the two conditions above is **Very Wet**.

## [LORS2008 Classification Tables:](#)

### Lake Okeechobee Stage on 2/22/2016

Lake Okeechobee Stage: **16.11 feet**

[USACE Report for Lake Okeechobee](#)

[Lake Okeechobee Stage Hydrograph](#)

Lake Okeechobee Management Zone/Band		Bottom Elevation (feet, NGVD)	Current Lake Stage
High Lake Management Band		17.25	
Operational Band	High sub-band	16.66	
	Intermediate sub-band	15.82	← 16.11
	Low sub-band	13.50	
Base Flow sub-band		12.60	
Beneficial Use sub-band		11.89	
Water Shortage Management Band			

**[Part C of LORS2008: Discharge to WCA's](#)**

Release Guidance Flow Chart Outcome: No Releases to the WCAs

**[Part D of LORS2008: Discharge to Tidewater](#)**

Release Guidance Flow Chart Outcome: S-77 up to 6500 cfs and S-80 up to 2800 cfs

**Technical Input Summaries from:**

- [Lake Okeechobee Division](#)
- [Coastal Ecosystems](#)
- [Everglades Ecosystems Division](#)
- [Water Supply Department](#)
- [Water Resource Management Release Recommendation](#)
- [Kissimmee Watershed Environmental Conditions](#)
- [Operations Department](#)

**[Back to Lake Okeechobee Operations Main Page](#)**

**[Back to U.S. Army Corps of Engineers LORSS Homepage](#)**

## LORS2008 Implementation on 2/22/2016 (ENSO El Nino Condition):

### Water Supply Department Technical Input

#### Water Supply Outlook:

District wide, Raindar rainfall 0.96 inches for the week ending 2/22/2016. Lake stage on 2/22/2016 is 16.11 ft, down 0.10 ft from last week.

The updated January 2016 SFWMM Dynamic Position Analysis [percentile graph](#) and [tracking chart](#) for Lake Okeechobee show that the lake stage is in the Intermediate Operational Sub-Band.

The LORS2008 tributary [indices](#) are classified as **Very Wet**. The PDSI indicates normal condition and the LONIN is Very Wet. The classification is based on the wetter of the two.

#### Water Supply Risk Evaluation


Area	Indicator	Value	Color Coded Scoring Scheme
LOK	Projected LOK Stage for the next two months	*Intermediate Flow Sub-Band	L
	Palmer Index for LOK Tributary Conditions	1.45 (Normal)	L
	CPC Precipitation Outlook	1 month: Above Normal	L
		3 months: Above Normal	L
	LOK Seasonal Net Inflow Forecast AMO warm/El Nino	2.19 ft (Normal to Extremely Wet)	L
	LOK Multi-Seasonal Net Inflow Forecast AMO warm/El Nino	4.04 ft (Wet)	L
			L
WCAs	WCA 1: Site 1-7, Site 1-8T, & Site 1-9 Average	Above Line 1 (16.91 ft)	L
	WCA 2A: Site 2-17 HW	Above Line1 (13.51 ft)	L
	WCA-3A: 3 Station Average (Site 63, 64 and 65)	Above Line 1 (11.50 ft)	L
LEC	Service Area 1	Year-Round Irrigation Rule in effect	L
	Service Area 2	Year-Round Irrigation Rule in effect	L
	Service Area 3	Year-Round Irrigation Rule in effect	L

Note: The water supply risk classification based on the Palmer index, as well as the LOK seasonal and multi-seasonal net inflow forecasts use slightly different classification intervals than those used by the 2008-LORS for classifying the tributary hydrologic condition (THC).

[Back to Lake Okeechobee Operations Main Page](#)

[Back to U.S. Army Corps of Engineers LORSS Homepage](#)


# Lake Okeechobee SFWMM Feb 2016 Dynamic Position Analysis

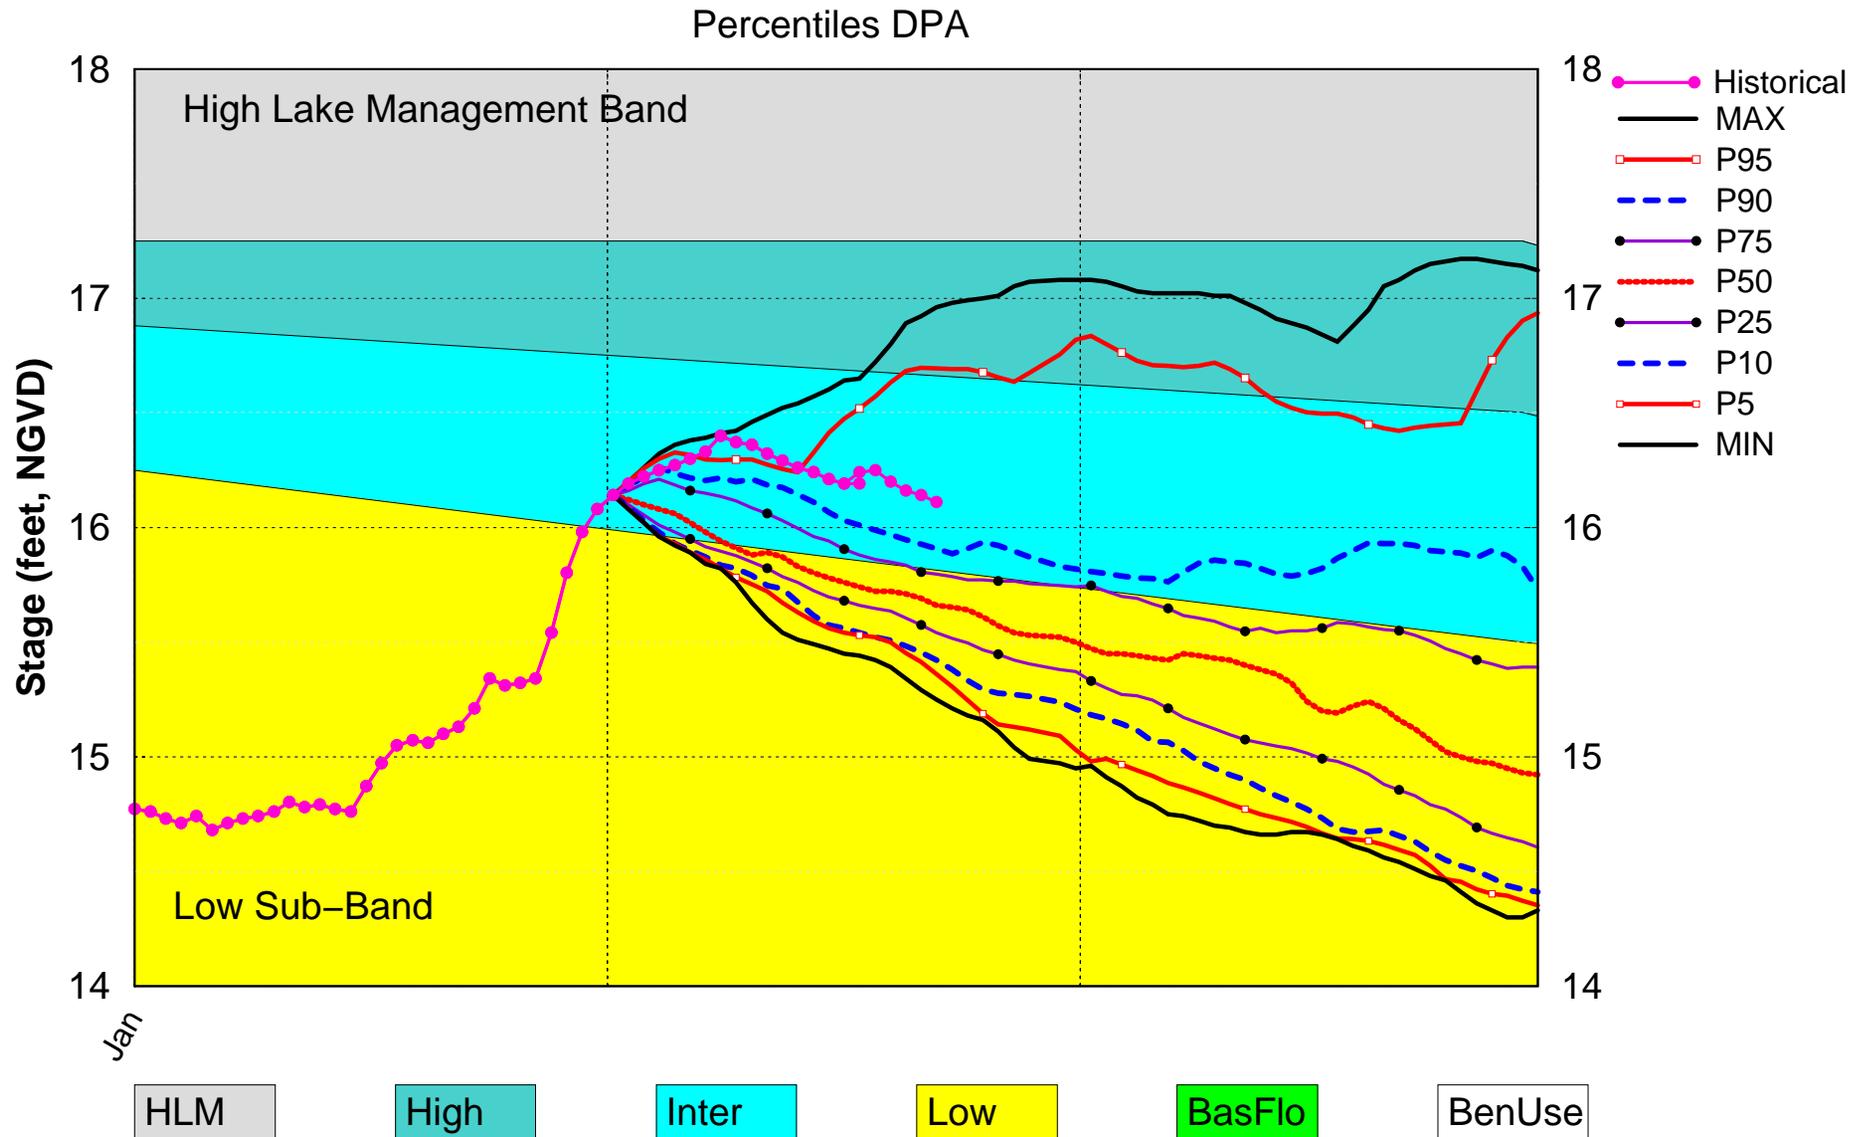


(See assumptions on the Position Analysis Results website)

# Tributary Basin Condition Indicators as of February 22 2016

## Palmer Index

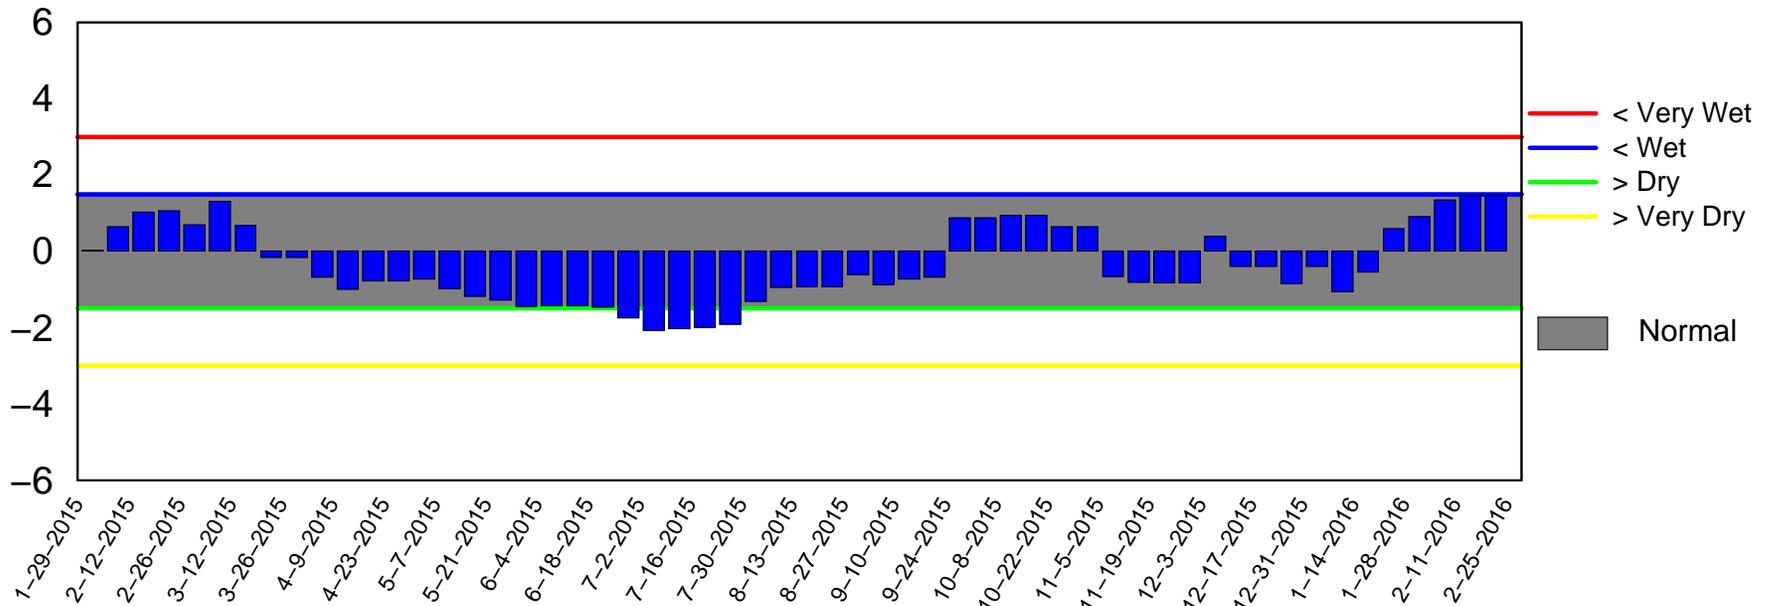

## Lake Okeechobee Net Inflow (LONIN) 14-day Running Average

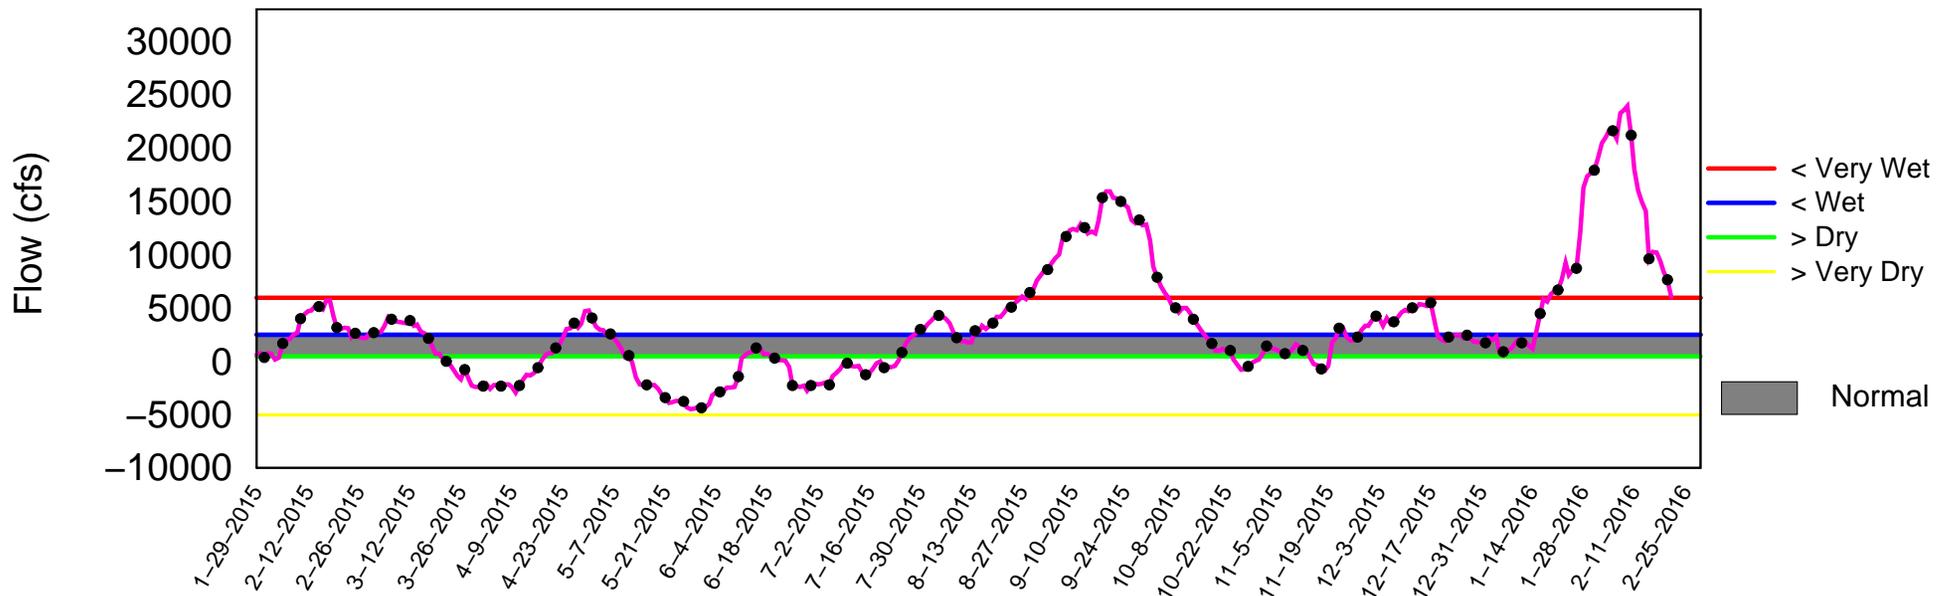

Mon Feb 22 13:07:35 EST 2016

# 2008 LORS

## Part C: Establish Allowable Lake Okeechobee Releases to the Water Conservation Areas

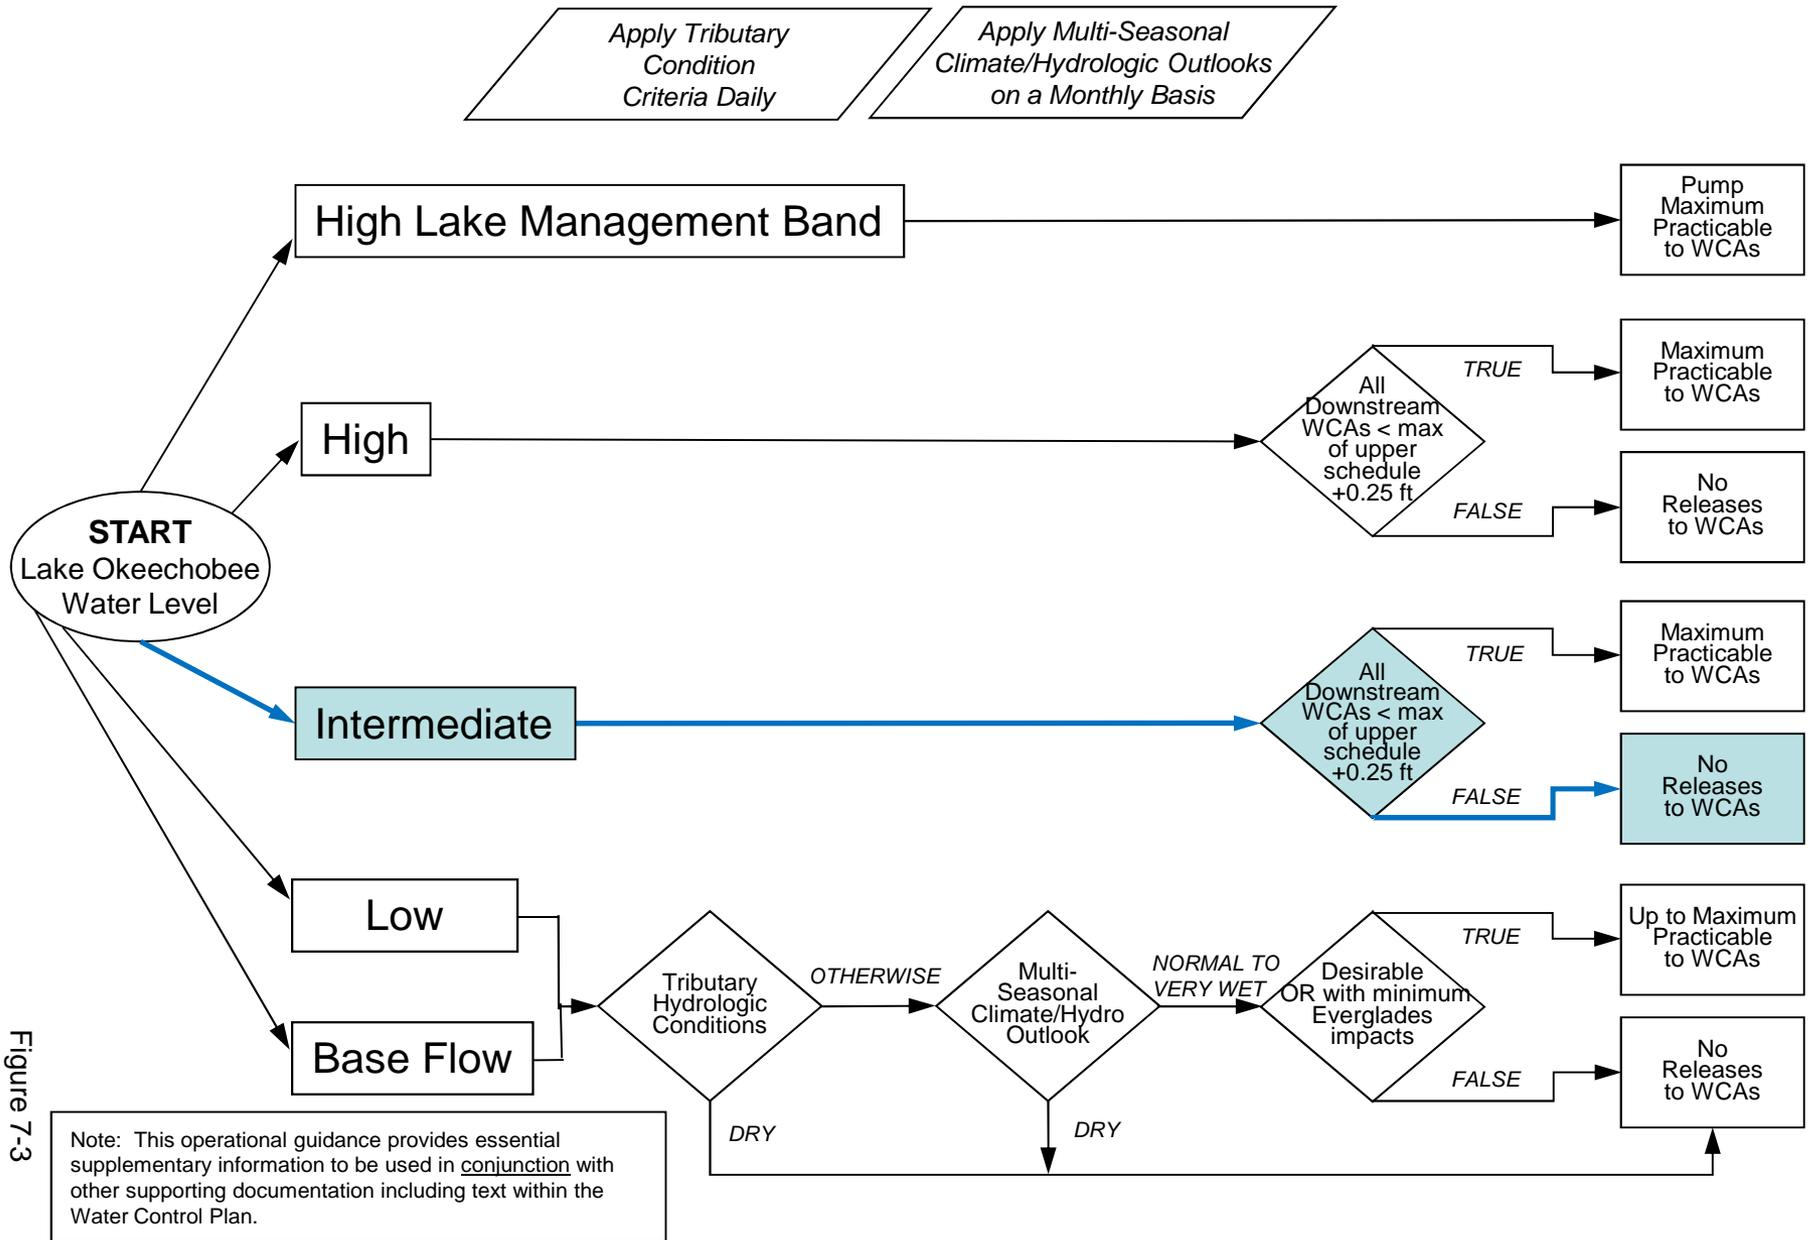


Figure 7-3


# 2008 LORS

## Part D: Establish Allowable Lake Okeechobee Releases to Tide (Estuaries)

Note: This operational guidance provides essential supplementary information to be used in conjunction with other supporting documentation including text within the Water Control Plan.

When conducting Base Flow releases, flows can be distributed East and West up to 650 cfs as needed to minimize impacts or provide benefits through S-80 and S-79

Apply Meteorological Forecasts on a Weekly Basis; apply Seasonal and Multi-Seasonal Climate/Hydrologic Outlooks on a Monthly Basis

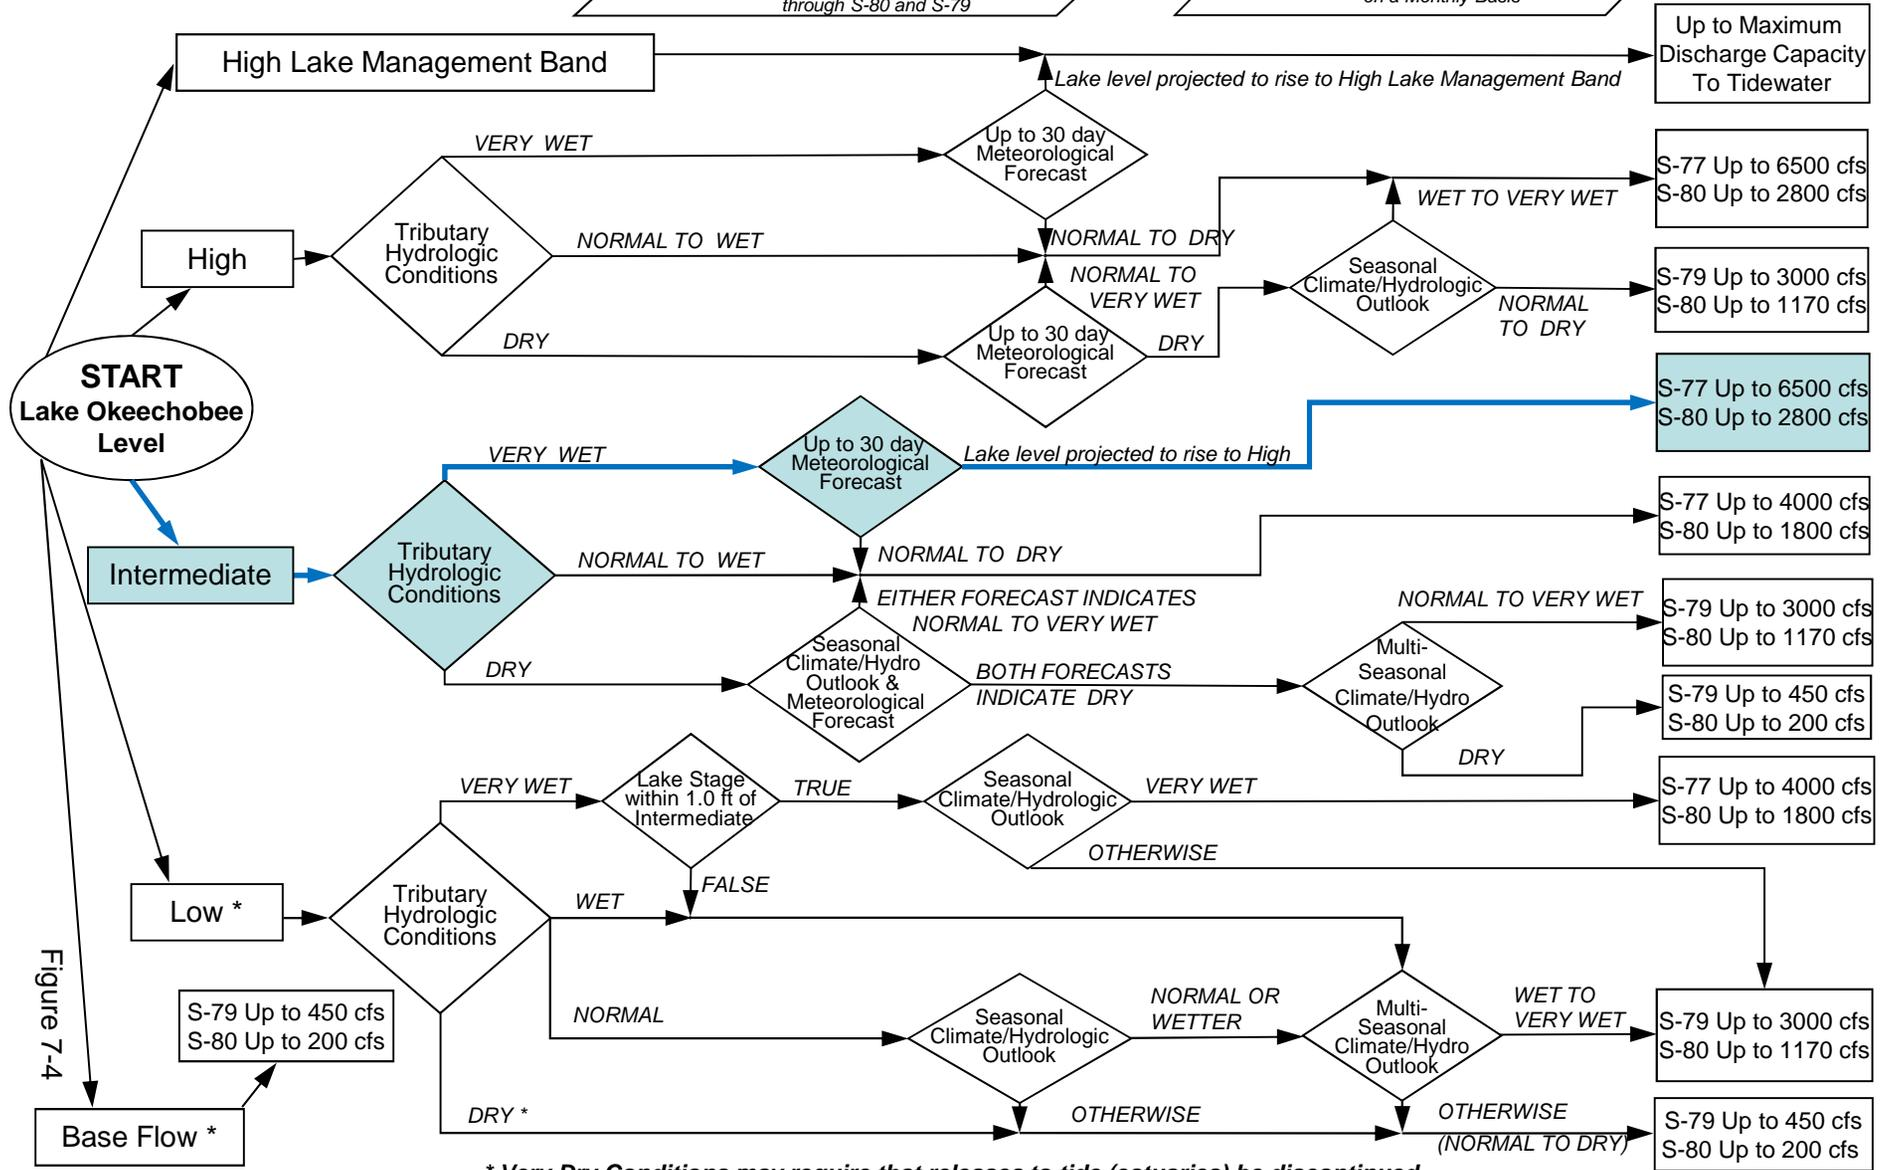

\* Very Dry Conditions may require that releases to tide (estuaries) be discontinued

Figure 7-4

# 2008 LORS FORECAST

## Part C: Establish Allowable Lake Okeechobee Releases to the Water Conservation Areas

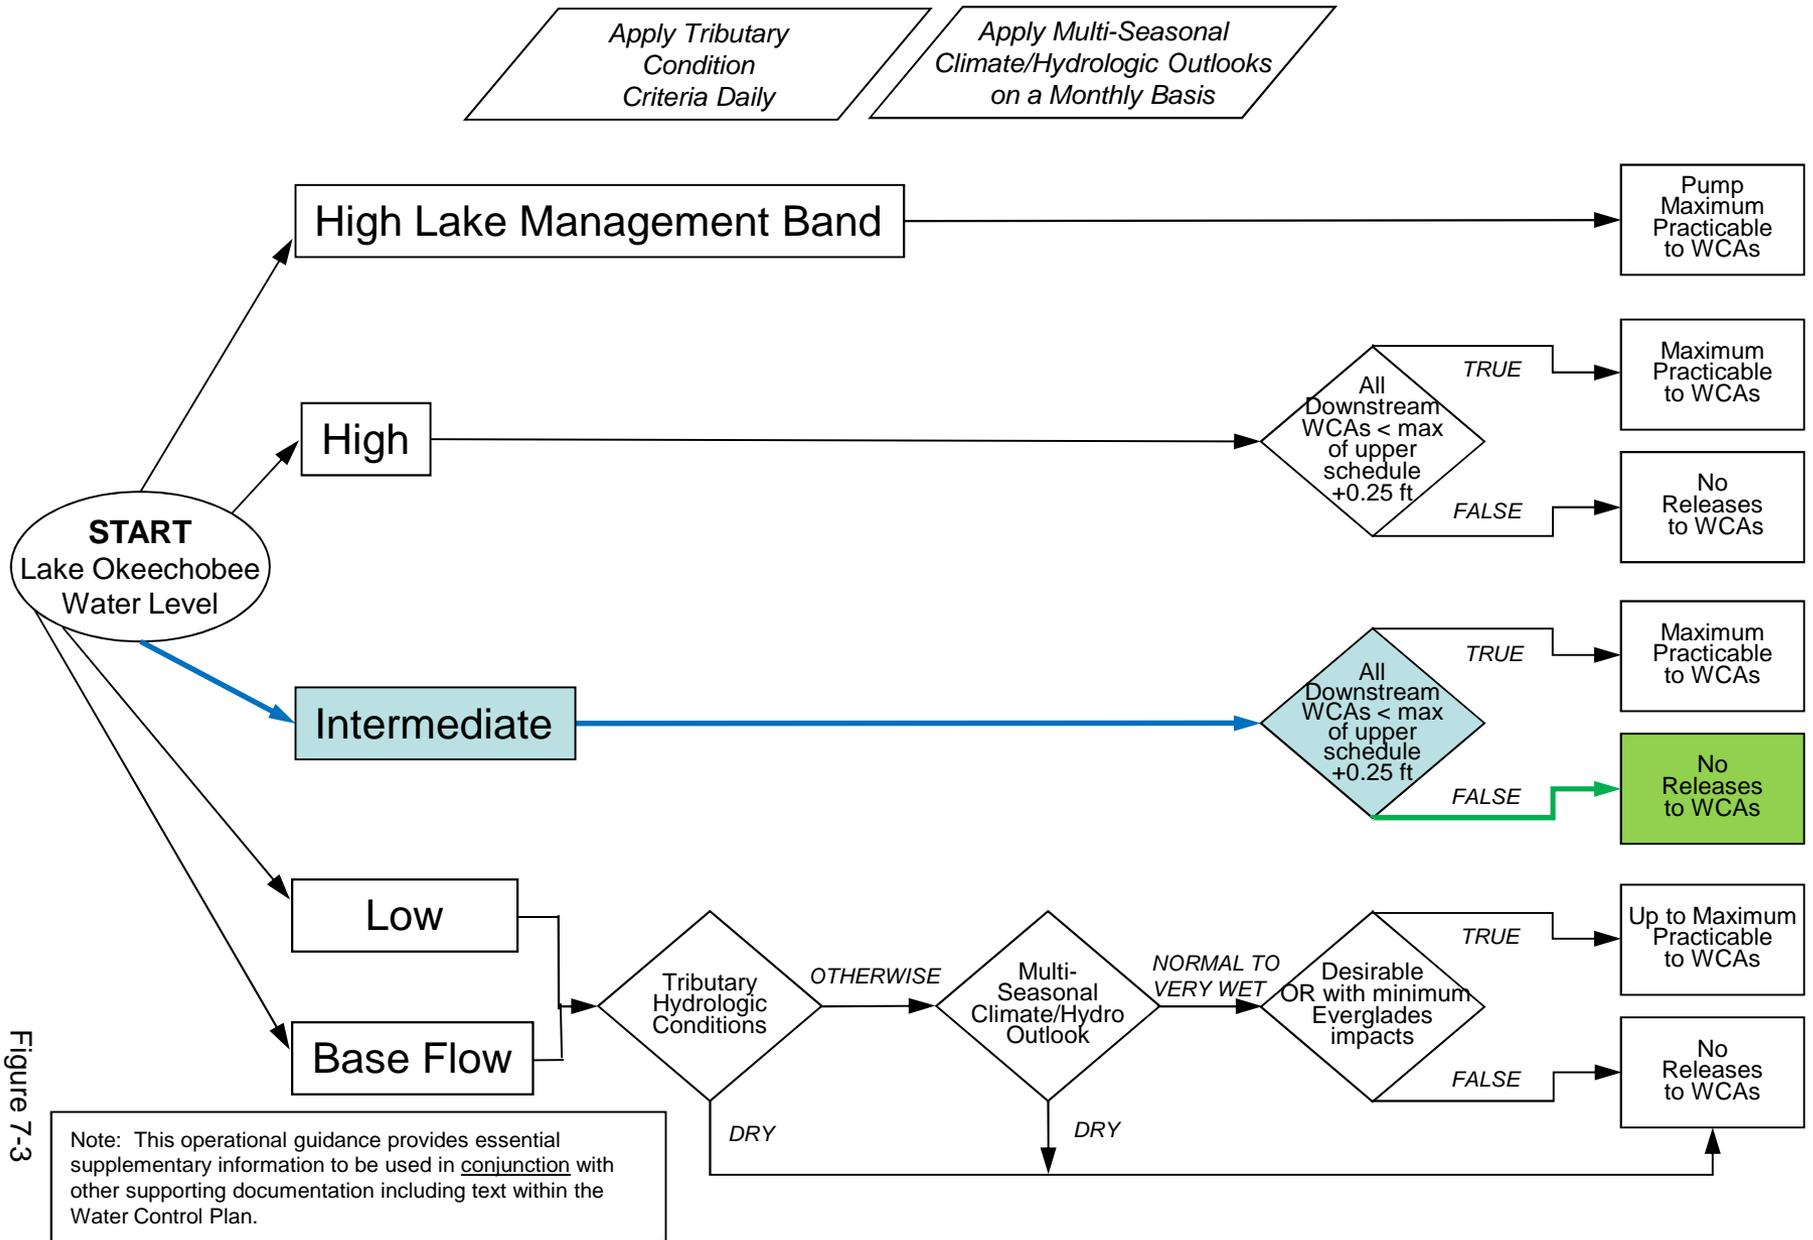


Figure 7-3

# 2008 LORS FORECAST

## Part D: Establish Allowable Lake Okeechobee Releases to Tide (Estuaries)

Note: This operational guidance provides essential supplementary information to be used in conjunction with other supporting documentation including text within the Water Control Plan.

When conducting Base Flow releases, flows can be distributed East and West up to 650 cfs as needed to minimize impacts or provide benefits through S-80 and S-79

Apply Meteorological Forecasts on a Weekly Basis; apply Seasonal and Multi-Seasonal Climate/Hydrologic Outlooks on a Monthly Basis


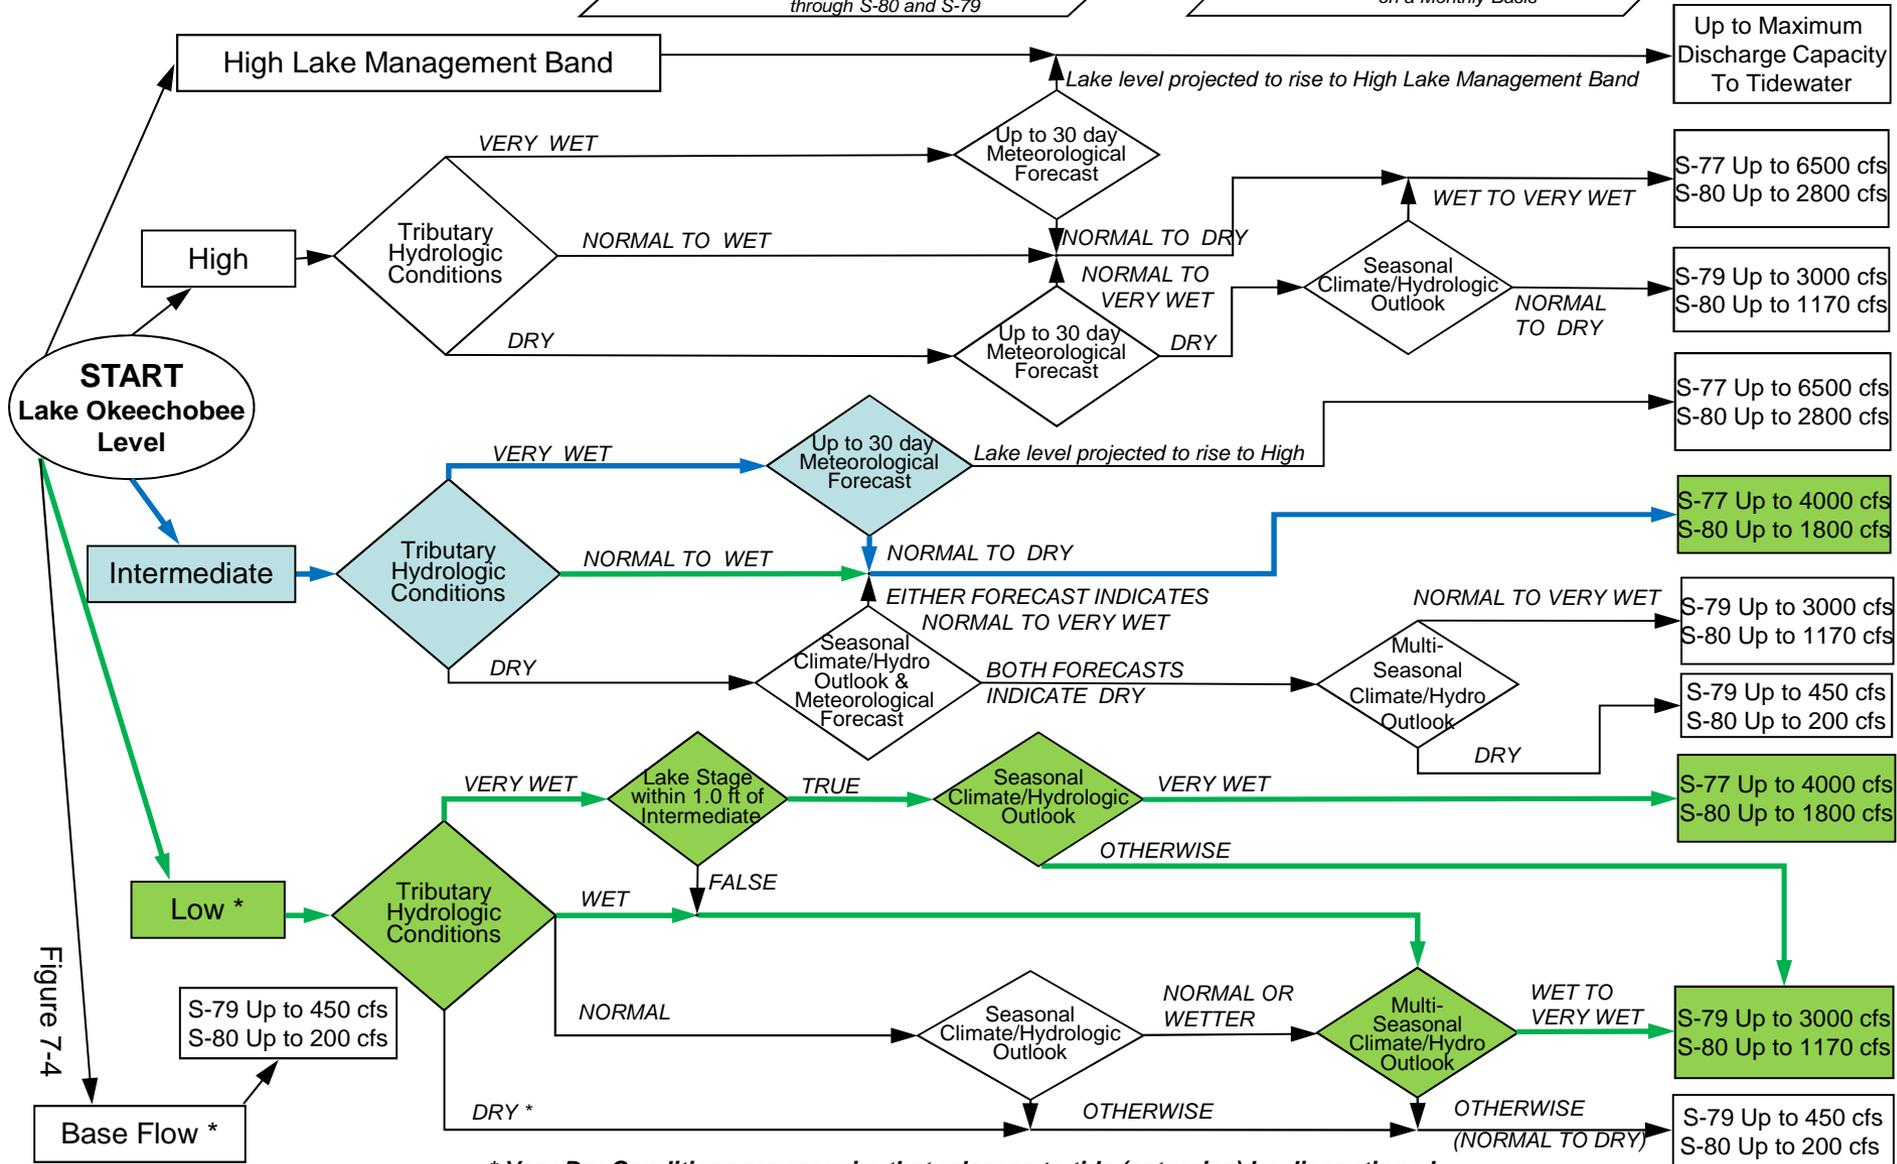


Figure 7-4

\* Very Dry Conditions may require that releases to tide (estuaries) be discontinued

# Lake Okeechobee Water Level History and Projected Stages

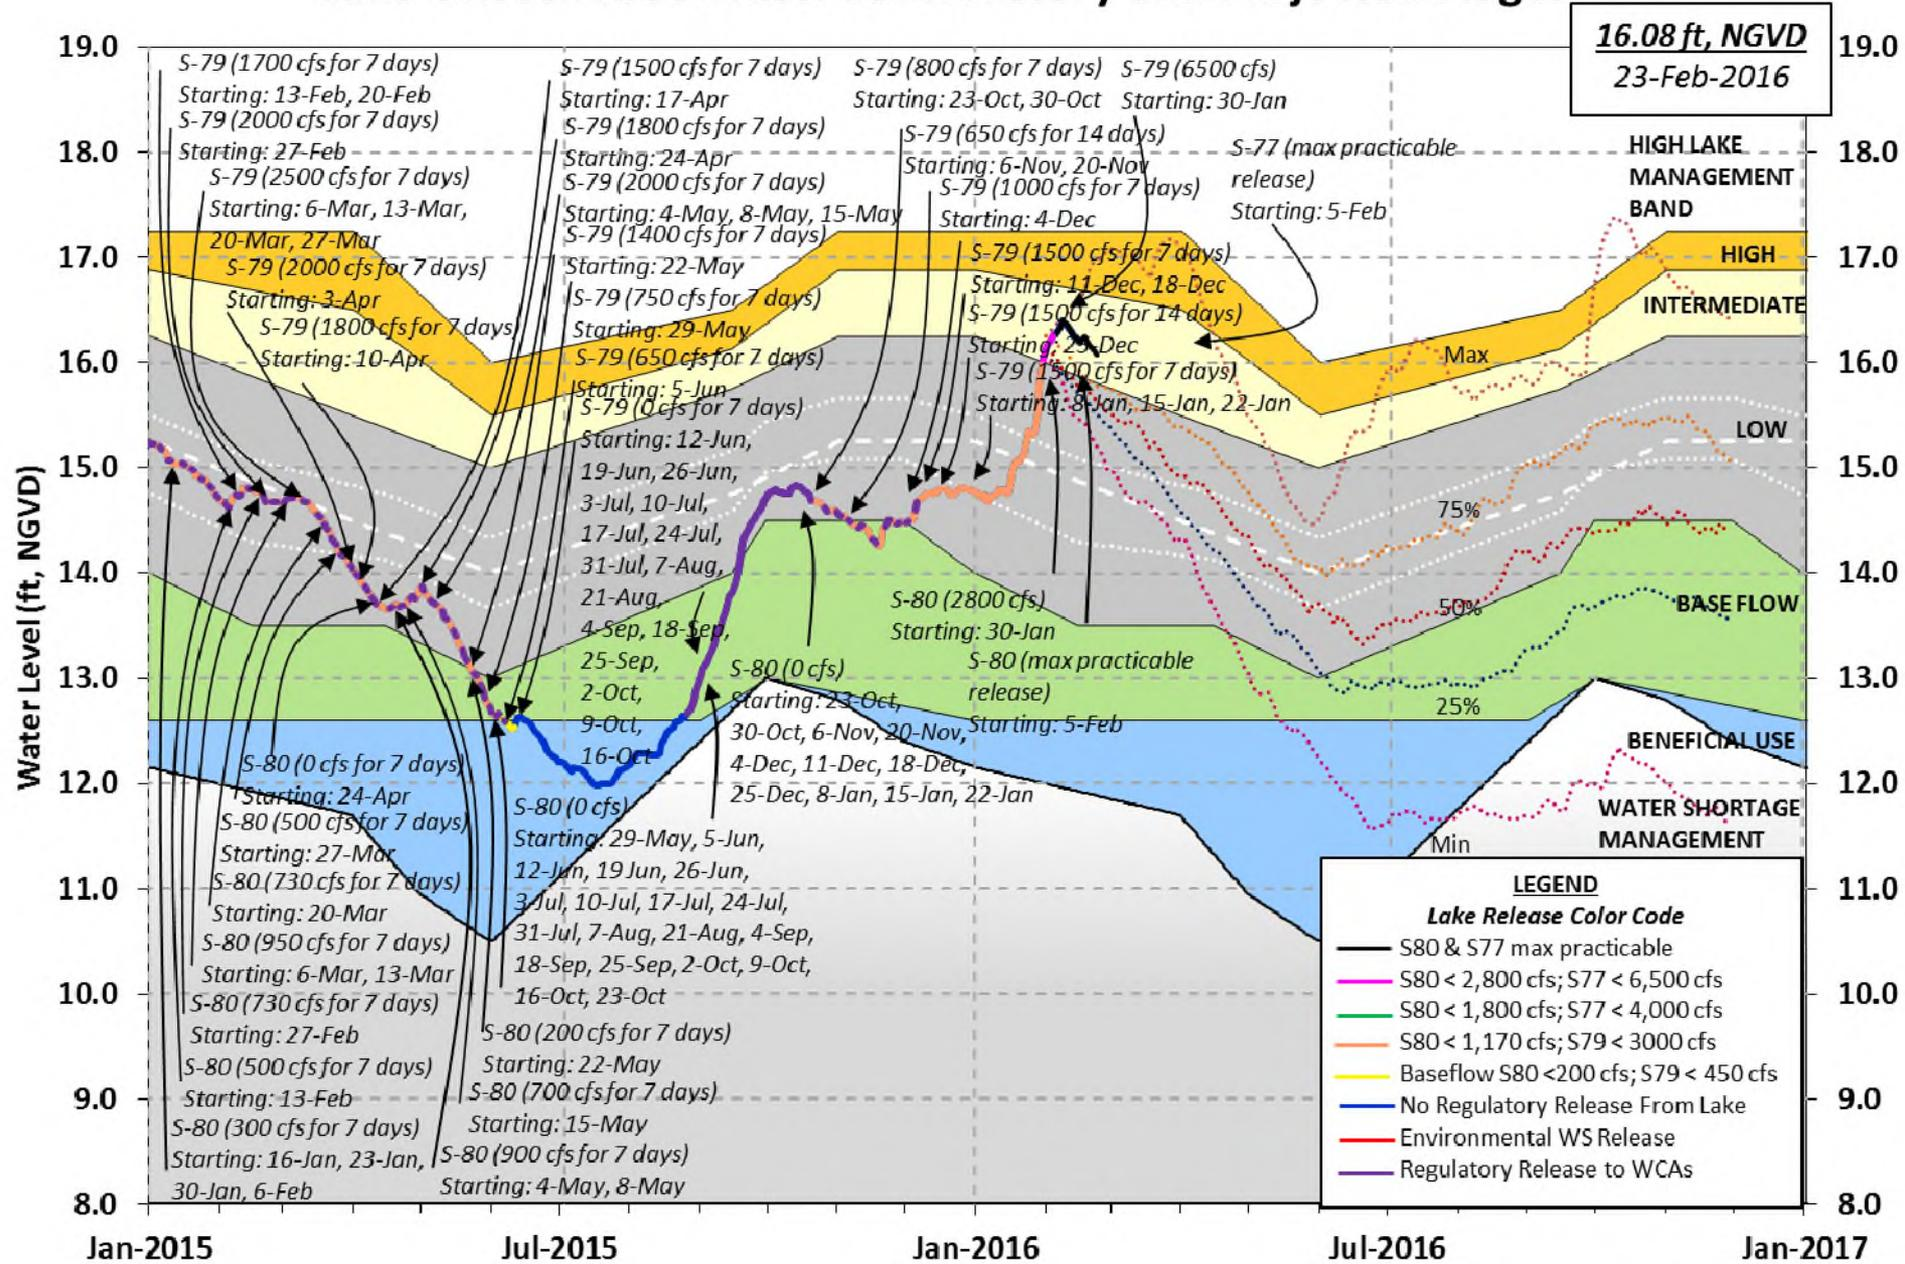

U. S. Army Corps of Engineers, Jacksonville District  
 Lake Okeechobee and Vicinity Report  
 \*\* Preliminary Data - Subject to Revision \*\*

Data Ending 2400 hours    21 FEB 2016

Okeechobee Lake Regulation	Elevation	Last Year	2YRS Ago
	(ft-NGVD)	(ft-NGVD)	(ft-NGVD)
*Okeechobee Lake Elevation	16.11	14.68	13.99 (Official Elv)
Bottom of High Lake Mngmt=	17.25	Top of Water Short Mngmt=	11.89
Currently in Operational Management Band			
Simulated Average LORS2008 [1965-2000]		13.37	
Difference from Average LORS2008		2.74	
21FEB (1965-2007) Period of Record Average		14.55	
Difference from POR Average		1.56	

Today Lake Okeechobee elevation is determined from the 4 Int & 4 Edge stations

++Navigation Depth (Based on 2007 Channel Condition Survey) Route 1 ÷ 10.05'  
 ++Navigation Depth (Based on 2008 Channel Condition Survey) Route 2 ÷ 8.25'  
 Bridge Clearance = 47.75'

4 Interior and 4 Edge Okeechobee Lake Average (Avg-Daily values):

L001	L005	L006	LZ40	S4	S352	S308	S133
15.97	16.17	16.13	16.09	16.15	16.25	16.05	16.06

\*Combination Okeechobee Avg-Daily Lake Average = 16.11  
 (\*See Note)

Okeechobee Inflows (cfs):

S65E	2522	C5	-122	Fisheating Cr	548
S154	61	S191	0	S135 Pumps	0
S84	0	S133 Pumps	0	S2 Pumps	0
S84X	620	S127 Pumps	0	S3 Pumps	0
S71	109	S129 Pumps	0	S4 Pumps	0
S72	338	S131 Pumps	0		
Total Inflows:	4076				

Okeechobee Outflows (cfs):

S135 Culverts	0	S354	0	S77	(Not Used)
S127 Culverts	-NR-	S351	0	S77Below	6278
(USED)					
S129 Culverts	0	S352	0	S308	(Not Used)

S131 Culverts -NR- L8 Canal Pt 54 S308Below 3500  
 (USED)  
 Total Outflows: 9833

\*\*\*\*S77 Structure outflow is being used to compute Total Outflow.  
 \*\*\*\*S308 Structure outflow is being used to compute Total Outflow.

Okeechobee Pan Evaporation (inches):  
 S77 0.16 S308 0.10  
 Average Pan Evap x 0.75 Pan Coefficient = 0.10" = 0.01'

Lake Average Precipitation using NEXRAD: = 0.00" = 0.00'

Evaporation - Precipitation: = 0.10" = 0.01'  
 Evaporation - Precipitation using Lake Area of 730 square miles  
 is equal to 1914 cfs out of the lake.  
 Lake Okeechobee (Change in Storage) Flow is -6806 cfs or -13500 AC-FT

Note: Headwater, tailwater, and stage values below are instantaneous values unless otherwise specified.

---	Headwater Tailwater		Disch	----- Gate Positions -----						
	Elevation	Elevation		#1	#2	#3	#4	#5	#6	#7
#8	(ft-msl)	(ft-msl)	(cfs)	(ft)	(ft)	(ft)	(ft)	(ft)	(ft)	(ft)
	(I) see note at bottom									
North East Shore										
S133 Pumps:	13.48	16.06	0	0	0	0	0	0	0	(cfs)
S193:										
S191:	18.87	16.05	0	0.0	0.0	0.0				
S135 Pumps:		-NR-	0	0	0	0	0			(cfs)
S135 Culverts:			0	-NR-	-NR-					
North West Shore										
S65E:	20.94	15.86	2522	0.8	0.7	1.2	1.7	1.6	1.0	
S127 Pumps:	13.47	-NR-	0	0	0	0	0	0	0	(cfs)
S127 Culvert:			-NR-	-NR-						
S129 Pumps:	13.02	16.12	0	0	0	0				(cfs)
S129 Culvert:			0	0.0						
S131 Pumps:	12.94	16.17	0	0	0					(cfs)
S131 Culvert:			-NR-							
Fisheating Creek										
nr Palmdale		32.19	548							
nr Lakeport										
C5:	15.97	16.01	-122	8.0	0.0	8.0				

South Shore

S4 Pumps:	11.55	16.13	0	0	0	0				(cfs)
S169:	15.25	11.53	0	0.0	0.0	0.0				
S310:	16.06		-NR-							
S3 Pumps:	9.37	16.16	0	0	0	0				(cfs)
S354:	16.16	9.37	0	0.0	0.0					
S2 Pumps:	9.55	16.10	0	0	0	0	0			(cfs)
S351:	16.10	9.55	0	0.0	0.0	0.0				
S352:	16.24	10.11	0	0.0	0.0					
C10A:	-NR-	14.05		0.0	0.0	1.0	0.0	0.0		
L8 Canal PT		13.82	54							

---

S351 and S352 Temporary Pumps/S354 Spillway

S351:	9.55	16.10	0	-NR-	-NR-	-NR-	-NR-	-NR-	-NR-
S352:	10.11	16.24	0	-NR-	-NR-	-NR-	-NR-		
S354:	9.37	16.16	0	-NR-	-NR-	-NR-	-NR-		

---

Caloosahatchee River (S77, S78, S79)

S47B:	13.03	11.08		0.5	0.5				
S47D:	11.02	11.02	24	5.0					
S77:									
Spillway and Sector Flow:									
15.43	11.32	6278	6.9	6.9	6.9	6.9			
Flow Due to Lockages+:		7							
S77 Below USGS Flow Gage		6278							
S78:									
Spillway and Sector Flow:									
10.50	3.32	6261	5.0	5.0	5.5	5.5			
Flow Due to Lockages+:		15							
S79:									
Spillway and Sector Flow:									
2.89	1.31	8719	3.0	3.0	3.0	4.0	5.0	5.0	4.0
4.0									
Flow Due to Lockages+:		10							
Percent of flow from S77		87%							
Chloride (ppm)		48							

St. Lucie Canal (S308, S80)

S308:									
Spillway and Sector Flow:									
16.05	15.75	3500	7.0	7.0	7.0	7.0			
Flow Due to Lockages+:		0							
S308 Below USGS Flow Gage		3500							
S153:	18.70	15.49	68	0.5	0.5				
S80:									
Spillway and Sector Flow:									
12.61	2.11	6233	2.0	2.3	2.3	3.0	2.3	2.0	3.0
Flow Due to Lockages+:		17							
Percent of flow from S308		78%							

Steele Point Top Salinity (mg/ml) 6032  
 Steele Point Bottom Salinity (mg/ml) \*\*\*\*

Speedy Point Top Salinity (mg/ml) 555  
 Speedy Point Bottom Salinity (mg/ml) 584

+ Flow Due to lockages is computed utilizing average daily headwater and tailwater along with total number of lockages for the day to calculate a volume which is then converted to an average discharge in cfs.

---

Daily Precipitation Totals Speed (mph)	1-Day (inches)	3-Day (inches)	7-Day (inches)	Direction (Degø)	Wind ---
S133 Pump Station:	-NR-	0.00	0.33		
S193:	-NR-	0.00	0.00	-NR-	-NR-
Okeechobee Field Station:	-NR-	0.00	0.00		
S135 Pump Station:	-NR-	0.00	0.94		
S127 Pump Station:	-NR-	0.00	0.18		
S129 Pump Station:	-NR-	0.00	0.67		
S131 Pump Station:	-NR-	0.00	0.95		
S77:	0.00	0.00	1.29	130	2
S78:	0.00	0.00	60.82	80	4
S79:	0.00	0.00	-46.31	172	1
S4 Pump Station:	-NR-	0.00	0.00		
Clewiston Field Station:	-NR-	0.00	0.00		
S3 Pump Station:	-NR-	0.00	0.89		
S2 Pump Station:	-NR-	0.00	0.83		
S308:	*****	*****	*****	57	0
S80:	0.00	0.00	0.93	152	1
Okeechobee Average (Sites S78, S79 and S80 not included)	*****	6133.38	*****		
-----					
Oke Nexrad Basin Avg	0.00	0.00	0.84		
-----					

---

Okeechobee Lake Elevations 21FEB16	21 FEB 2016	16.11 Difference from
21FEB16 -1 Day =	20 FEB 2016	16.14 0.03
21FEB16 -2 Days =	19 FEB 2016	16.16 0.05
21FEB16 -3 Days =	18 FEB 2016	16.20 0.09
21FEB16 -4 Days =	17 FEB 2016	16.25 0.14
21FEB16 -5 Days =	16 FEB 2016	16.24 0.13
21FEB16 -6 Days =	15 FEB 2016	16.19 0.08
21FEB16 -7 Days =	14 FEB 2016	16.21 0.10
21FEB16 -30 Days =	22 JAN 2016	15.21 -0.90
21FEB16 -1 Year =	21 FEB 2015	14.68 -1.43
21FEB16 -2 Year =	21 FEB 2014	13.99 -2.12

---

Long Term Mean 30day Avearge ET for Lake Alfred (Inches) = -NR-

---

Lake Okeechobee Net Inflow (LONIN)

Average Flow over the previous 14 days				Avg-Daily Flow
21FEB16	Today =	21 FEB 2016	7044 MON	5693
21FEB16	-1 Day =	20 FEB 2016	8534 SUN	-NR-
21FEB16	-2 Days =	19 FEB 2016	9071 SAT	2997
21FEB16	-3 Days =	18 FEB 2016	9900 FRI	316
21FEB16	-4 Days =	17 FEB 2016	10685 THU	13581
21FEB16	-5 Days =	16 FEB 2016	10684 WED	23320
21FEB16	-6 Days =	15 FEB 2016	9966 TUE	7798
21FEB16	-7 Days =	14 FEB 2016	10663 MON	6428
21FEB16	-8 Days =	13 FEB 2016	11512 SUN	8248
21FEB16	-9 Days =	12 FEB 2016	12680 SAT	6274
21FEB16	-10 Days =	11 FEB 2016	15020 FRI	6057
21FEB16	-11 Days =	10 FEB 2016	18613 THU	843
21FEB16	-12 Days =	09 FEB 2016	21651 WED	7359
21FEB16	-13 Days =	08 FEB 2016	21436 TUE	2655

---



---

S65E

Average Flow over previous 14 days				Avg-Daily Flow
21FEB16	Today=	21 FEB 2016	3887 MON	2522
21FEB16	-1 Day =	20 FEB 2016	4081 SUN	2509
21FEB16	-2 Days =	19 FEB 2016	4224 SAT	2635
21FEB16	-3 Days =	18 FEB 2016	4317 FRI	3052
21FEB16	-4 Days =	17 FEB 2016	4366 THU	3308
21FEB16	-5 Days =	16 FEB 2016	4400 WED	3676
21FEB16	-6 Days =	15 FEB 2016	4409 TUE	3742
21FEB16	-7 Days =	14 FEB 2016	4436 MON	3907
21FEB16	-8 Days =	13 FEB 2016	4478 SUN	4134
21FEB16	-9 Days =	12 FEB 2016	4550 SAT	4506
21FEB16	-10 Days =	11 FEB 2016	4584 FRI	4773
21FEB16	-11 Days =	10 FEB 2016	4547 THU	4822
21FEB16	-12 Days =	09 FEB 2016	4445 WED	5542
21FEB16	-13 Days =	08 FEB 2016	4217 TUE	5294

---

Lake Okeechobee Outlets Last 14 Days

DATE	S-77	S-77	Below S-77	S-78	S-78	S-79
	Discharge (0700-2100) (AC-FT)	Discharge (ALL DAY) (AC-FT)	Discharge (ALL-DAY) (AC-FT)	Discharge (0700-2100) (AC-FT)	Discharge (ALL DAY) (AC-FT)	Discharge (ALL DAY) (AC-FT)
21 FEB 2016			12450	-NR-	12444	17309
20 FEB 2016			12608	-NR-	12494	17975
19 FEB 2016			12810	-NR-	12839	17461
18 FEB 2016			12624	-NR-	13018	18265
17 FEB 2016			12584	-NR-	13065	19088
16 FEB 2016			12406	-NR-	12405	18716
15 FEB 2016			12228	-NR-	11376	15578
14 FEB 2016			11842	-NR-	11618	15798
13 FEB 2016			11889	-NR-	11620	15310
12 FEB 2016			11456	-NR-	13021	16290

11 FEB 2016		11603	-NR-	12593	16641
10 FEB 2016		10979	-NR-	12111	16084
09 FEB 2016		11039	-NR-	13724	18951
08 FEB 2016		11006	-NR-	13870	18388

	S-310	S-351	S-352	S-354	L8 Canal Pt
	Discharge	Discharge	Discharge	Discharge	Discharge
	(ALL DAY)	(ALL DAY)	(ALL DAY)	(ALL DAY)	(ALL DAY)
DATE	(AC-FT)	(AC-FT)	(AC-FT)	(AC-FT)	(AC-FT)
21 FEB 2016	-NR-	0	0	0	108
20 FEB 2016	-NR-	-NR-	0	0	108
19 FEB 2016	3	0	0	0	103
18 FEB 2016	3	0	0	0	97
17 FEB 2016	8	0	0	0	28
16 FEB 2016	-3	0	0	0	23
15 FEB 2016	0	0	0	0	85
14 FEB 2016	27	0	0	0	27
13 FEB 2016	121	0	0	0	-15
12 FEB 2016	2	0	0	0	-5
11 FEB 2016	5	0	0	0	5
10 FEB 2016	13	0	0	0	3
09 FEB 2016	23	0	0	0	-25
08 FEB 2016	10	0	0	0	2

	S-308	Below S-308	S-80
	Discharge	Discharge	Discharge
	(ALL DAY)	(ALL-DAY)	(ALL-DAY)
DATE	(AC-FT)	(AC-FT)	(AC-FT)
21 FEB 2016		6940	12394
20 FEB 2016		7077	12639
19 FEB 2016		7328	13139
18 FEB 2016		7292	13424
17 FEB 2016		7450	13644
16 FEB 2016		6249	12486
15 FEB 2016		6790	10712
14 FEB 2016		7266	12092
13 FEB 2016		7517	12502
12 FEB 2016		7141	12503
11 FEB 2016		7696	12570
10 FEB 2016		7559	12649
09 FEB 2016		6964	10167
08 FEB 2016		7106	10901

\*\*\* NOTE: 1) Discharge from (0700-2100) is computed using Spillway and Sector Gate Discharges from 0700 hrs to 2100 hrs.

2) Discharge (ALL DAY) is computed using Spillway, Sector Gate and Lockages Discharges from 0015 hrs to 2400 hrs.

---

(I) - Flows preceded by "I" signify an instantaneous flow computed from the single value reported for the day

---

\* On 11 May 1999, Lake Okeechobee Elevation was switched from

Instantaneous 2400 value to an average-daily lake average.

On 14 Mar 2001, due to the isolation of various gages within the standard

10 stations, the average of the interior 4 station gages was used as the Lake Okeechobee Elevation.

On 05 November 2010, Lake Okeechobee Elevation was switched to a 9 gage mix of interior and edge gages to obtain a more reliable representation of the lake level.

On 09 May 2011, Lake Okeechobee Elevation was switched to a 8 gage mix of interior and edge gages to obtain a more reliable representation of the lake level due to isolation of S135 from low lake levels.

Today Lake Okechobee elevation is determined from the 4 Int & 4 Edge stations

++ For more information see the Jacksonville District Navigation website at <http://www.saj.usace.army.mil/>


\$ For information regarding Lake Okeechobee Service Area water restrictions please refer to [www.sfwmd.gov](http://www.sfwmd.gov)

---

—  
Report Generated 22FEB2016 @ 10:15 \*\* Preliminary Data - Subject to Revision  
\*\*

# Lake Okeechobee

22FEB16 10:30:31

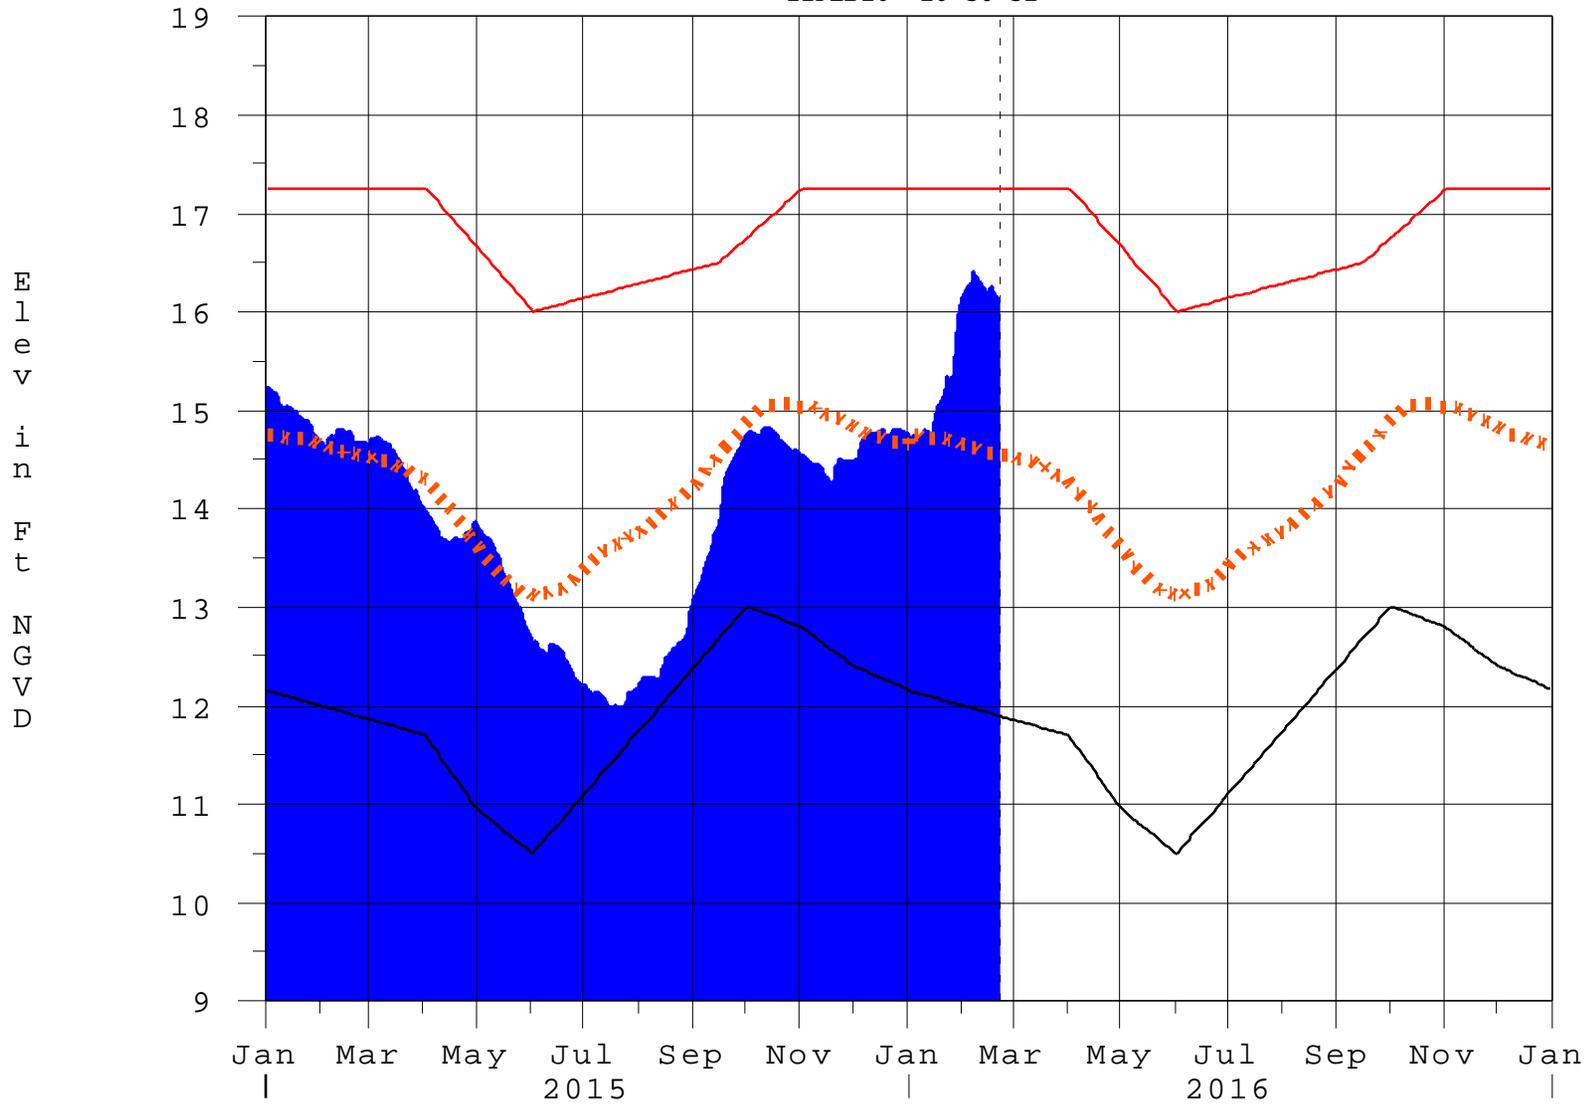

- High Lake Management
- Okeechobee Avg Elev
- Average Elev [1965-2007]
- Water Shortage Management

# Classification Tables

---

Supplemental Tables used in conjunction with the LORS2008 Release

Guidance Flow Charts

- [Class Limits for Tributary Hydrologic Conditions](#)

Table K-2 in the Lake Okeechobee Water Control Plan

- [6-15 Day Precipitation Outlook Categories](#)

Table ?? in the Lake Okeechobee Water Control Plan

- [Classification of Lake Okeechobee Net Inflow for Seasonal Outlook](#)

Table K-3 in the Lake Okeechobee Water Control Plan

- [Classification of Lake Okeechobee Net Inflow for Multi-Seasonal Outlook](#)

Table K-4 in the Lake Okeechobee Water Control Plan

---

[Back to Lake Okeechobee Operations Main Page](#)

[Back to U.S. Army Corps of Engineers Lake Okeechobee Operations Homepage](#)

Tributary Hydrologic Classification*	Palmer Index Class Limits	2-wk Mean L.O. Net Inflow Class Limits
Very Wet	3.0 or greater	Greater $\geq$ 6000 cfs
Wet	1.5 to 2.99	2500 - 5999 cfs
Near Normal	-1.49 to 1.49	500 - 2499 cfs
Dry	-2.99 to -1.5	-5000 – 500 cfs
Very Dry	-3.0 or less	Less than -5000 cfs

\* use the wettest of the two indicators

**Classification of Lake Okeechobee Net Inflow Seasonal Outlook\***

<b>Lake Net Inflow Prediction</b> <b>[million acre-feet]</b>	<b>Equivalent Depth**</b> <b>[feet]</b>	<b>Lake Okeechobee Net Inflow Seasonal Outlook</b>
> 0.93	> 2.0	Very Wet
0.71 to 0.93	1.51 to 2.0	Wet
0.35 to 0.70	0.75 to 1.5	Normal
< 0.35	< 0.75	Dry

**\*\*Volume-depth conversion based on average lake surface area of 467,000 acres**

## Classification of Lake Okeechobee Net Inflow Multi-Seasonal Outlook\*

<b>Lake Net Inflow Prediction</b> <b>[million acre-feet]</b>	<b>Equivalent Depth**</b> <b>[feet]</b>	<b>Lake Okeechobee Net Inflow Multi-Seasonal Outlook</b>
> 2.0	> 4.3	Very Wet
1.18 to 2.0	2.51 to 4.3	Wet
0.5 to 1.17	1.1 to 2.5	Normal
< 0.5	< 1.1	Dry

**\*\*Volume-depth conversion based on average lake surface area of 467,000 acres**

**6-15 Day Precipitation Outlook Categories\***

<b>6-15 Day Precipitation Outlook Categories</b>	<b>WSE Decision Tree Categories</b>
Above Normal	Wet to Very Wet
Normal	Normal
Below Normal	Dry

\* Corresponds to Table 7-6 in the Lake Okeechobee Water Control Plan

Under Construction