

Application of the Lake Okeechobee Regulation Schedule (LORS2008) on 5/30/2016 (ENSO Neutral Condition)

Lake Okeechobee Net Inflow Outlook:

The Lake Okeechobee Net Inflow Outlook has been computed using 4 methods: Croley's method¹, the SFWMD empirical method², a sub-sampling of Neutral years³ and a sub-sampling of warm years of the Atlantic Multi-decadal Oscillation (AMO) in combination with Neutral ENSO years⁴. The results for Croley's method and the SFWMD empirical method are based on the [CPC Outlook](#).

Table of the Lake Okeechobee Net Inflow Outlooks in feet of equivalent depth. All methods are updated on a weekly basis with observed net inflow for the current month.

Season	Croley's Method ^{1*}		SFWMD Empirical Method ²		Sub-sampling of Neutral ENSO Years ³		Sub-sampling of AMO Warm + Neutral ENSO Years ⁴	
	Value (ft)	Condition	Value (ft)	Condition	Value (ft)	Condition	Value (ft)	Condition
Current (May-Oct)	N/A	N/A	2.53	Very Wet	2.91	Very Wet	3.54	Very Wet
Multi Seasonal (May-Apr)	N/A	N/A	3.38	Wet	4.12	Wet	5.13	Very Wet

*Croley's Method Not Produced For This Report

See [Seasonal](#) and [Multi-Seasonal](#) tables for the classification of Lake Okeechobee Outlooks.

The recommended methods and values for estimating the Lake Okeechobee Net Inflow Outlook are shaded and should be used in the LORS2008 Release Guidance Flow Charts.

[Tributary Hydrologic Conditions Graph:](#)

13394 cfs 14-day running average for Lake Okeechobee Net Inflow through 5/29/2016. According to the classification in [Tributary Hydrologic Conditions](#) table, this condition is Very Wet.

1.74 for Palmer Index on 5/28/2016.

According to the classification in [Tributary Hydrologic Conditions](#) table, this condition is Wet.

The wetter of the two conditions above is **Very Wet**.

[LORS2008 Classification Tables:](#)

Lake Okeechobee Stage on 5/30/2016

Lake Okeechobee Stage: **14.40 feet**

[USACE Report for Lake Okeechobee](#)

[Lake Okeechobee Stage Hydrograph](#)

Lake Okeechobee Management Zone/Band		Bottom Elevation (feet, NGVD)	Current Lake Stage
High Lake Management Band		16.04	
Operational Band	High sub-band	15.53	
	Intermediate sub-band	15.02	
	Low sub-band	13.02	← 14.40
Base Flow sub-band		12.60	
Beneficial Use sub-band		10.52	
Water Shortage Management Band			

[Part C of LORS2008: Discharge to WCA's](#)

Release Guidance Flow Chart Outcome: Up to Maximum Releases to the WCAs if Desirable or with Minimum Everglades Impacts

[Part D of LORS2008: Discharge to Tidewater](#)

Release Guidance Flow Chart Outcome: S-77 up to 4000 cfs and S-80 up to 1800 cfs

Technical Input Summaries from:

- [Lake Okeechobee Division](#)
- [Coastal Ecosystems](#)
- [Everglades Ecosystems Division](#)
- [Water Supply Department](#)
- [Water Resource Management Release Recommendation](#)
- [Kissimmee Watershed Environmental Conditions](#)
- [Operations Department](#)

[Back to Lake Okeechobee Operations Main Page](#)

[Back to U.S. Army Corps of Engineers LORSS Homepage](#)

LORS2008 Implementation on 5/30/2016 (ENSO Neutral Condition):

Water Supply Department Technical Input

Water Supply Outlook:

District wide, Raindar rainfall 0.84 inches for the week ending 5/31/2016. Lake stage on 5/30/2016 is 14.40 ft, up 0.11 ft from last week.

The updated May 2016 SFWMM Dynamic Position Analysis [percentile graph](#) and [tracking chart](#) for Lake Okeechobee show that the lake stage is in the Low Operational Sub-Band.

The LORS2008 tributary [indices](#) are classified as **Very Wet**. The PDSI indicates wet condition and the LONIN is Very Wet. The classification is based on the wetter of the two.

Water Supply Risk Evaluation


Area	Indicator	Value	Color Coded Scoring Scheme
LOK	Projected LOK Stage for the next two months	Low Sub-Band	L
	Palmer Index for LOK Tributary Conditions	1.74 (Normal)	L
	CPC Precipitation Outlook	1 month: Normal	L
		3 months: Normal	L
	LOK Seasonal Net Inflow Forecast El Nino	2.91 ft (Normal to Extremely Wet)	L
	LOK Multi-Seasonal Net Inflow Forecast El Nino	4.12 ft (Wet)	L
WCAs	WCA 1: Site 1-7, Site 1-8T, & Site 1-9 Average	Above Line 1 (16.07 ft)	L
	WCA 2A: Site 2-17 HW	Above Line1 (12.07 ft)	L
	WCA-3A: 3 Station Average (Site 63, 64 and 65)	Above Line 1 (9.59 ft)	L
LEC	Service Area 1	Year-Round Irrigation Rule in effect	L
	Service Area 2	Year-Round Irrigation Rule in effect	L
	Service Area 3	Year-Round Irrigation Rule in effect	L

Note: The water supply risk classification based on the Palmer index, as well as the LOK seasonal and multi-seasonal net inflow forecasts use slightly different classification intervals than those used by the 2008-LORS.

[Back to Lake Okeechobee Operations Main Page](#)

[Back to U.S. Army Corps of Engineers LORSS Homepage](#)


Lake Okeechobee SFWMM May 2016 Dynamic Position Analysis

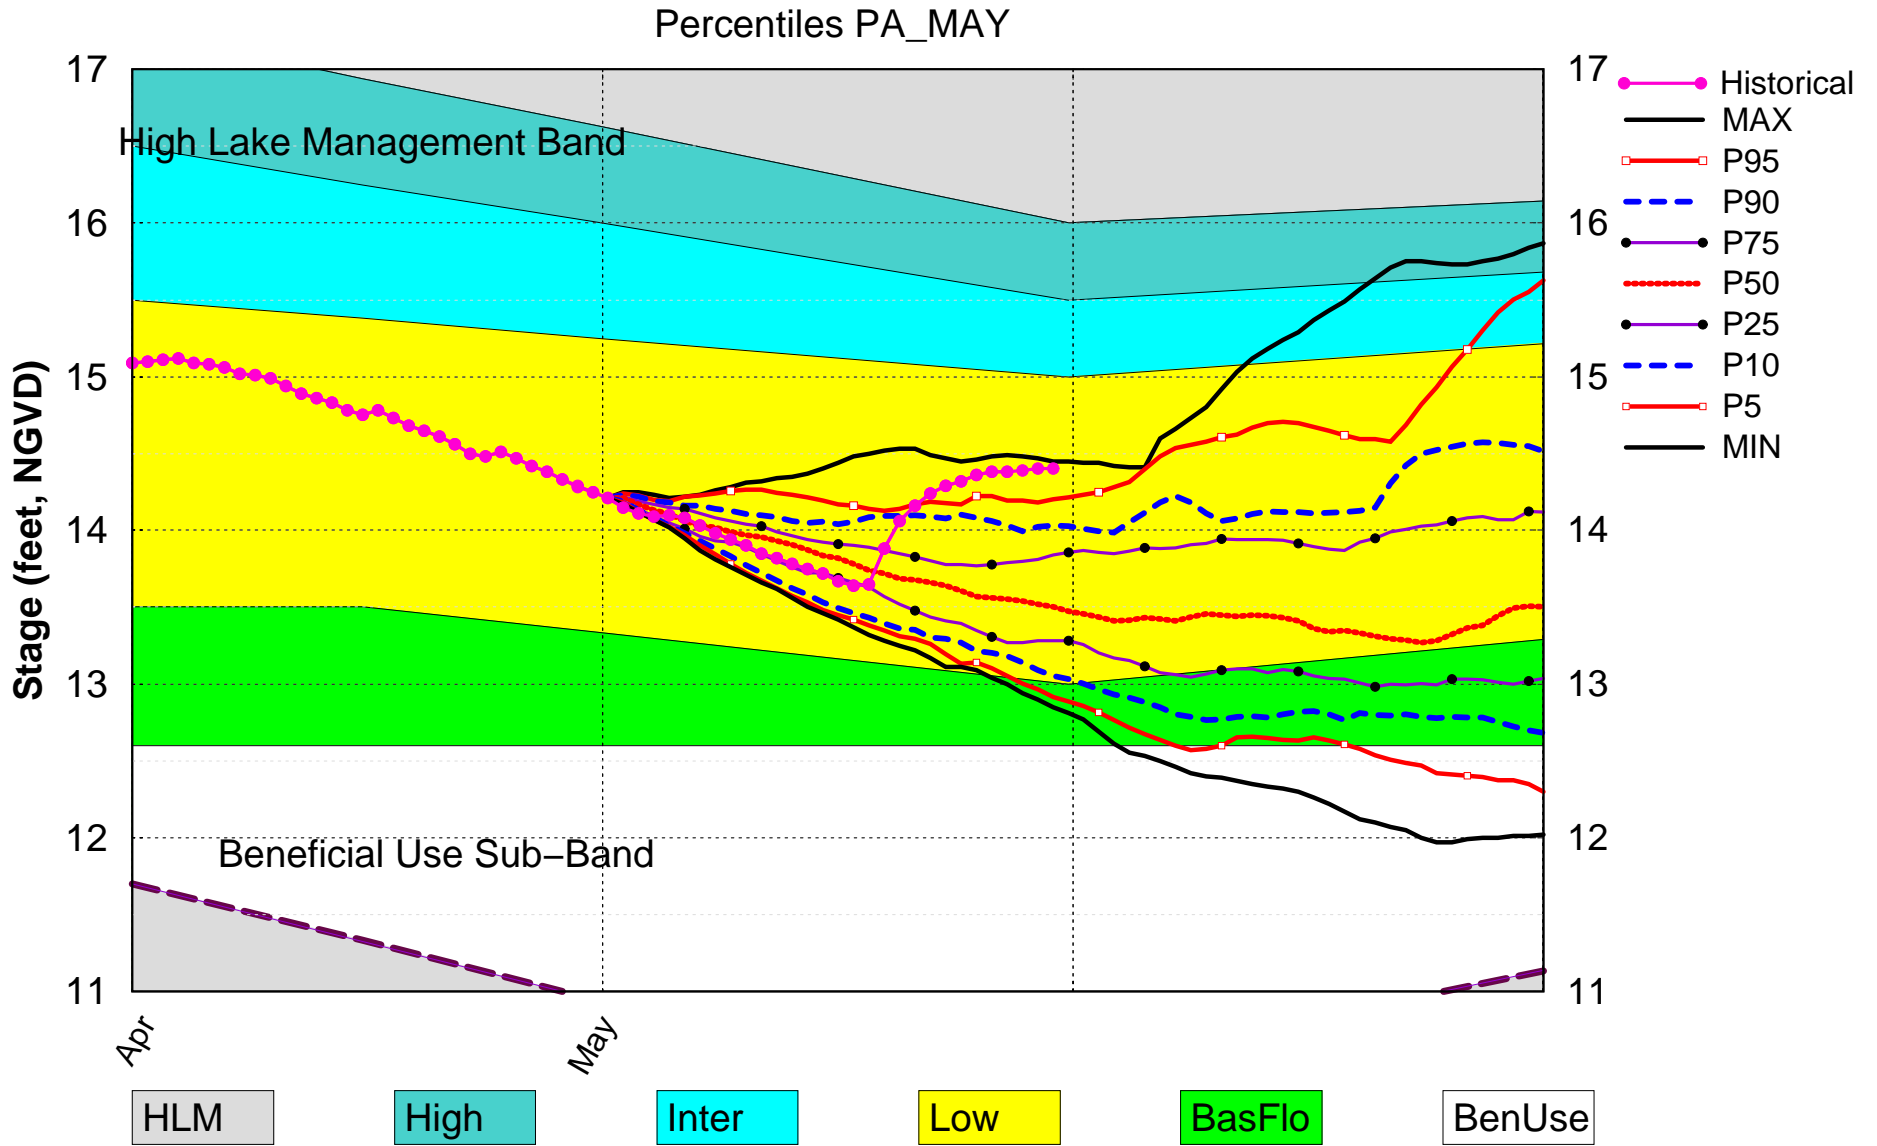


(See assumptions on the Position Analysis Results website)

Tributary Basin Condition Indicators as of May 30 2016

Palmer Index

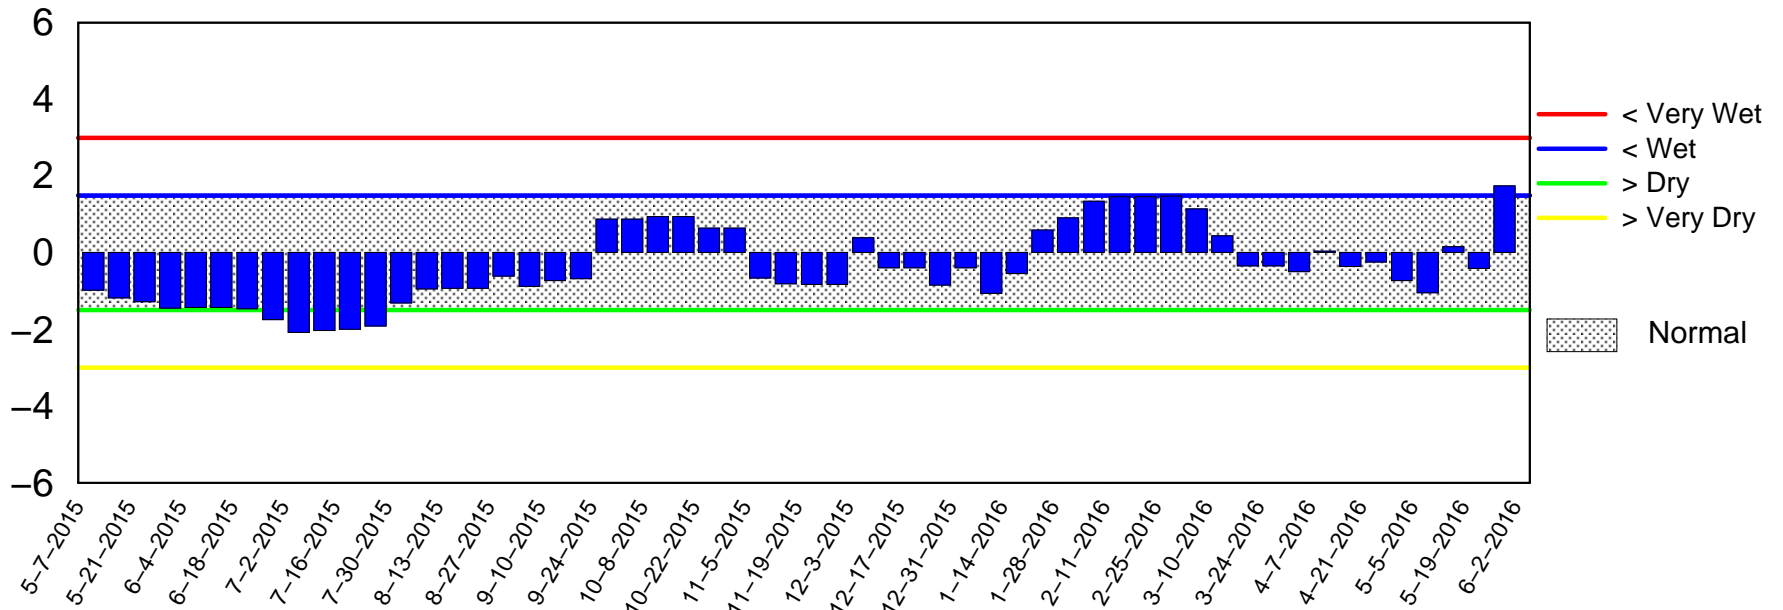

Lake Okeechobee Net Inflow (LONIN) 14-day Running Average

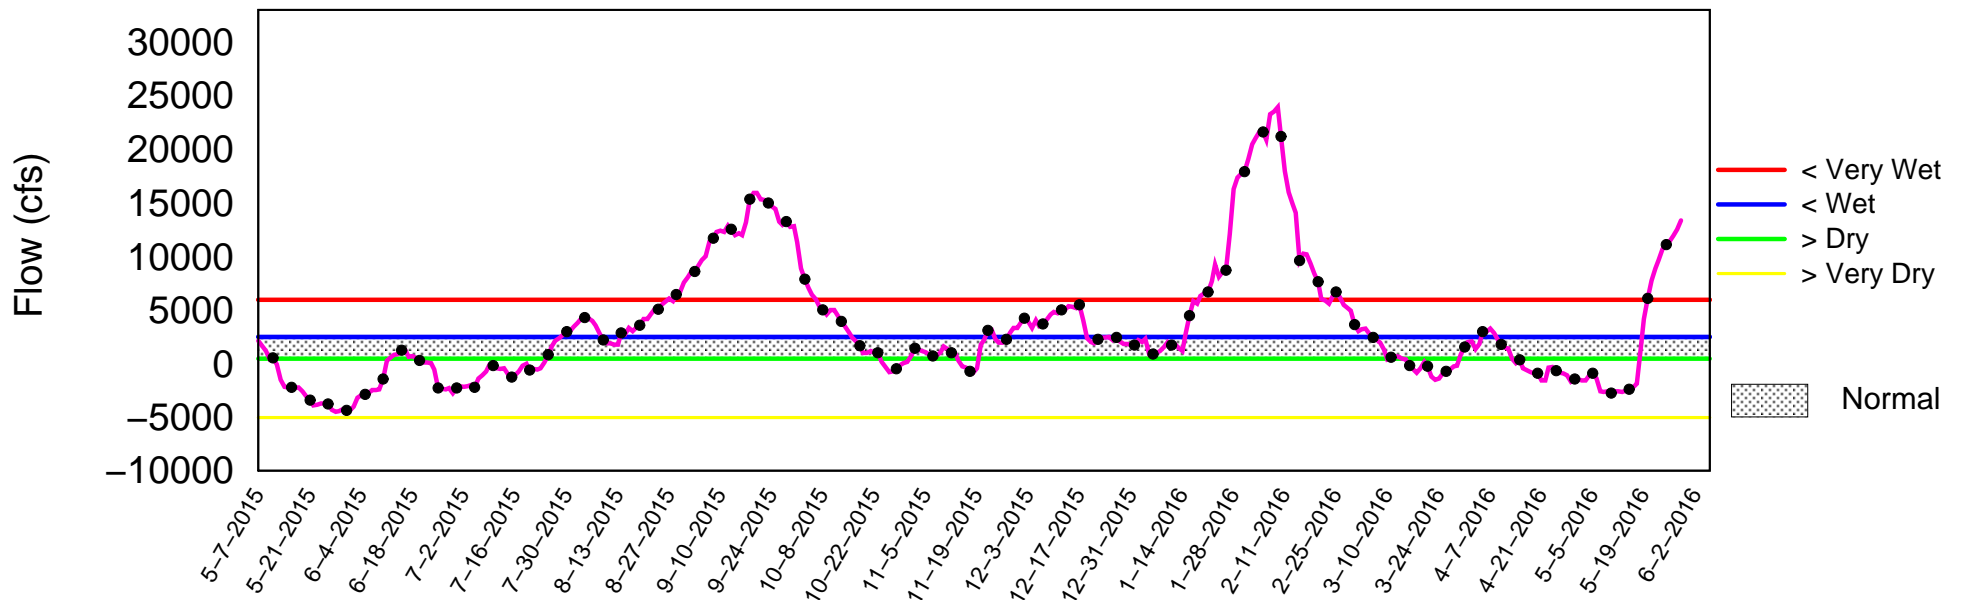

Tue May 31 07:50:33 EDT 2016

2008 LORS

Part C: Establish Allowable Lake Okeechobee Releases to the Water Conservation Areas

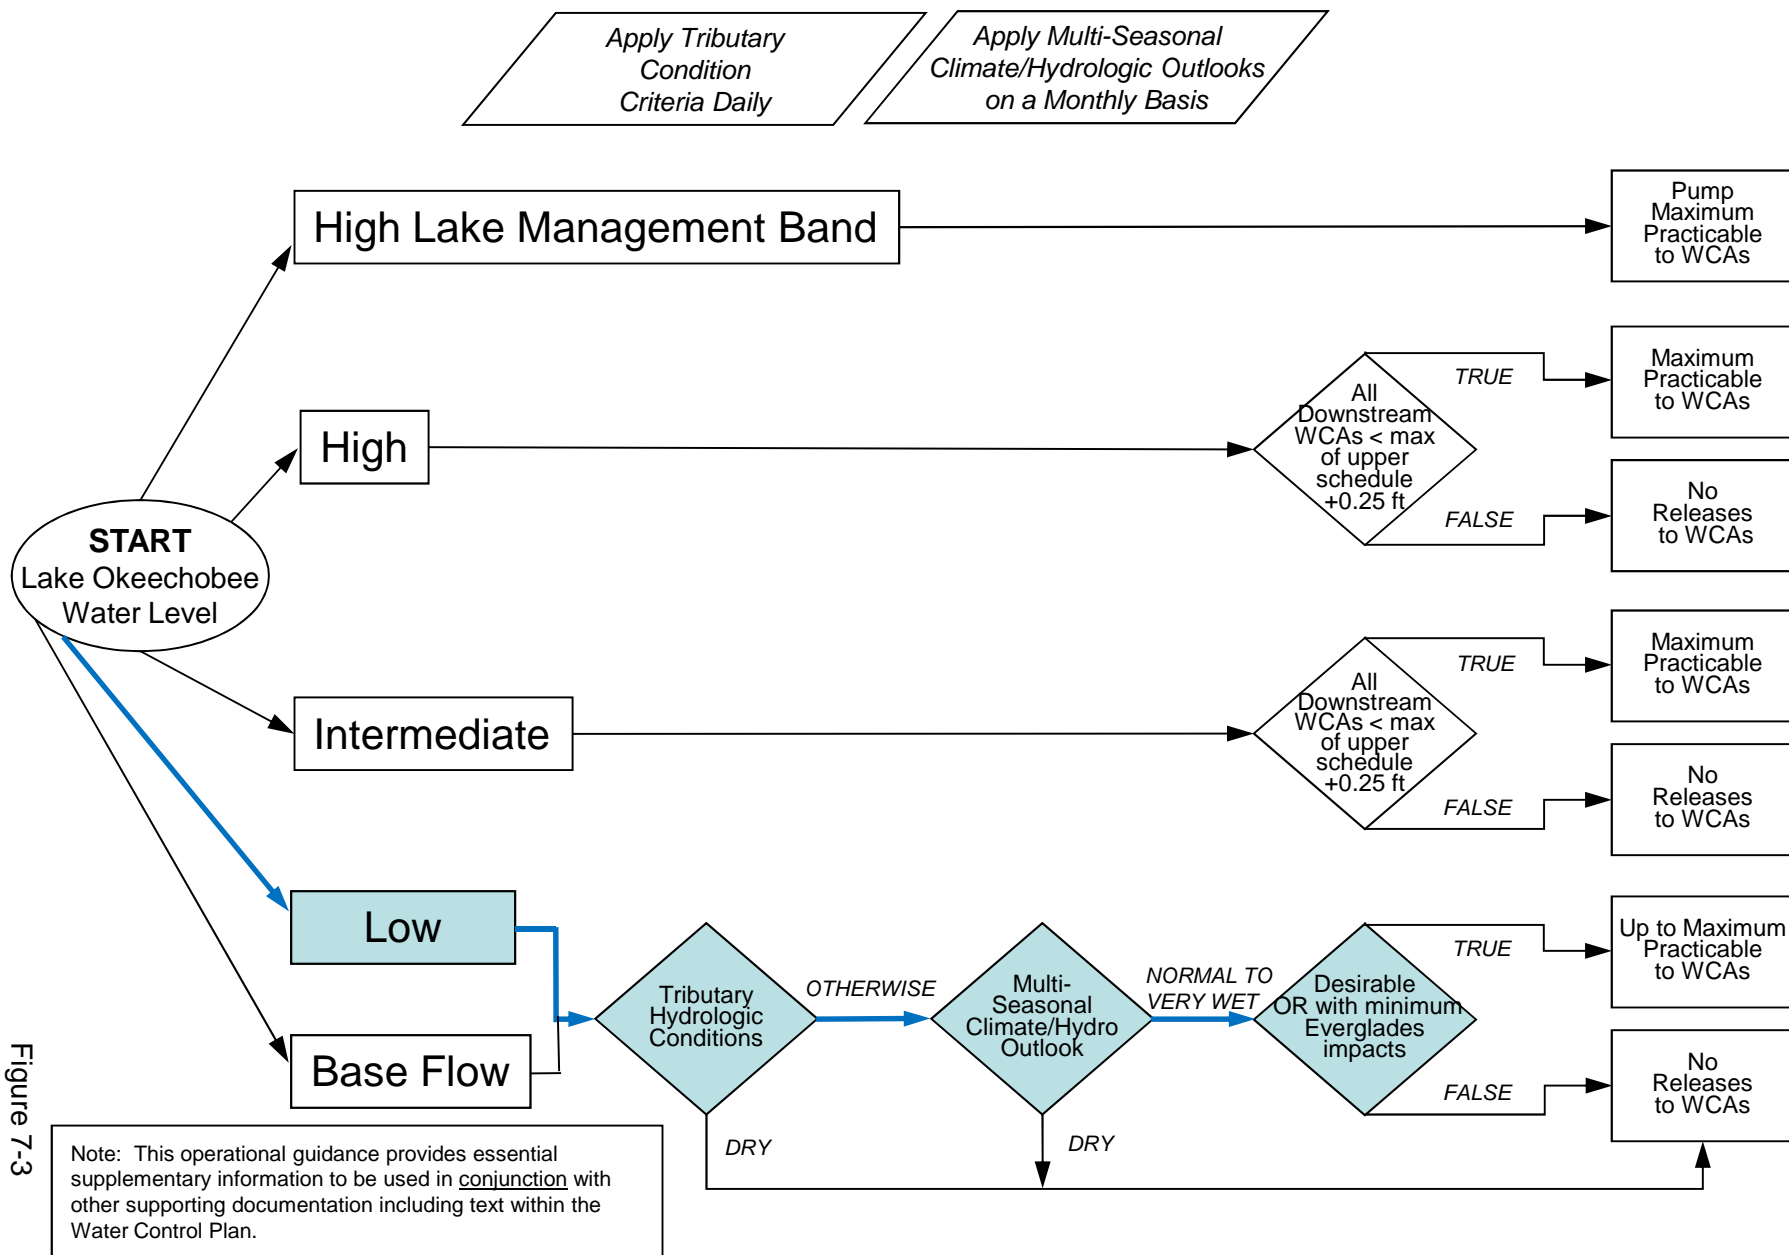


Figure 7-3


2008 LORS

Part D: Establish Allowable Lake Okeechobee Releases to Tide (Estuaries)

Note: This operational guidance provides essential supplementary information to be used in conjunction with other supporting documentation including text within the Water Control Plan.

When conducting Base Flow releases, flows can be distributed East and West up to 650 cfs as needed to minimize impacts or provide benefits through S-80 and S-79

Apply Meteorological Forecasts on a Weekly Basis; apply Seasonal and Multi-Seasonal Climate/Hydrologic Outlooks on a Monthly Basis

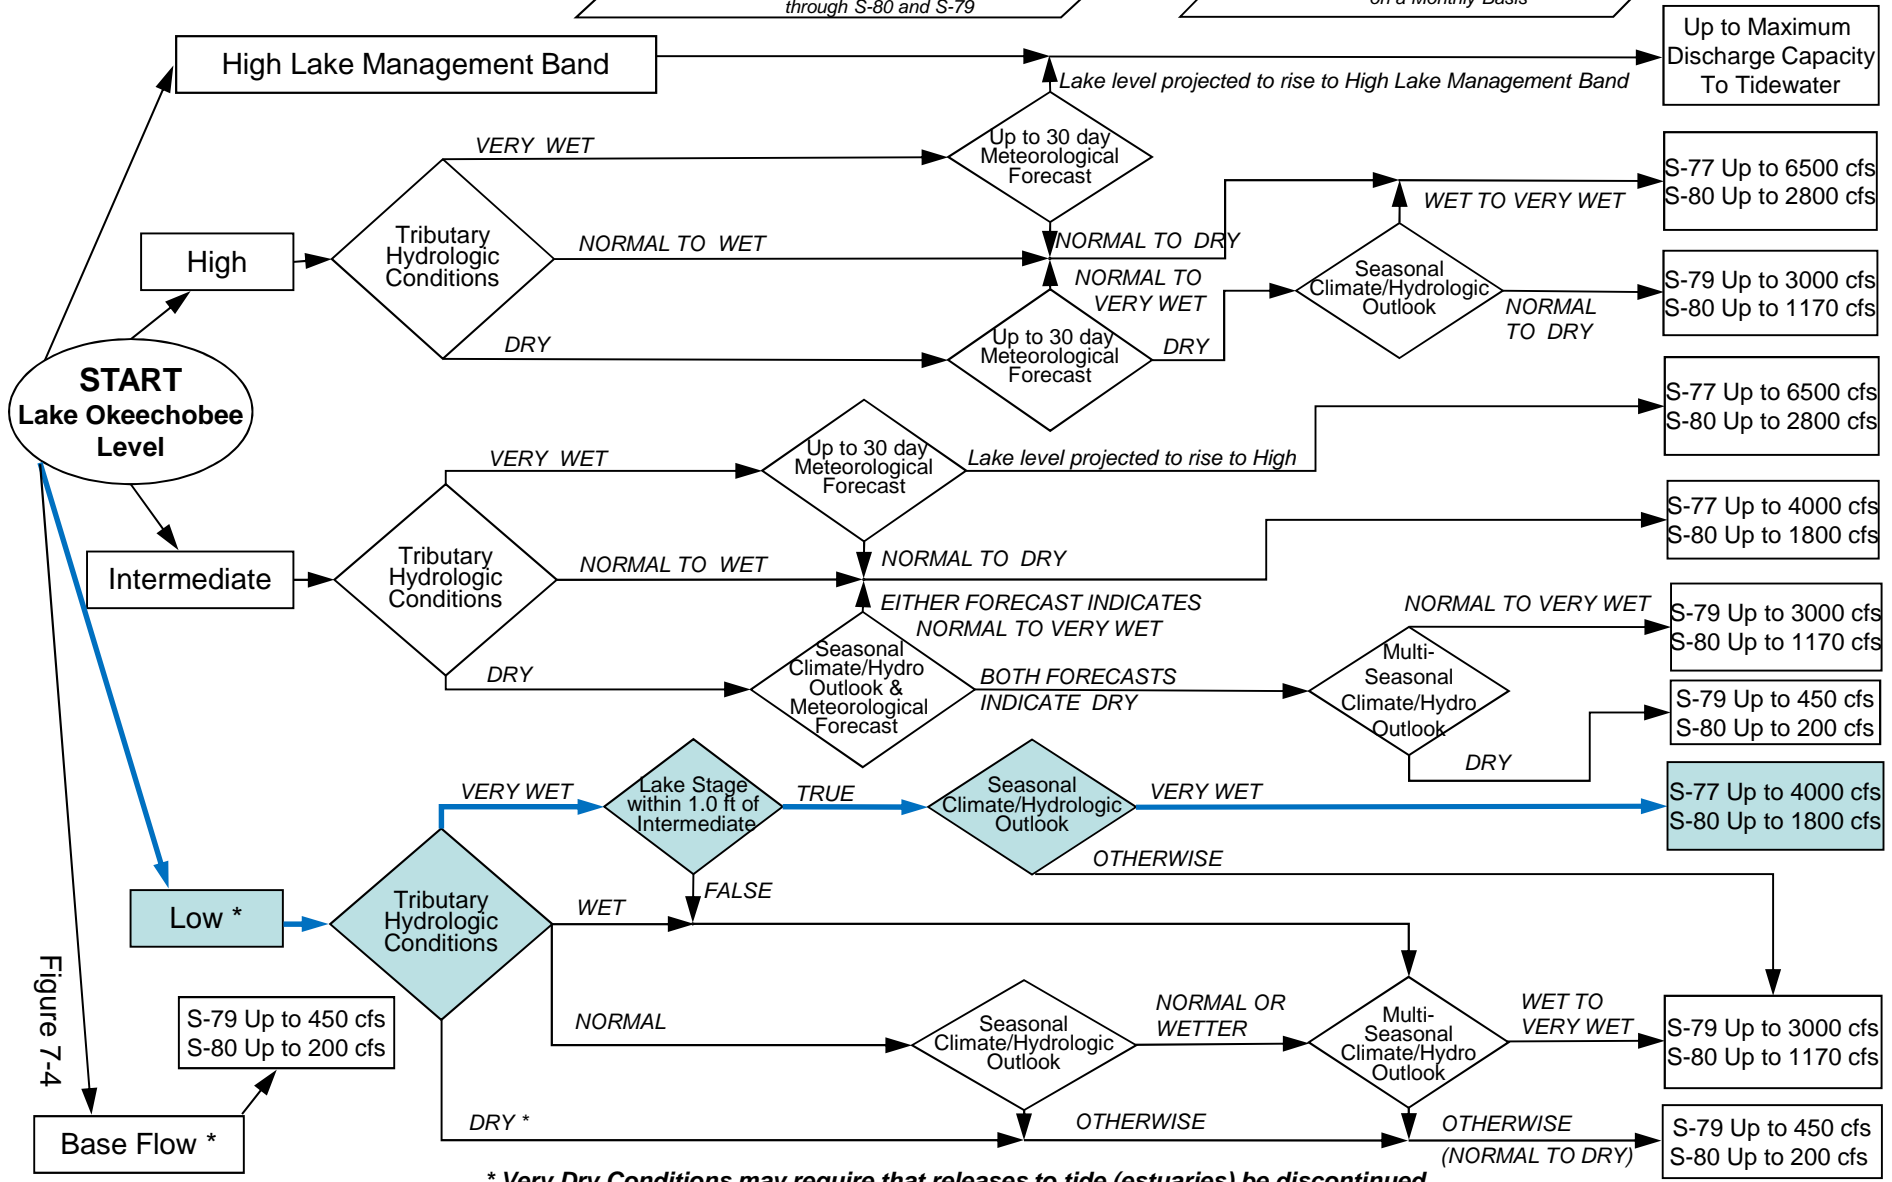

* Very Dry Conditions may require that releases to tide (estuaries) be discontinued

Figure 7-4

2008 LORS FORECAST

Part C: Establish Allowable Lake Okeechobee Releases to the Water Conservation Areas

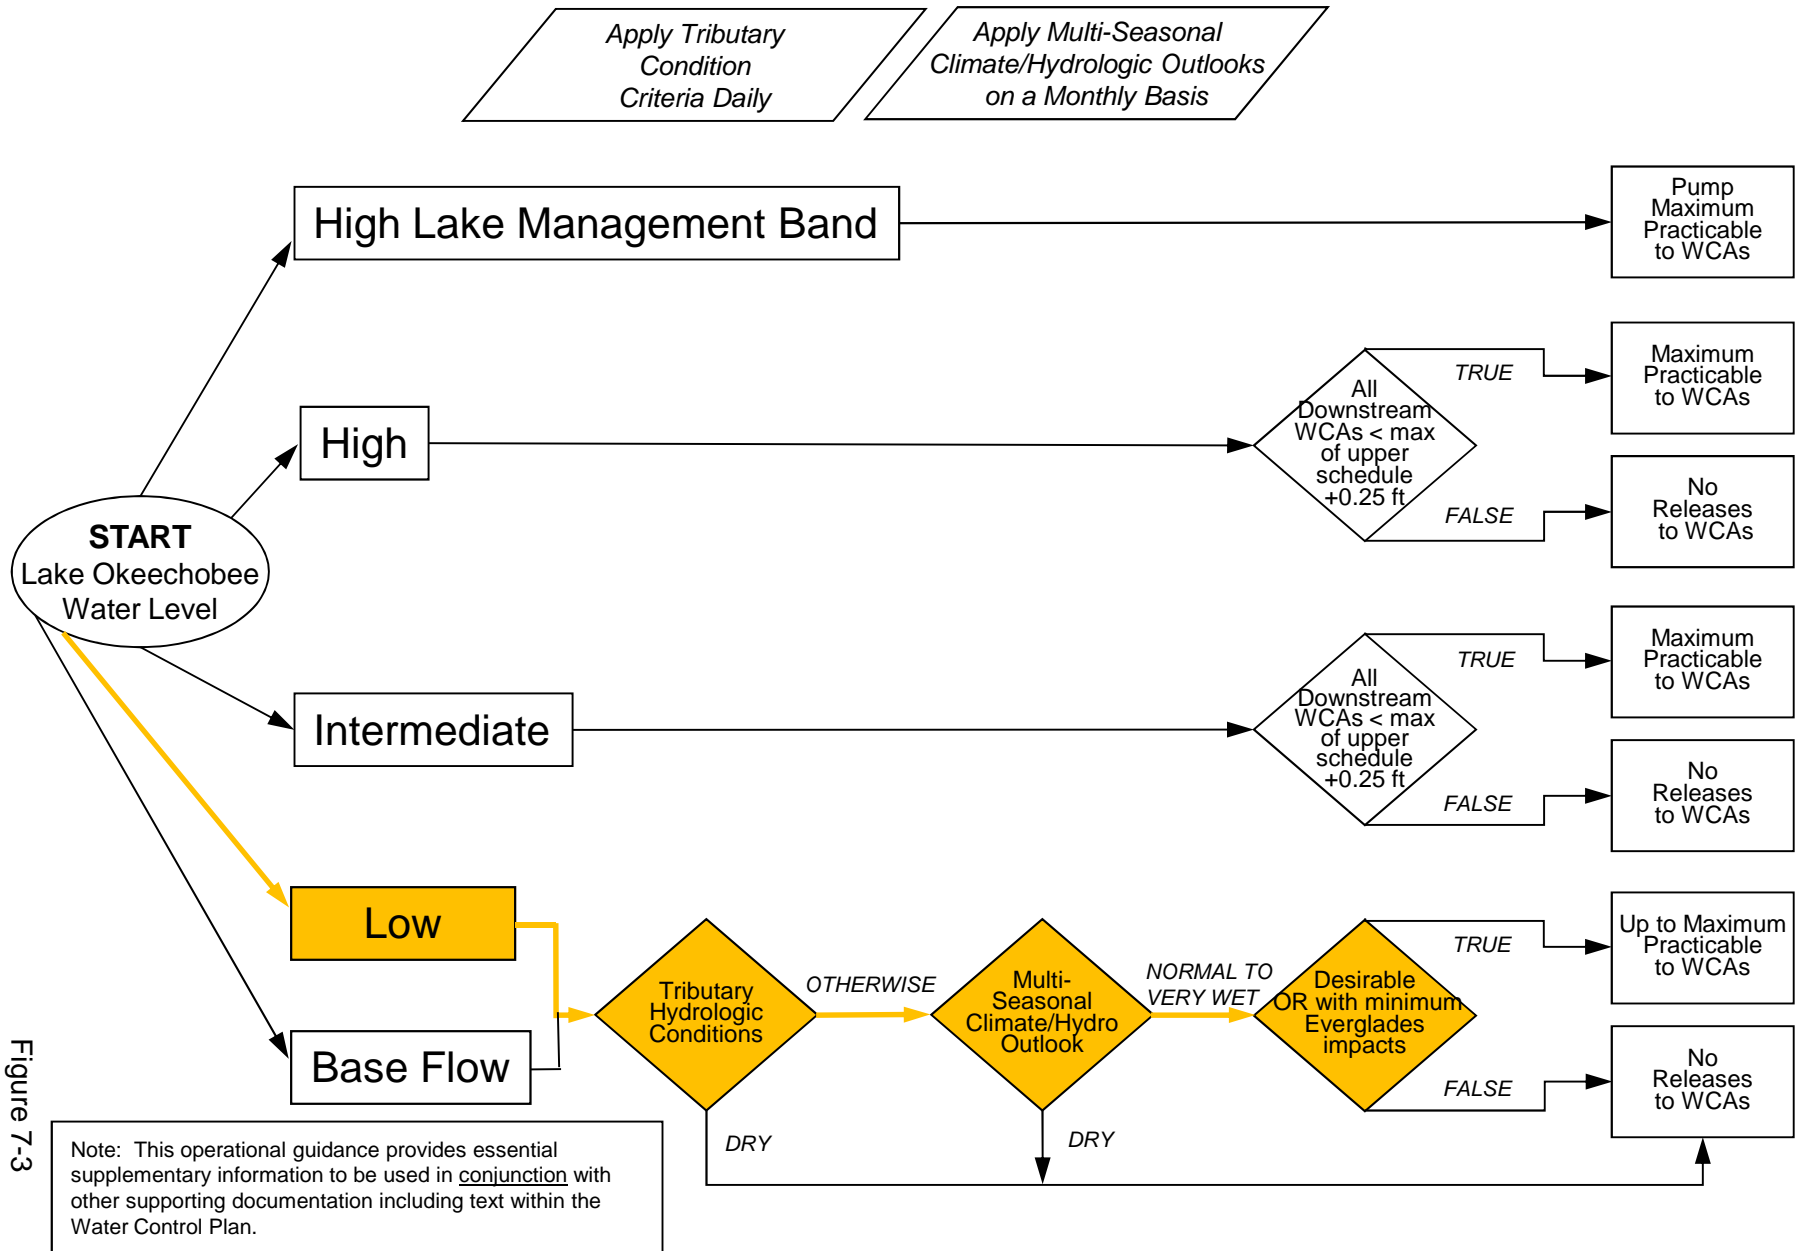


Figure 7-3


2008 LORS FORECAST

Part D: Establish Allowable Lake Okeechobee Releases to Tide (Estuaries)

Note: This operational guidance provides essential supplementary information to be used in conjunction with other supporting documentation including text within the Water Control Plan.

When conducting Base Flow releases, flows can be distributed East and West up to 650 cfs as needed to minimize impacts or provide benefits through S-80 and S-79

Apply Meteorological Forecasts on a Weekly Basis; apply Seasonal and Multi-Seasonal Climate/Hydrologic Outlooks on a Monthly Basis

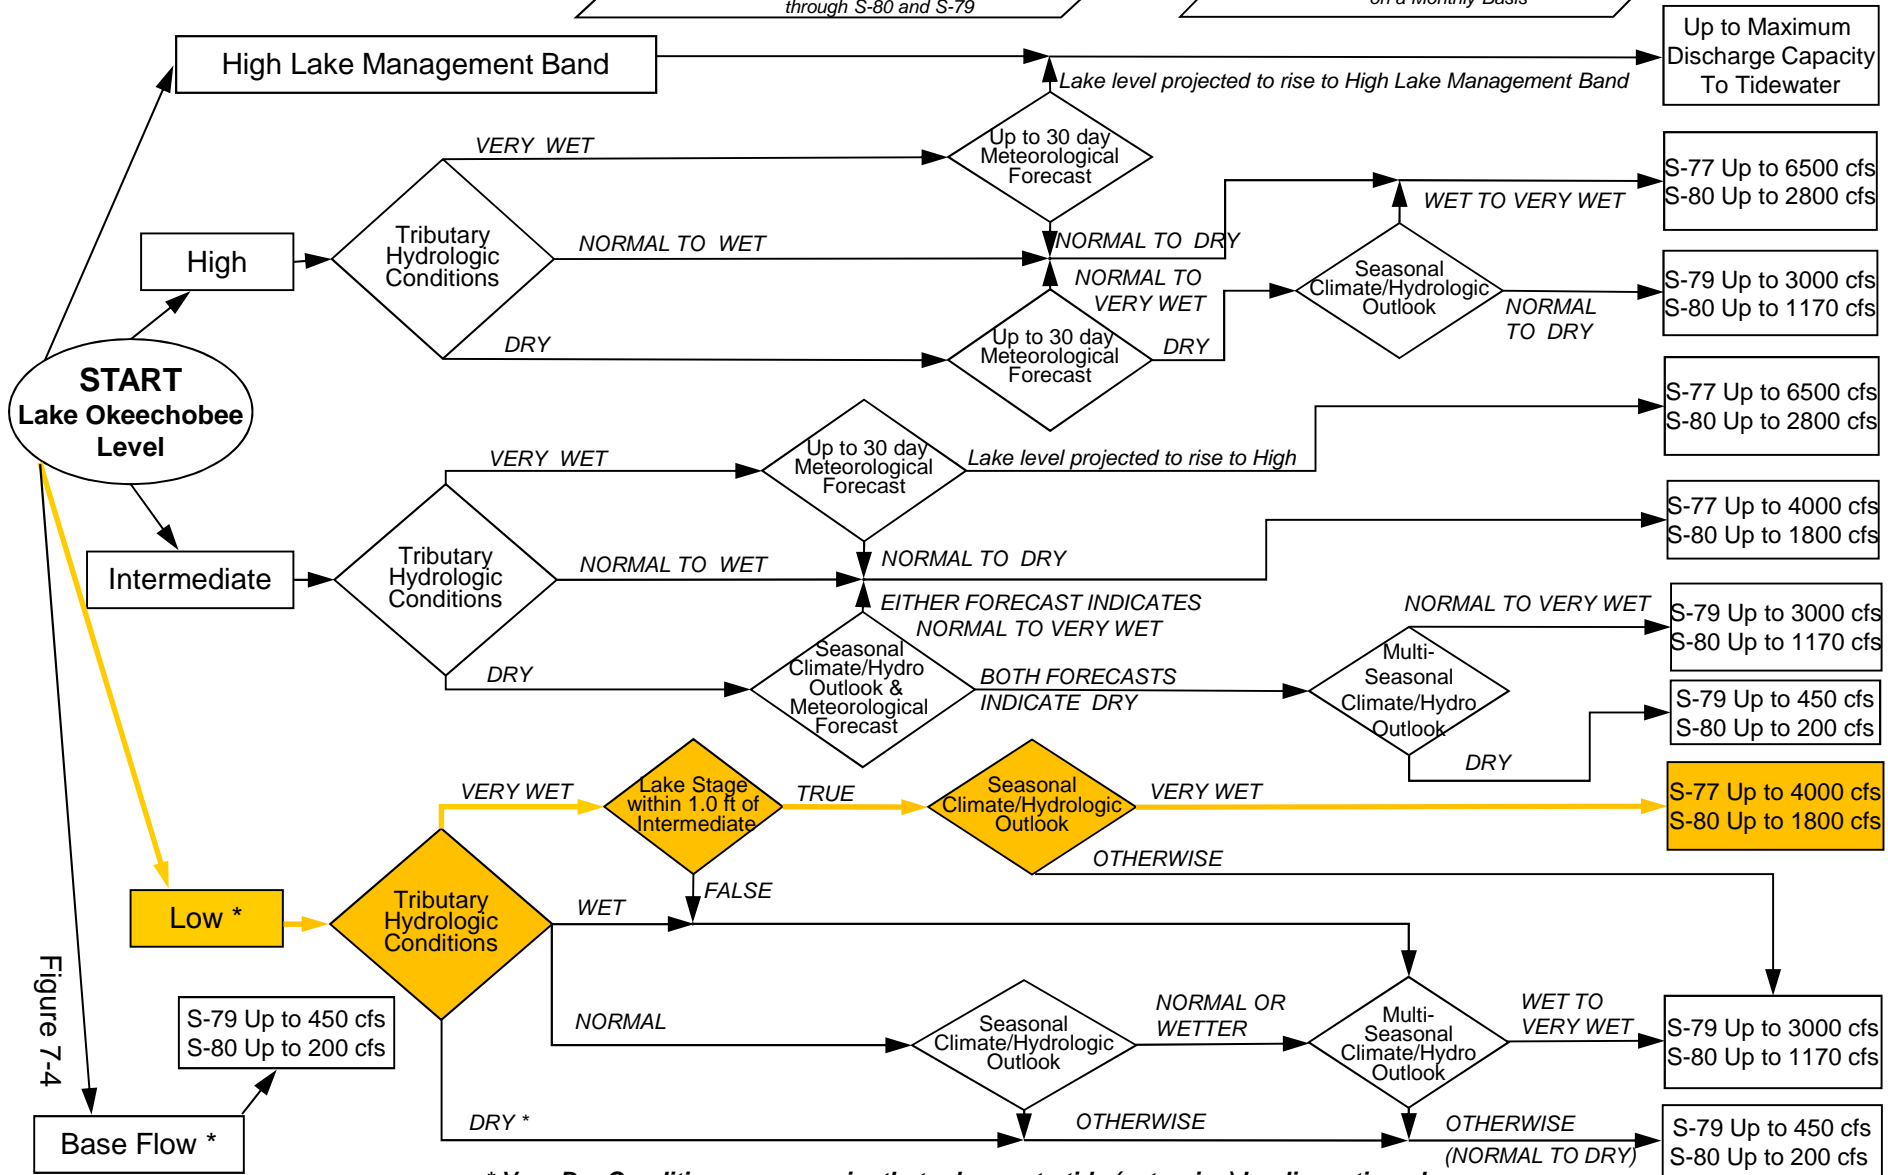


* Very Dry Conditions may require that releases to tide (estuaries) be discontinued

Figure 7-4

Lake Okeechobee Water Level History and Projected Stages

14.40 ft, NGVD
31-May-2016

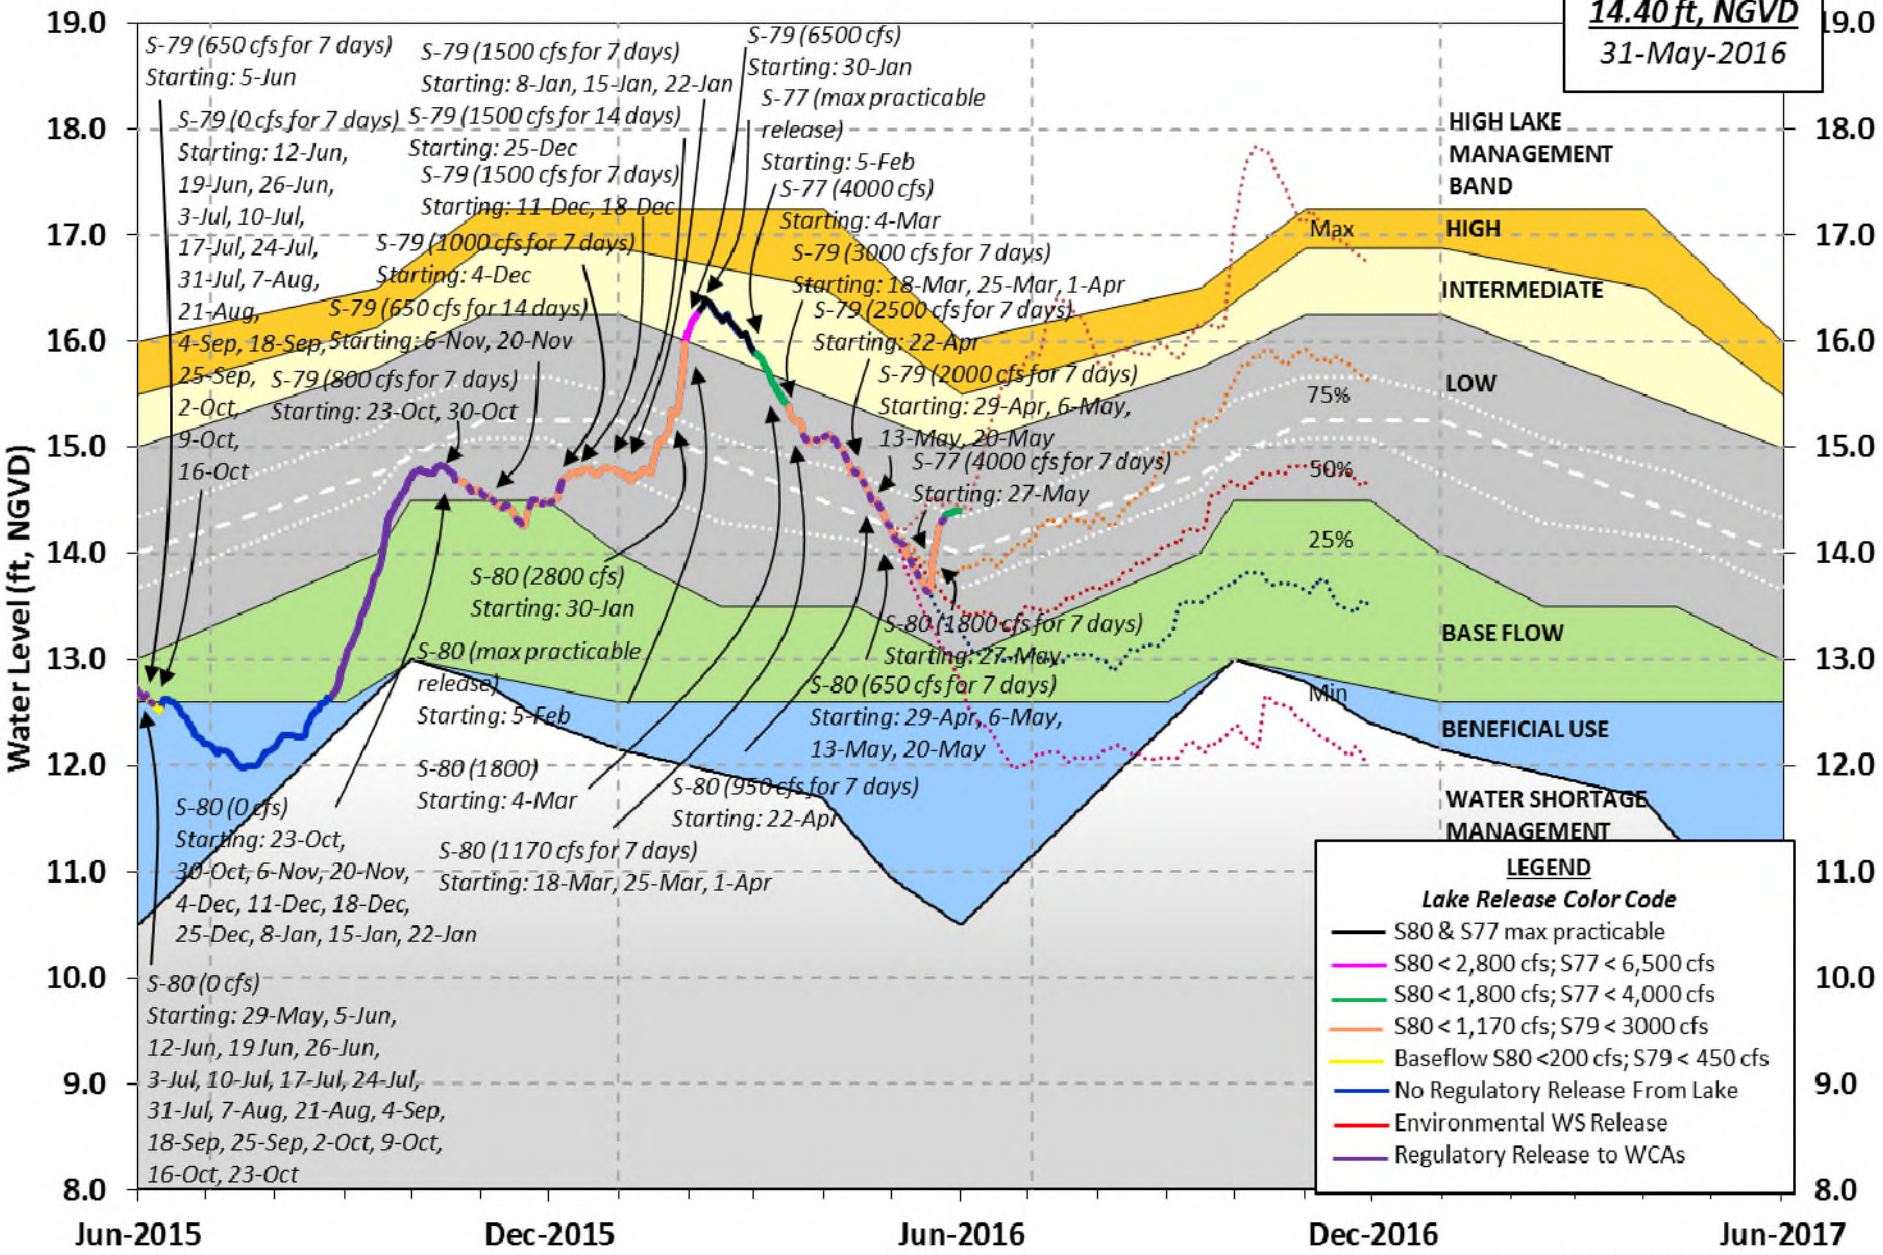

LEGEND

Lake Release Color Code

- S80 & S77 max practicable
- S80 < 2,800 cfs; S77 < 6,500 cfs
- S80 < 1,800 cfs; S77 < 4,000 cfs
- S80 < 1,170 cfs; S79 < 3000 cfs
- Baseflow S80 < 200 cfs; S79 < 450 cfs
- No Regulatory Release From Lake
- Environmental WS Release
- Regulatory Release to WCAs

U. S. Army Corps of Engineers, Jacksonville District
 Lake Okeechobee and Vicinity Report
 ** Preliminary Data - Subject to Revision **

Data Ending 2400 hours 30 MAY 2016

Okeechobee Lake Regulation	Elevation	Last Year	2YRS Ago
	(ft-NGVD)	(ft-NGVD)	(ft-NGVD)
*Okeechobee Lake Elevation	14.40	12.73	12.48 (Official Elv)
Bottom of High Lake Mngmt=	16.04	Top of Water Short Mngmt=	10.51
Currently in Operational Management Band			

Simulated Average LORS2008 [1965-2000]	11.96
Difference from Average LORS2008	2.44

30MAY (1965-2007) Period of Record Average	13.13
Difference from POR Average	1.27

Today Lake Okeechobee elevation is determined from the 4 Int & 4 Edge stations

++Navigation Depth (Based on 2007 Channel Condition Survey) Route 1 ÷ 8.34'
 ++Navigation Depth (Based on 2008 Channel Condition Survey) Route 2 ÷ 6.54'
 Bridge Clearance = -NR-'

4 Interior and 4 Edge Okeechobee Lake Average (Avg-Daily values):

L001	L005	L006	LZ40	S4	S352	S308	S133
14.27	14.47	14.48	14.37	14.32	14.57	-NR-	14.34

*Combination Okeechobee Avg-Daily Lake Average = 14.40
 (*See Note)

Okeechobee Inflows (cfs):

S65E	6567	C5	-99	Fisheating Cr	-NR-
S154	0	S191	0	S135 Pumps	0
S84	128	S133 Pumps	0	S2 Pumps	0
S84X	809	S127 Pumps	0	S3 Pumps	0
S71	303	S129 Pumps	0	S4 Pumps	0
S72	81	S131 Pumps	44		
Total Inflows:	7833				

Okeechobee Outflows (cfs):

S135 Culverts	0	S354	105	S77	(Not Used)
S127 Culverts	0	S351	270	S77Below	4263
(USED)					
S129 Culverts	-NR-	S352	133	S308	(Not Used)

S131 Culverts -NR- L8 Canal Pt 274 S308Below 1783
 (USED)

Total Outflows: No Report Due To Missing S77 or S308 Discharge Data

****S77 Structure outflow is being used to compute Total Outflow.
 ****S308 Structure outflow is being used to compute Total Outflow.

Okeechobee Pan Evaporation (inches):

S77 -NR- S308 -NR-
 Average Pan Evap x 0.75 Pan Coefficient = -NR-" = -NR-'

Lake Average Precipitation using NEXRAD: = -NR-" = -NR-'

Evaporation - Precipitation: = -NR-" = -NR-'

Evaporation - Precipitation using Lake Area of 730 square miles
 is equal to -NR-

Lake Okeechobee (Change in Storage) Flow is 0 cfs or 0 AC-FT

Note: Headwater, tailwater, and stage values below are instantaneous values
 unless otherwise specified.

	Headwater	Tailwater		----- Gate Positions -----						
---	Elevation	Elevation	Disch	#1	#2	#3	#4	#5	#6	#7
#8	(ft-msl)	(ft-msl)	(cfs)	(ft)	(ft)	(ft)	(ft)	(ft)	(ft)	(ft)
(ft)										

(I) see note at bottom

North East Shore

S133 Pumps:	13.78	14.24	0	0	0	0	0	0	0	(cfs)
S193:										
S191:	18.18	14.23	0	0.0	0.0	0.0				
S135 Pumps:	13.59	14.25	0	0	0	0	0			(cfs)
S135 Culverts:			0	-NR-	-NR-					

North West Shore

S65E:	20.88	13.89	6567	2.5	2.8	2.8	2.3	2.3	2.3	
S127 Pumps:	13.44	14.31	0	0	0	0	0	0	0	(cfs)
S127 Culvert:			0	0.0						
S129 Pumps:	_____	-NR-	0	0	0	0				(cfs)
S129 Culvert:			-NR-	-NR-						
S131 Pumps:	13.01	14.32	44	28	34					(cfs)
S131 Culvert:			-NR-							

Fisheating Creek

nr Palmdale	_____		-NR-							
nr Lakeport	_____									
C5:	14.06	14.18	-99	5.2	5.3	5.3				

South Shore

S4 Pumps:	10.87	14.35	0	0	0	0				(cfs)
S169:	14.47	10.87	0	0.0	0.0	0.0				
S310:	14.37		10							
S3 Pumps:	10.24	14.45	0	0	0	0				(cfs)
S354:	14.45	10.24	105	0.2	0.2					
S2 Pumps:	10.09	14.52	0	0	0	0	0			(cfs)
S351:	14.52	10.09	270	0.4	0.3	0.4				
S352:	14.66	10.22	133	0.0	0.4					
C10A:	-NR-	14.46		0.0	0.0	4.0	0.0	0.0		
L8 Canal PT		14.32	274							

S351 and S352 Temporary Pumps/S354 Spillway

S351:	10.09	14.52	270	-NR--NR--NR--NR--NR--NR-
S352:	10.22	14.66	133	-NR--NR--NR--NR-
S354:	10.24	14.45	105	-NR--NR--NR--NR-

Caloosahatchee River (S77, S78, S79)

S47B:	13.44	10.65		0.9	0.9					
S47D:	10.39	10.31	75	6.0						
S77:										
Spillway and Sector Flow:										
-NR- -NR-			4263	5.0	5.0	5.0	5.0			
Flow Due to Lockages+:			-NR-							
S77 Below USGS Flow Gage			4263							
S78:										
Spillway and Sector Flow:										
-NR- -NR-			-NR-	5.0	0.0	5.0	5.0			
Flow Due to Lockages+:			-NR-							
S79:										
Spillway and Sector Flow:										
3.07 1.92			6505	3.0	3.0	3.0	4.0	4.0	3.0	3.0
3.0										
Flow Due to Lockages+:			10							
Percent of flow from S77			-NR-%							
Chloride (ppm)			54							

St. Lucie Canal (S308, S80)

S308:										
Spillway and Sector Flow:										
-NR- -NR-			1783	5.0	5.0	5.0	5.0			
Flow Due to Lockages+:			-NR-							
S308 Below USGS Flow Gage			1783							
S153:	18.75	14.06	48	0.0	0.0					
S80:										
Spillway and Sector Flow:										
-NR- -NR-			-NR-	1.1	1.1	1.1	0.0	1.1	1.1	0.0
Flow Due to Lockages+:			-NR-							
Percent of flow from S308			-NR-%							

Steele Point Top Salinity (mg/ml) ****
 Steele Point Bottom Salinity (mg/ml) ****

Speedy Point Top Salinity (mg/ml) 5469
 Speedy Point Bottom Salinity (mg/ml) 9884

+ Flow Due to lockages is computed utilizing average daily headwater and tailwater along with total number of lockages for the day to calculate a volume which is then converted to an average discharge in cfs.

				----- Wind ---	
Daily Precipitation Totals	1-Day	3-Day	7-Day	Direction	
Speed	(inches)	(inches)	(inches)	(Degø)	
(mph)					
S133 Pump Station:	-NR-	0.00	0.00		
S193:	-NR-	0.00	0.00	-NR-	-NR-
Okeechobee Field Station:	-NR-	0.00	0.00		
S135 Pump Station:	-NR-	0.00	0.00		
S127 Pump Station:	-NR-	0.00	0.00		
S129 Pump Station:	-NR-	0.00	0.00		
S131 Pump Station:	-NR-	0.00	0.00		
S77:	0.00	0.76	0.76	-NR-	-NR-
S78:	0.00	1.03	1.05	-NR-	-NR-
S79:	0.26	0.27	0.27	194	0
S4 Pump Station:	-NR-	0.00	0.00		
Clewiston Field Station:	-NR-	0.00	0.00		
S3 Pump Station:	-NR-	0.00	0.00		
S2 Pump Station:	-NR-	0.00	0.00		
S308:	*****	*****	*****	-NR-	-NR-
S80:	0.97	1.00	1.04	-NR-	-NR-
Okeechobee Average	*****	4951.29	*****		
(Sites S78, S79 and S80 not included)					

Oke Nexrad Basin Avg	-NR-	0.31	0.34		

Okeechobee Lake Elevations	30 MAY 2016	14.40	Difference from
30MAY16			
30MAY16 -1 Day =	29 MAY 2016	14.40	0.00
30MAY16 -2 Days =	28 MAY 2016	14.40	0.00
30MAY16 -3 Days =	27 MAY 2016	14.39	-0.01
30MAY16 -4 Days =	26 MAY 2016	14.38	-0.02
30MAY16 -5 Days =	25 MAY 2016	14.38	-0.02
30MAY16 -6 Days =	24 MAY 2016	14.36	-0.04
30MAY16 -7 Days =	23 MAY 2016	14.32	-0.08
30MAY16 -30 Days =	30 APR 2016	14.21	-0.19
30MAY16 -1 Year =	30 MAY 2015	12.73	-1.67
30MAY16 -2 Year =	30 MAY 2014	12.48	-1.92

Long Term Mean 30day Avearge ET for Lake Alfred (Inches) = -NR-

Lake Okeechobee Net Inflow (LONIN)

Average Flow over the previous 14 days				Avg-Daily Flow
30MAY16	Today =	30 MAY 2016	13937 TUE	6828
30MAY16	-1 Day =	29 MAY 2016	13415 MON	6995
30MAY16	-2 Days =	28 MAY 2016	12589 SUN	8652
30MAY16	-3 Days =	27 MAY 2016	11977 SAT	6601
30MAY16	-4 Days =	26 MAY 2016	11467 FRI	1151
30MAY16	-5 Days =	25 MAY 2016	11162 THU	5558
30MAY16	-6 Days =	24 MAY 2016	10725 WED	9299
30MAY16	-7 Days =	23 MAY 2016	9723 TUE	7350
30MAY16	-8 Days =	22 MAY 2016	8958 MON	11787
30MAY16	-9 Days =	21 MAY 2016	7826 SUN	17360
30MAY16	-10 Days =	20 MAY 2016	6171 SAT	21478
30MAY16	-11 Days =	19 MAY 2016	4221 FRI	38133
30MAY16	-12 Days =	18 MAY 2016	1456 THU	49047
30MAY16	-13 Days =	17 MAY 2016	-1787 WED	4877

S65E

Average Flow over previous 14 days				Avg-Daily Flow
30MAY16	Today=	30 MAY 2016	5782 TUE	6567
30MAY16	-1 Day =	29 MAY 2016	5427 MON	6885
30MAY16	-2 Days =	28 MAY 2016	5055 SUN	6998
30MAY16	-3 Days =	27 MAY 2016	4674 SAT	7377
30MAY16	-4 Days =	26 MAY 2016	4275 FRI	7854
30MAY16	-5 Days =	25 MAY 2016	3836 THU	8252
30MAY16	-6 Days =	24 MAY 2016	3367 WED	8401
30MAY16	-7 Days =	23 MAY 2016	2892 TUE	8468
30MAY16	-8 Days =	22 MAY 2016	2414 MON	5859
30MAY16	-9 Days =	21 MAY 2016	2123 SUN	4474
30MAY16	-10 Days =	20 MAY 2016	1913 SAT	3362
30MAY16	-11 Days =	19 MAY 2016	1784 FRI	2513
30MAY16	-12 Days =	18 MAY 2016	1714 THU	2233
30MAY16	-13 Days =	17 MAY 2016	1661 WED	1710

Lake Okeechobee Outlets Last 14 Days

DATE	S-77 Discharge (0700-2100) (AC-FT)	S-77 Discharge (ALL DAY) (AC-FT)	Below S-77 Discharge (ALL-DAY) (AC-FT)	S-78 Discharge (0700-2100) (AC-FT)	S-78 Discharge (ALL DAY) (AC-FT)	S-79 Discharge (ALL DAY) (AC-FT)
30 MAY 2016			8454	-NR-	-NR-	12919
29 MAY 2016			9291	-NR-	9623	13538
28 MAY 2016			8753	-NR-	9294	11120
27 MAY 2016			5860	-NR-	6195	7480
26 MAY 2016			521	-NR-	2911	3423
25 MAY 2016			1398	-NR-	3080	3418
24 MAY 2016			628	-NR-	4889	7788
23 MAY 2016			784	-NR-	2777	5643
22 MAY 2016			1018	-NR-	3397	7542
21 MAY 2016			158	-NR-	3486	8574

20 MAY 2016			-24	-NR-	6676	10785
19 MAY 2016			35	-NR-	6928	12560
18 MAY 2016			502	-NR-	3280	9485
17 MAY 2016			2380	-NR-	2017	3551

	S-310	S-351	S-352	S-354	L8 Canal Pt
	Discharge	Discharge	Discharge	Discharge	Discharge
	(ALL DAY)	(ALL DAY)	(ALL DAY)	(ALL DAY)	(ALL DAY)
DATE	(AC-FT)	(AC-FT)	(AC-FT)	(AC-FT)	(AC-FT)
30 MAY 2016	20	535	264	208	543
29 MAY 2016	2	331	171	230	548
28 MAY 2016	-23	32	173	16	552
27 MAY 2016	-18	77	355	99	532
26 MAY 2016	-39	28	506	220	537
25 MAY 2016	-162	0	0	0	459
24 MAY 2016	-260	0	0	0	405
23 MAY 2016	-345	0	0	0	371
22 MAY 2016	-312	0	0	0	346
21 MAY 2016	-359	0	0	0	118
20 MAY 2016	-496	0	0	0	-169
19 MAY 2016	-546	0	0	0	-129
18 MAY 2016	-244	0	0	0	182
17 MAY 2016	81	849	603	38	390

	S-308	Below S-308	S-80
	Discharge	Discharge	Discharge
	(ALL DAY)	(ALL-DAY)	(ALL-DAY)
DATE	(AC-FT)	(AC-FT)	(AC-FT)
30 MAY 2016		3535	-NR-
29 MAY 2016		3301	-NR-
28 MAY 2016		3433	2338
27 MAY 2016		1968	1752
26 MAY 2016		472	439
25 MAY 2016		767	609
24 MAY 2016		611	741
23 MAY 2016		823	869
22 MAY 2016		1015	1044
21 MAY 2016		158	-NR-
20 MAY 2016		-22	1175
19 MAY 2016		-54	1124
18 MAY 2016		-169	571
17 MAY 2016		1212	712

*** NOTE: 1) Discharge from (0700-2100) is computed using Spillway and Sector Gate Discharges from 0700 hrs to 2100 hrs.

2) Discharge (ALL DAY) is computed using Spillway, Sector Gate and Lockages Discharges from 0015 hrs to 2400 hrs.

(I) - Flows preceded by "I" signify an instantaneous flow computed from the single value reported for the day

* On 11 May 1999, Lake Okeechobee Elevation was switched from

Instantaneous 2400 value to an average-daily lake average.

On 14 Mar 2001, due to the isolation of various gages within the standard

10 stations, the average of the interior 4 station gages was used as the Lake Okeechobee Elevation.

On 05 November 2010, Lake Okeechobee Elevation was switched to a 9 gage mix of interior and edge gages to obtain a more reliable representation of the lake level.

On 09 May 2011, Lake Okeechobee Elevation was switched to a 8 gage mix of interior and edge gages to obtain a more reliable representation of the lake level due to isolation of S135 from low lake levels.

Today Lake Okechobee elevation is determined from the 4 Int & 4 Edge stations


++ For more information see the Jacksonville District Navigation website at <http://www.saj.usace.army.mil/>

\$ For information regarding Lake Okeechobee Service Area water restrictions please refer to www.sfwmd.gov

—
Report Generated 31MAY2016 @ 07:06 ** Preliminary Data - Subject to Revision
**

Lake Okeechobee

31MAY16 07:00:21

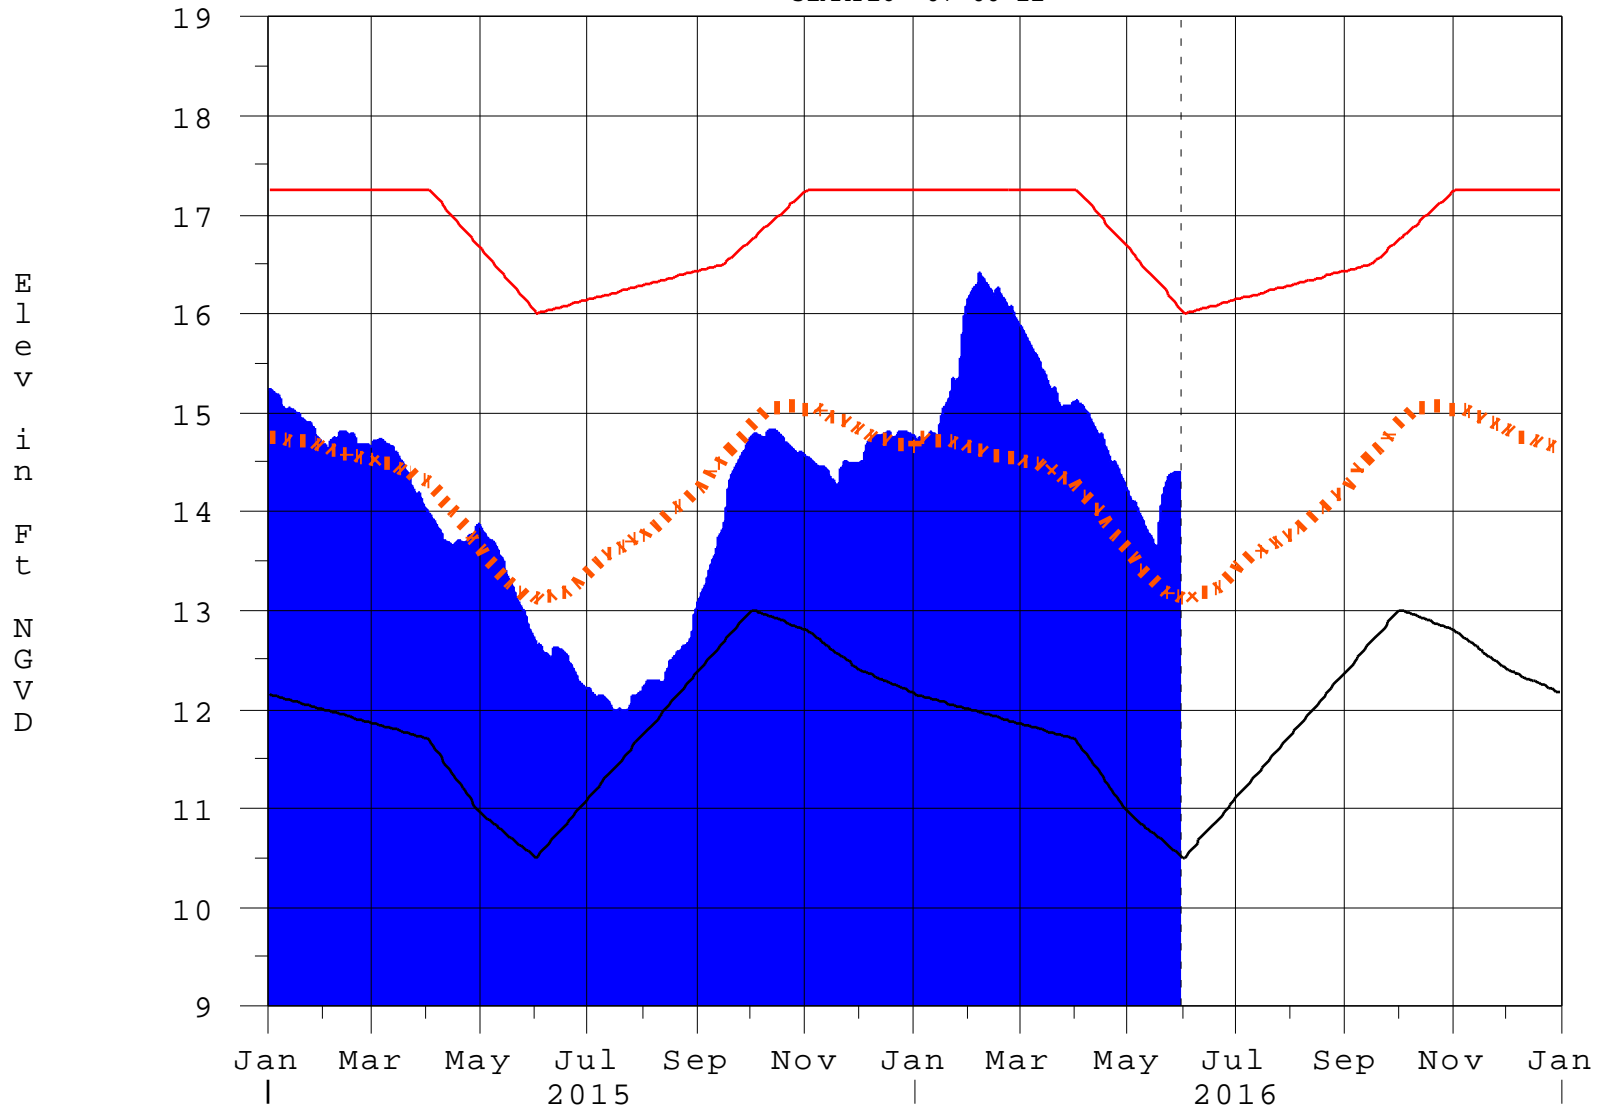

- High Lake Management
- Okeechobee Avg Elev
- Average Elev [1965-2007]
- Water Shortage Management

Classification Tables

Supplemental Tables used in conjunction with the LORS2008 Release

Guidance Flow Charts

- [Class Limits for Tributary Hydrologic Conditions](#)

Table K-2 in the Lake Okeechobee Water Control Plan

- [6-15 Day Precipitation Outlook Categories](#)

Table ?? in the Lake Okeechobee Water Control Plan

- [Classification of Lake Okeechobee Net Inflow for Seasonal Outlook](#)

Table K-3 in the Lake Okeechobee Water Control Plan

- [Classification of Lake Okeechobee Net Inflow for Multi-Seasonal Outlook](#)

Table K-4 in the Lake Okeechobee Water Control Plan

[Back to Lake Okeechobee Operations Main Page](#)

[Back to U.S. Army Corps of Engineers Lake Okeechobee Operations Homepage](#)

Tributary Hydrologic Classification*	Palmer Index Class Limits	2-wk Mean L.O. Net Inflow Class Limits
Very Wet	3.0 or greater	Greater \geq 6000 cfs
Wet	1.5 to 2.99	2500 - 5999 cfs
Near Normal	-1.49 to 1.49	500 - 2499 cfs
Dry	-2.99 to -1.5	-5000 – 500 cfs
Very Dry	-3.0 or less	Less than -5000 cfs

* use the wettest of the two indicators

Classification of Lake Okeechobee Net Inflow Seasonal Outlook*

Lake Net Inflow Prediction [million acre-feet]	Equivalent Depth** [feet]	Lake Okeechobee Net Inflow Seasonal Outlook
> 0.93	> 2.0	Very Wet
0.71 to 0.93	1.51 to 2.0	Wet
0.35 to 0.70	0.75 to 1.5	Normal
< 0.35	< 0.75	Dry

****Volume-depth conversion based on average lake surface area of 467,000 acres**

Classification of Lake Okeechobee Net Inflow Multi-Seasonal Outlook*

Lake Net Inflow Prediction [million acre-feet]	Equivalent Depth** [feet]	Lake Okeechobee Net Inflow Multi-Seasonal Outlook
> 2.0	> 4.3	Very Wet
1.18 to 2.0	2.51 to 4.3	Wet
0.5 to 1.17	1.1 to 2.5	Normal
< 0.5	< 1.1	Dry

****Volume-depth conversion based on average lake surface area of 467,000 acres**

6-15 Day Precipitation Outlook Categories*

6-15 Day Precipitation Outlook Categories	WSE Decision Tree Categories
Above Normal	Wet to Very Wet
Normal	Normal
Below Normal	Dry

* Corresponds to Table 7-6 in the Lake Okeechobee Water Control Plan

Under Construction