


# STA-5 Structures & Flow\*

<span style="color: red;">■</span> Remote Operated Structure	<span style="color: blue;">■</span> Manually Operated Structure
<span style="color: green;">■</span> Passive Structure	

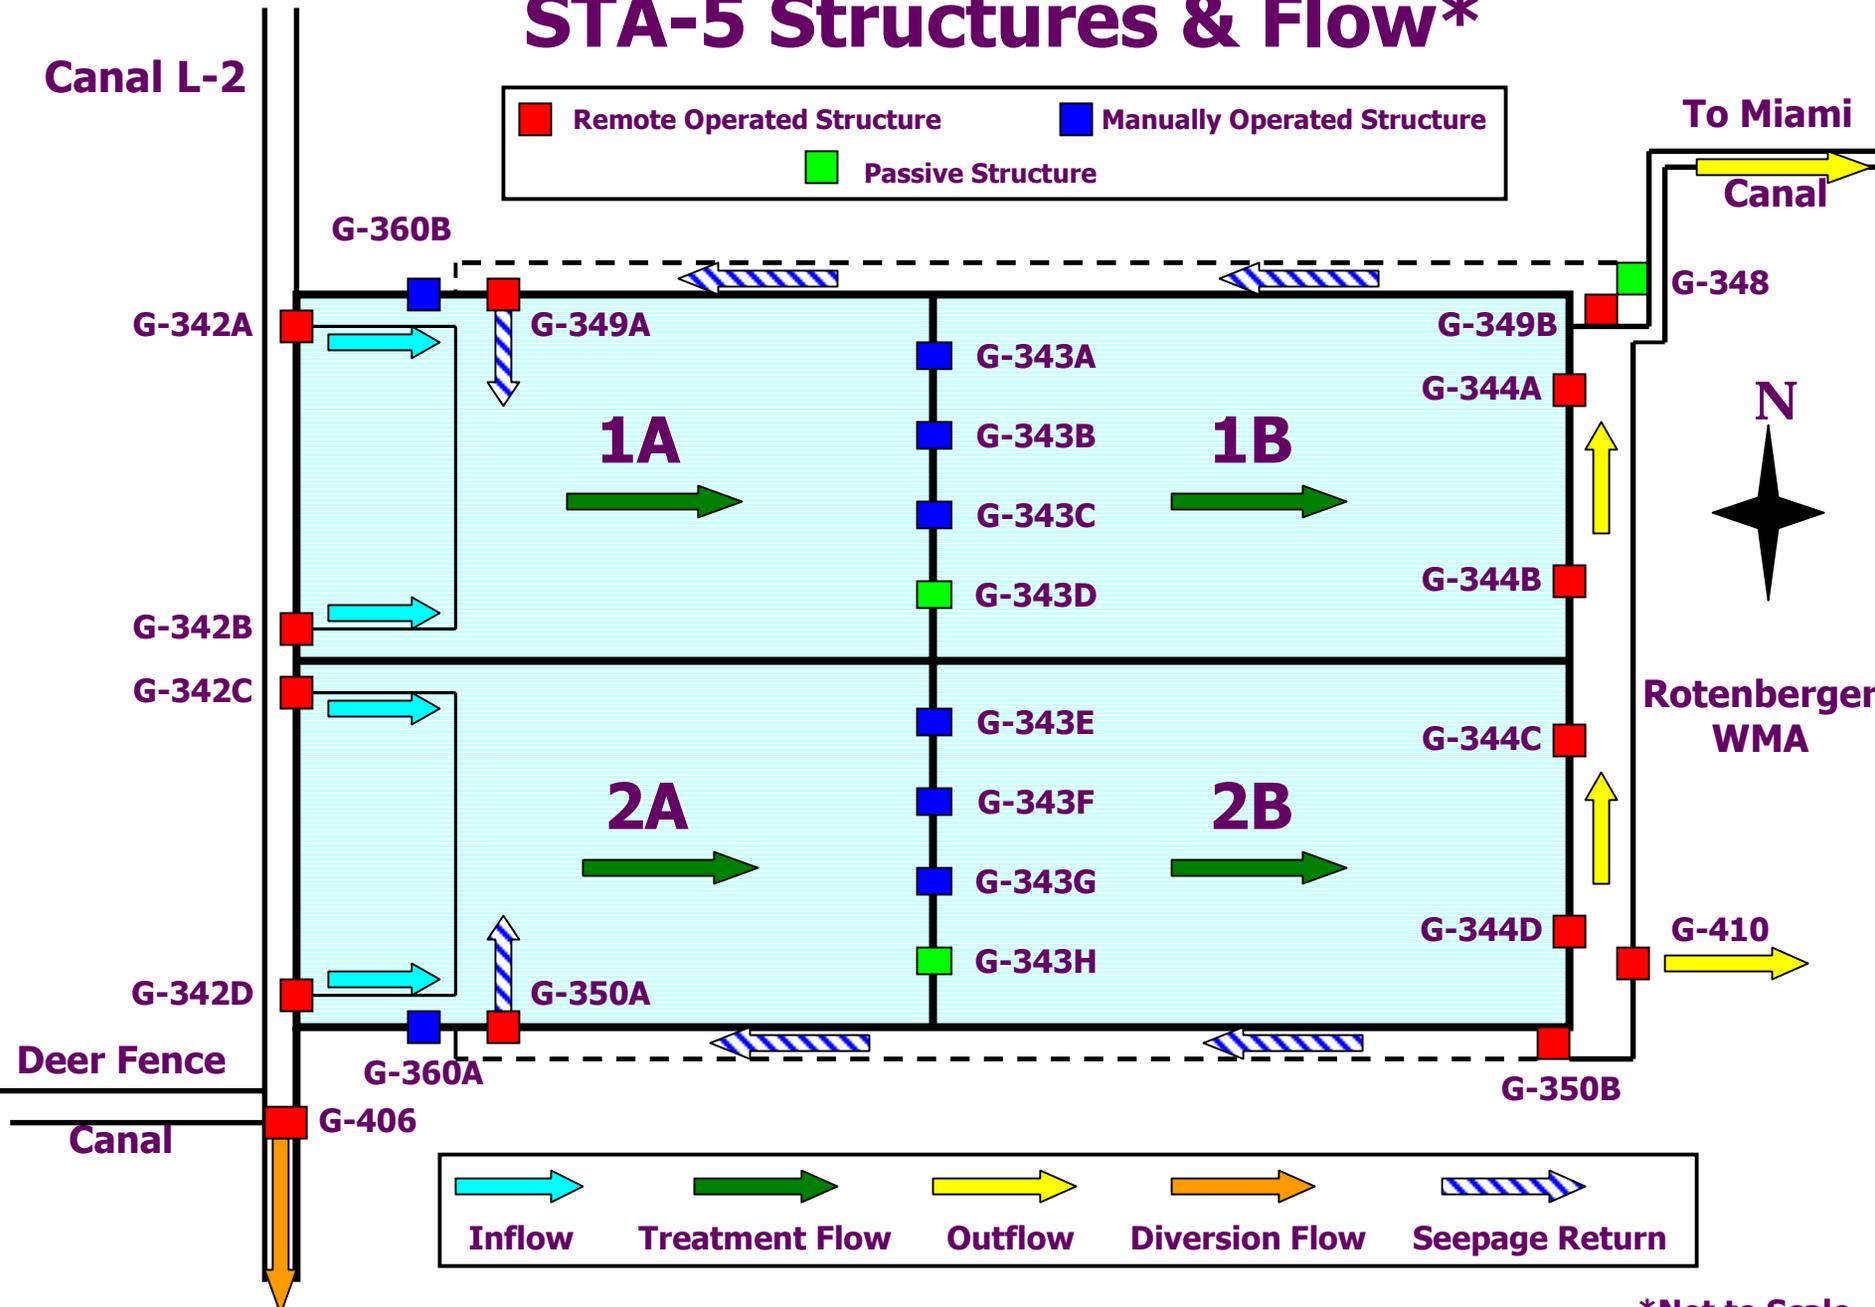


\*Not to Scale

# STA-5 Load Reductions - Water Year 2002

## Preliminary Data

164,000 acre feet treated

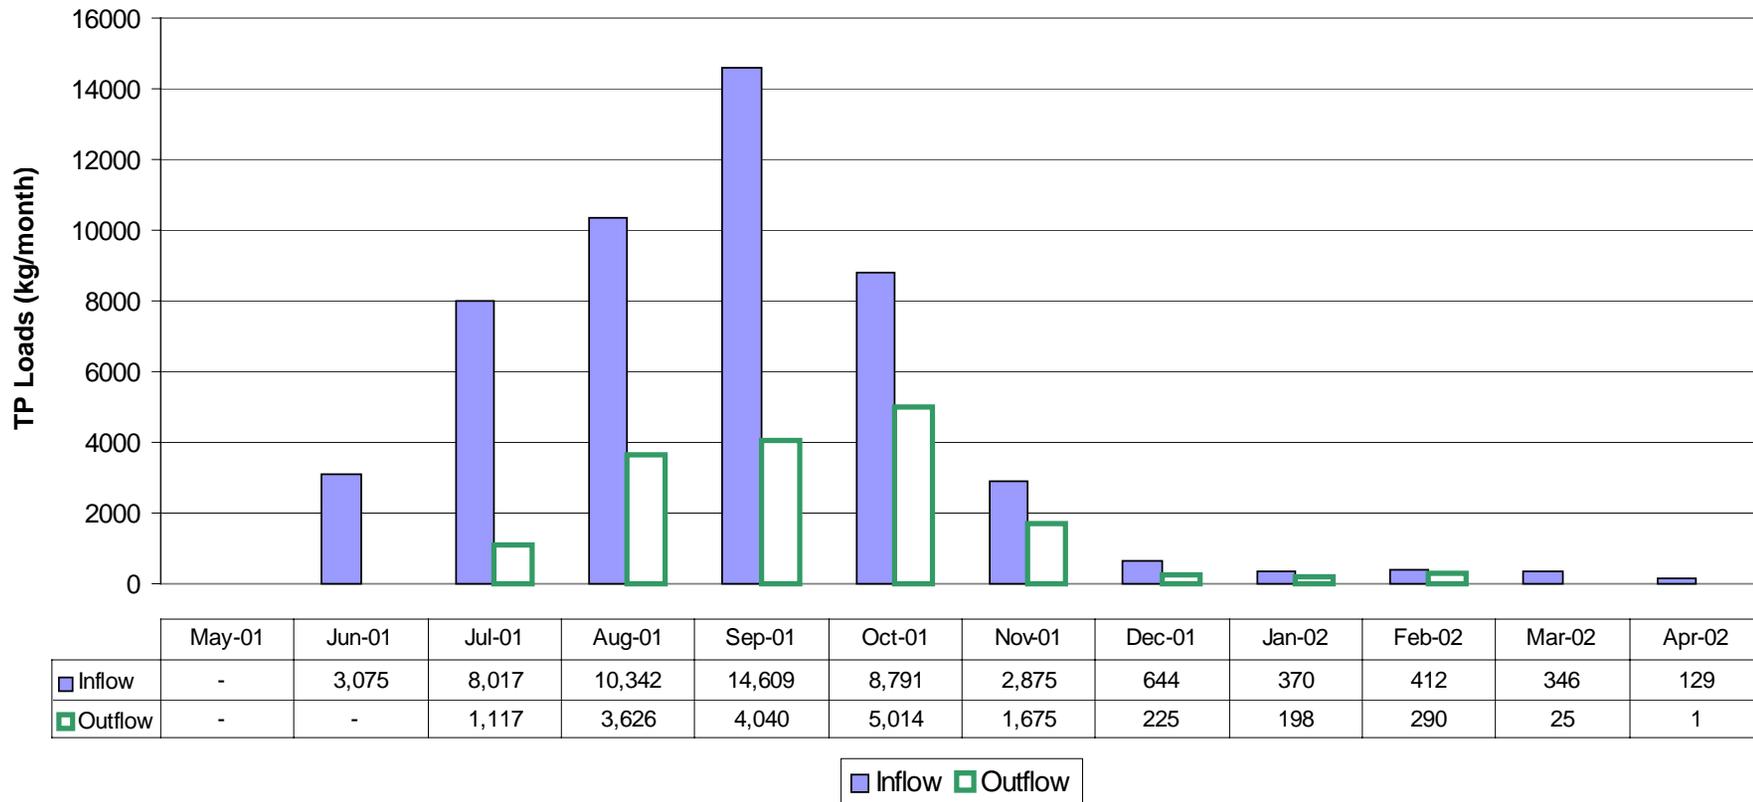


Over 41 tons removed to date

# STA-5 P Concentrations - Water Year 2002

## Preliminary Data

Note: The outlet gates were opened once per month between November and March for maintenance purposes; TP concentrations were elevated due to shallow water conditions.

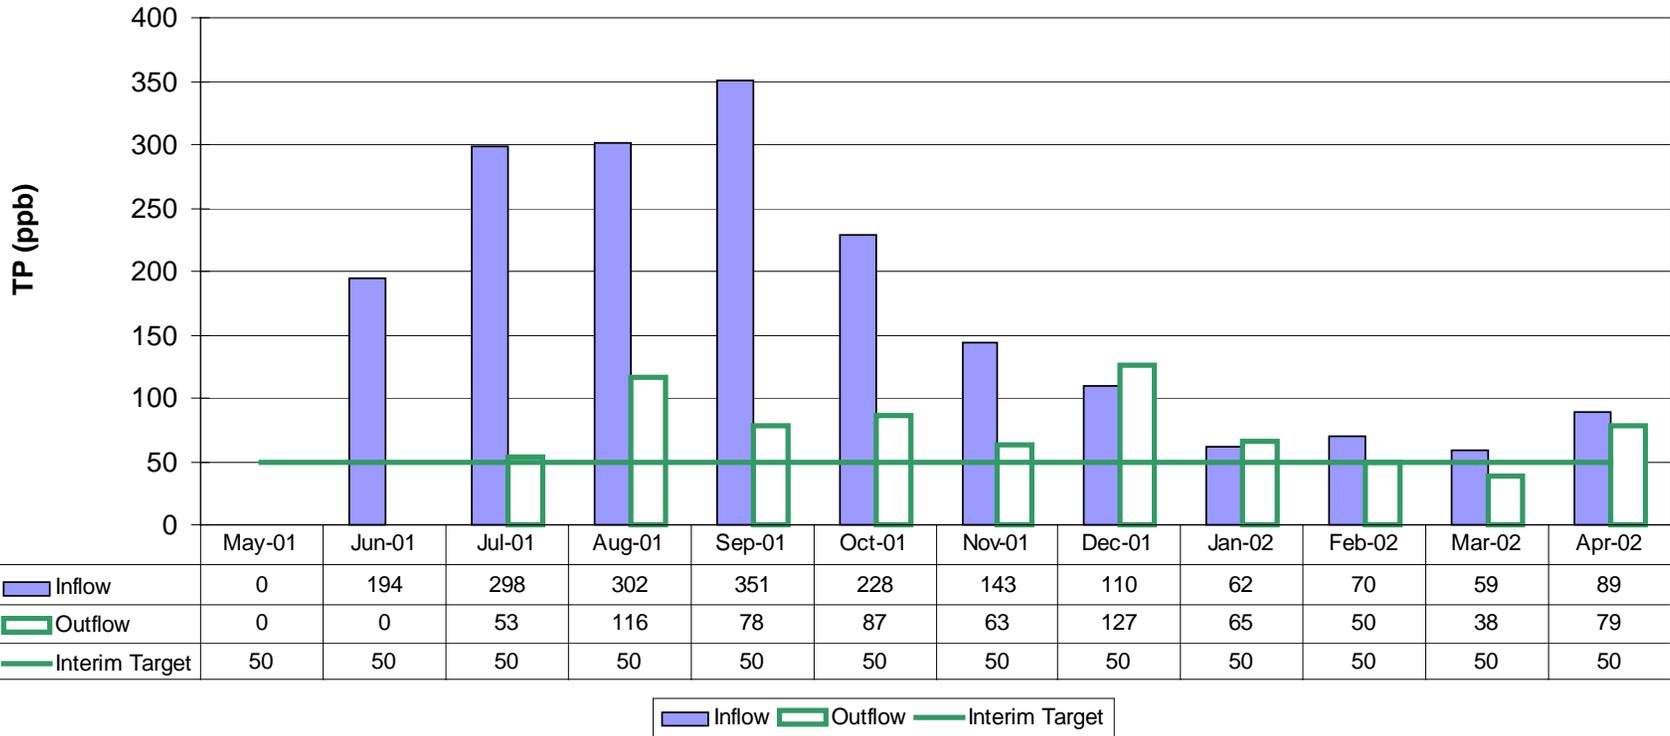


To date: average discharge concentration = 87 ppb

# Rotenberger Inflows - Water Year 2002

Preliminary Data

Inflow averaged 55 ppb

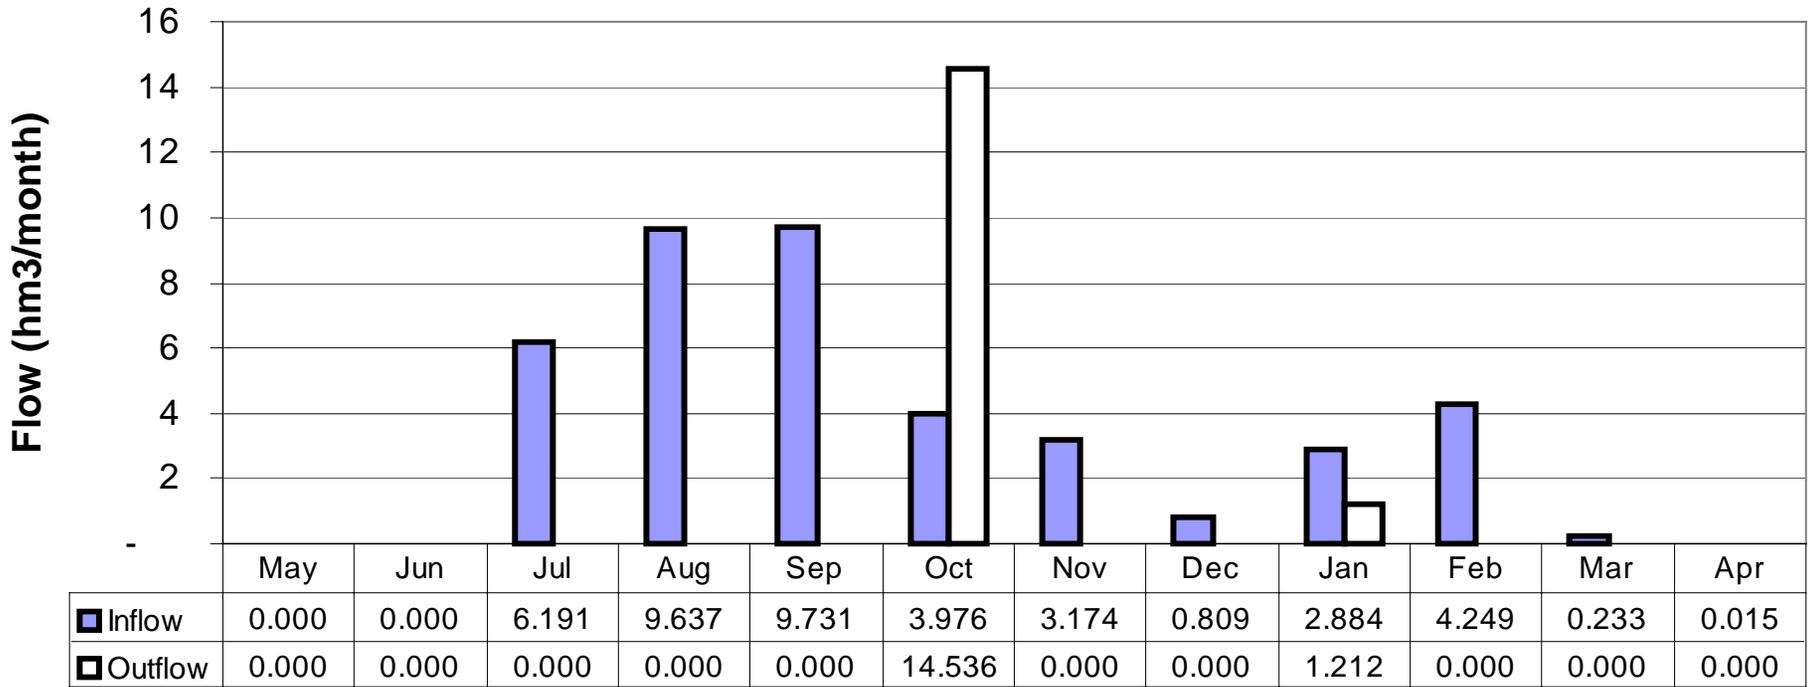

1 hm<sup>3</sup>=810.7 acre

Inflow  Outflow

**Approximately 33,000 AF introduced into Rotenberger**

Average Weekly Stages in Rotenberger  
July 01 to July 02

